

3 - 6 TON PACKAGED GAS/ELECTRIC UNITS

13 SEER / UP TO 11.3 EER

80% AFUE

6-TON WITH TWO-SPEED BLOWER MOTOR AND
TWO-STAGE COMPRESSOR UP TO 15.5 IEER

COOLING CAPACITY: 34,600 — 71,000 BTU/H

HEATING CAPACITY: 36,800 — 110,400 BTU/H



■ Contents

Nomenclature.....	2
Product Specifications.....	4
Expanded Cooling Data	8
Airflow Data	18
Crankcase Heater	24
Dimensions	25
Wiring Diagrams	29
— for Models with DDC Controls	39
Accessories	54

■ Standard Features

- Patented tubular heat exchanger
- High-efficiency scroll compressor
- High and low-pressure switches
- Copper tube / aluminum fin coils
- Contactor with lugs
- High-capacity, steel-cased filter drier
- 24-volt terminal strip
- Convertible airflow orientation
- Easy to service
- Built-in filter rack with standard 2" filters
- Bottom utility entry
- Complies with California Low NOx emissions standards
- 3-6 Tons with single speed blower motor units meet the performance specified in Table 6.8.1A of ASHRAE Standard 90.1-2010
- AHRI Certified; ETL Listed
- 6-Ton with two-speed blower motor and two-stage compressor meet the performance specified as of 1/1/2016 in Table 6.8.1-1 of ASHRAE Standard 90.1-2013

■ Cabinet Features

- Heavy-gauge, galvanized-steel cabinet with UV-resistant powder-paint finish
- Full Perimeter Rail
- Sloped drain pan



* Complete warranty details available from your local distributor or manufacturer's representative or at www.daikincomfort.com.

	D	C	G	060	090	3	B	*	*	*	A	*
	1	2	3	4,5,6	7,8,9	10	11	12	13	14	15	16
	REVISION LEVELS											
	Major & Minor											
BRAND	FACTORY-INSTALLED OPTIONS											
D Daikin	X No Options											
CONFIGURATION	A Non-powered convenience outlet											
C Standard Efficiency (6 - 25 Tons)	B Powered convenience outlet											
S Standard Efficiency (3 - 5 Tons)	C Low-ambient kit											
T High Efficiency (3 - 5 Tons)	D Return air smoke detector											
APPLICATION	E Supply air smoke detector											
C Cooling ¹	F Non-powered convenience outlet; Low-ambient kit											
G Gas Heat	G Non-powered convenience outlet; Return air smoke detector											
H Heat Pump ¹	H Non-powered convenience outlet; Supply air smoke detector											
NOMINAL COOLING CAPACITY	J Non-powered convenience outlet; Return & Supply air smoke detectors											
036 3 Tons 102 8½ Tons 300 25 Tons	K Non-powered convenience outlet; Low-ambient kit; Supply air smoke detector											
048 4 Tons 120 10 Tons	L Non-powered convenience outlet; Low-ambient kit											
060 5 Tons 150 12½ tons	Return & Supply air smoke detectors											
072 6 Tons 180 15 Tons	M Powered convenience outlet; Low-ambient kit											
090 7½ Tons 240 20 Tons	N Powered convenience outlet; Return air smoke detector											
NOMINAL HEATING CAPACITY	O Powered convenience outlet; Return & Supply air smoke detectors											
Gas/Electric A/C H/P Factory-Installed Electric Heat	P Powered convenience outlet; Supply air smoke detector											
045 45,000 BTU/h XXX No Heat	Q Powered convenience outlet; Low-ambient kit; Return air smoke detector											
090 90,000 BTU/h 010 10 kW 030 30 kW	R Powered convenience outlet; Low-ambient kit; Supply air smoke detector											
115 115,000 BTU/h 015 15 kW 031 30 kW	T Powered convenience outlet; Low-ambient kit; Return & Supply air smoke detectors											
140 140,000 BTU/h 016 15 kW 045 45 kW	U Non-powered convenience outlet; Low-ambient kit; Return air smoke detector											
210 210,000 BTU/h 018 18 kW 046 45 kW	V Low-ambient kit; Return air smoke detector											
350 350,000 BTU/h 020 20 kW 060 60 kW	W Low-ambient kit; Supply air smoke detector											
400 400,000 BTU/h 025 25 kW	Y Low-ambient kit; Return & Supply air smoke detectors											
See product specifications for heat size(s) available for each capacity.	Z Return & Supply air smoke detectors											
VOLTAGE	FACTORY-INSTALLED OPTIONS											
1 208-230/1/60 4 460/3/60	X Standard Aluminized Heat Exchanger											
3 208-230/3/60 7 575/3/60	S Stainless-Steel Heat Exchanger											
SUPPLY FAN/DRIVE TYPE/MOTOR	D Hinged Panels											
B Belt Drive (single speed) V Two-Speed Belt Drive (also designates 6-Ton	K Stainless-Steel Heat Exchanger; Hinged Panels											
D Direct Drive (3-5 Tons) with two-stage compressor)	B Phase Monitor											
H High Static (single-speed Belt Drive models only)	J Stainless Steel Heat Exchanger; Phase Monitor											
FACTORY-INSTALLED OPTIONS	M Hinged Panel; Phase Monitor											
A Ultra Low-Leak Downflow Economizer	L Stainless-Steel Heat Exchanger; Hinged Panels; Phase Monitor											
B DDC-BACnet protocol												
F Ultra Low-Leak Downflow Economizer; DDC-BACnet protocol												
H Disconnect Switch (non-fused)												
J Ultra Low-Leak Downflow Economizer; Disconnect Switch (non-fused)												
M Disconnect Switch (non-fused); DDC-BACnet protocol												
R Ultra Low-Leak Downflow Economizer; DDC-BACnet protocol;												
Disconnect Switch (non-fused)												
V Low-Leak Downflow Economizer												
W Low-Leak Downflow Economizer Disconnect Switch (non-fused)												
X No Options												

Note: Not all options available for all products.

¹X= No Options in character 13th

FACTORY-INSTALLED OPTIONS

- Stainless-Steel Heat Exchanger (Gas only units): A tubular heat exchanger made of 409-type stainless steel is installed in the unit.
- Low-Ambient Kit: Allows for cooling operation at lower outdoor temperatures. On the 3- to 6-ton units, cooling operation is extended from 60°F ambient temperature to 35°F outside air temperature. On 7½ -20 ton units, cooling operation is extended from 35°F ambient temperature to 0°F outside air temperature. For 25 ton units, cooling operation is extended from 24°F ambient temperature to 0°F outside air temperature.
- Economizers (Downflow): Based on air conditions, can provide outside air to cool the space.
- Electric Heat Kits (heat pump and cooling units only): Available in all voltage options.
- Non-powered Convenience Outlet: A 120V, 15A, GFCI outlet makes it easier for technicians to service the unit once an electrician runs power to the outlet.
- Powered Convenience Outlet: A 120V, 15A, GFCI outlet powered with a transformer built into the unit. When a factory-installed powered convenience outlet is installed in the equipment, the unit MCA (Min. Circuit Ampacity) will increase by 7.5A for 208/230V units, increase by 3.75A for 460V units, and by 3A for 575V units. The MOP (Max. Overcurrent Protection) device must be sized accordingly.
- Disconnect Switch (non-fused; 3-phase units only): A disconnect switch is installed in the unit and factory wiring will be complete from the switch to the unit. Please note that for air conditioning and heat pump models, the appropriate electric heat kit must be ordered to be factory-installed along with the disconnect switch (non-fused) when it is ordered. Please note that for models with a powered convenience outlet option and a disconnect switch (non-fused) option, the power to the powered convenience outlet will be shut off when the disconnect switch (non-fused) is in the off position.
- Return Air and/or Supply Air Smoke Detectors: Return air and/or supply air smoke detectors are installed in the unit.
- Hinged Access Panels: Allows access to unit's major components. Combined with latches for easy access to control box, compressor, filters and blower motor. Available on all units.
- Two-speed indoor fan blower models are available on 6, 7½, 8½, 10, 12½, 15, 20 & 25 ton units. Section 6.4.3.10.b of ASHRAE Standard 90.1-2010 and Section 6.5.3.2.1.a of ASHRAE Standard 90.1-2013 require a minimum of two fan speeds. Section 140.4(m)1 of California Energy Commission Title 24 2013 contains a similar provision. When the units with the two-speed indoor fan blowers operate on a call for the first stage of cooling, the fan operates at low speed, which is 66% of full speed. When the units operate on a call for the second stage of cooling, the fan operates at full speed. In heating operation, the fan operates at full speed. During ventilation operation, the fan operates at low speed.
- Return Air and/or Supply Air Smoke Detectors: Return air and/or supply air smoke detectors are installed in the unit.
- Hinged Access Panels: Allows access to unit's major components. Combined with latches for easy access to control box, compressor, filters and blower motor. Available on all models.
- Phase Monitor: Phase monitor (3 phase only), available for 3 - 25 ton DS, DC and DT series models. Phase monitor shall provide protection for motors and compressors against problems caused by phase loss, phase reversal and phase unbalance. Phase monitor is equipped with an LED that provides an ON or FAULT indicator.
- DDC Controller: DDC communicating controller, available for 3 - 25 ton DS, DC and DT series models with on-board BACnet® communication interface.

	DCG036 0453D***A*	DCG036 0453B***A*	DCG036 0454B***A*	DCG036 0903D***A*	DCG036 0903B***A*	DCG036 0904B***A*	DCG036 0907B***A*
COOLING CAPACITY							
Total BTU/h	34,600	34,600	34,600	34,600	34,600	34,600	34,600
Sensible BTU/h	25,600	25,600	25,600	25,600	25,600	25,600	25,900
SEER / EER	13 / 11.0	13 / 11.0	13 / 11.0	13 / 11.0	13 / 11.0	13 / 11.0	13 / 11.0
Decibels	78	78	78	78	78	78	78
AHRI Reference #s	6345718	6345718	6345719	6345718	6345718	6345719	6345720
HEATING CAPACITY							
High Input / Output kBTU/h	46 / 36.8	46 / 36.8	46 / 36.8	92 / 74	92 / 74	92 / 74	92 / 74
Steady State Efficiency (AFUE)	80	80	80	80	80	80	80
Temperature Rise Range (°F)	25-55	25-55	25-55	40-70 / 30-60	40-70 / 30-60	40-70 / 30-60	40-70 / 30-60
No. of Burners	2	2	2	4	4	4	3
EVAPORATOR MOTOR / COIL							
Motor Type	Direct Drive	Belt Drive	Belt Drive	Direct Drive	Belt Drive	Belt Drive	Belt Drive
# of Wheels (D x W)	1 (10" x 9")	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")
Indoor Nominal CFM	1,200	1,200	1,200	1,200	1,200	1,200	1,200
Motor Speed Tap (Cooling)	Low Speed	---	---	Low Speed	---	---	---
Indoor Motor FLA (Cooling)	2.50	3.8	1.9	2.50	3.8	1.9	1.9
Horsepower - RPM	⅓ - 890	1.0 - 1725	1.0 - 1725	⅓ - 890	1.0 - 1,725	1.0 - 1,725	1.0 - 1,725
Piston Size (Cooling)	0.072	0.072	0.072	0.068	0.068	0.068	0.068
Filter Size (")	(1) 24 x 24 x 2	(1) 24 x 24 x 2	(1) 24 x 24 x 2	(1) 24 x 24 x 2	(1) 24 x 24 x 2	(1) 24 x 24 x 2	(1) 24 x 24 x 2
Drain Size (NPT)	¾"	¾"	¾"	¾"	¾"	¾"	¾"
R-410A Refrigerant Charge Cir #1(oz.)	83	83	83	83	83	90	90
Evaporator Coil Face Area (ft²)	5.4	5.4	5.4	5.4	5.4	5.4	5.4
Rows Deep/ Fins per Inch	3/16	3/16	3/16	3 / 16	3 / 16	3 / 16	3 / 16
BELT DRIVE EVAP FAN DATA							
# of Wheels (D x W)	---	1 (11" x 10")	1 (11" x 10")	---	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")
Motor Sheave	---	1VL40 X ⅝	1VL40 X ⅝	---	1VL40 X ⅝	1VL40 X ⅝	1VL40 X ⅝
Blower Sheave	---	AK69 X 1	AK69 X 1	---	AK69 X 1	AK69 X 1	AK69 X 1
Belt	---	AX52	AX52	---	AX52	AX52	AX52
CONDENSER FAN / COIL							
Quantity of Condenser Fan Motors	1	1	1	1	1	1	1
Horsepower - RPM	⅓ / 1,090	⅓ / 1,090	⅓ - 890	⅓ / 1,090	⅓ / 1,090	⅓ - 890	⅓ - 1,075
Fan Diameter/ # Fan Blades	22/4	22/4	22/4	22 / 4	22 / 4	22 / 4	22 / 4
Outdoor Nominal CFM	3,800	3,800	3,800	3,800	3,800	3,800	3,800
Face Area (ft²)	17.0	17.0	17.0	18.0	18	18	13
Rows Deep/ Fins per Inch	1 / 24	1 / 24	1 / 24	1 / 22	1 / 22	1 / 22	2 / 16
COMPRESSOR							
Quantity / Stage	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
Compressor RLA / LRA	10.4 / 73.0	10.4 / 73.0	5.8 / 38.0	10.4 / 73.0	10.4 / 73.0	5.8 / 38.0	3.8 / 36.5
ELECTRICAL DATA							
Voltage-Phase-Frequency	208/230-3-60	208/230-3-60	460-3-60	208/230-3-60	208/230-3-60	460-3-60	575-3-60
Outdoor Fan HP / FLA	⅓ / 1.4	⅓ / 1.4	⅓ / 0.8	⅓ / 1.4	⅓ / 1.4	⅓ / 0.8	⅓ / 0.8
Total Unit Amps	14.35	15.65	8.47	14.35	15.65	8.47	6.68
Min. Circuit Ampacity ¹	17	18	10	17	18	10	8
Max. Overcurrent Protection (amps) ²	25	25	15	25	25	15	15
Power Supply Conduit Hole / Knockout	1.125	1.125	1.125	1.125	1.125	1.125	1.125
Low-Voltage Conduit Hole	½"	½"	½"	½"	½"	½"	½"
OPERATING WEIGHT (LBS)	545	545	545	545	545	545	545
SHIP WEIGHT (LBS)	560	560	560	560	560	560	560

¹ Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

² May use fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When a factory-installed powered convenience outlet is installed in the equipment, the unit MCA (Min. Circuit Ampacity) will increase by 7.5A for 208/230V units, increase by 3.75A for 460V units, and by 3A for 575V units. The MOP (Max. Overcurrent Protection) device must be sized accordingly.

	DCG048 0903D***A*	DCG048 0903B***A*	DCG048 0904B***A*	DCG048 1153D***A*	DCG048 1153B***A*	DCG048 1154B***A*	DCG048 1157B***A*
COOLING CAPACITY							
Total BTU/h	45,500	45,500	45,500	45,500	45,500	45,500	45,500
Sensible BTU/h	35,000	35,000	35,000	35,000	35,000	35,000	35,000
SEER / EER	13.0 / 11.3	13.0 / 11.3	13.0 / 11.3	13.0 / 11.3	13.0 / 11.3	13.0 / 11.3	13.0 / 11.3
Decibels	78	78	78	78	78	78	78
AHRI Reference #s	6345722	6345722	6345723	6345722	6345722	6345723	6345724
HEATING CAPACITY							
High Input /Output kBTU/h	92 / 74	92 / 74	92 / 74	115 / 92	115 / 92	115 / 92	115 / 92
Low Input /Output kBTU/h	69 / 55	69 / 55	69 / 55	86.25 / 69	86.25 / 69	86.25 / 69	86.25 / 69
Steady State Efficiency (AFUE)	80	80	80	80	80	80	80
Temperature Rise Range (°F) Hi / Low	30-60 / 15-45	30-60 / 15-45	30-60 / 15-45	40-70 / 25-55	40-70 / 25-55	40-70 / 25-55	40-70 / 25-55
No. of Burners	4	4	4	5	5	5	5
EVAPORATOR MOTOR / COIL							
Motor Type	Direct Drive	Belt Drive	Belt Drive	Direct Drive	Belt Drive	Belt Drive	Belt Drive
Indoor Nominal CFM	1,600	1,600	1,600	1,600	1,600	1,600	1,600
Motor Speed Tap (Cooling)	Medium	---	---	Medium	--	--	--
Indoor Motor FLA (Cooling)	2.87	3.8	1.9	2.87	3.8	1.9	2.3
Horsepower - RPM	½ - 1,000	1.0 / 1,725	1.0 / 1,725	½ - 1,000	1.0 / 1,725	1.0 / 1,725	1½ / 1,725
Piston Size (Cooling)	0.076	0.076	0.076	0.076	0.076	0.076	0.076
Filter Size (#)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)
Drain Size (NPT)	¾"	¾"	¾"	¾"	¾"	¾"	¾"
R-410A Refrigerant Charge (oz.)	103	105	103	103	103	103	105
Evaporator Coil Face Area (ft²)	7.0	7.0	7.0	7.0	7.0	7.0	7.0
Rows Deep / Fins per Inch	4 / 16	4 / 16	4 / 16	4 / 16	4 / 16	4 / 16	4 / 16
BELT DRIVE EVAP FAN DATA							
# of Wheels (D" x W")	---	(1) 11 x 10	(1) 11 x 10	---	(1) 11 x 10	(1) 11 x 10	(1) 11 x 10
Motor Sheave	---	VL44 X ½	VL44 X ½	---	VL44 X ½	VL44 X ½	VL44 X ½
Blower Sheave	---	AK66 X 1	AK66 X 1	---	AK66 X 1	AK66 X 1	AK66 X 1
Belt	---	AX52	AX52	---	AX52	AX52	AX52
CONDENSER FAN / COIL							
Quantity of Condenser Fan Motors	1	1	1	1	1	1	1
Horsepower - RPM	¼ - 1,090	¼ - 1,090	¼ - 890	¼ - 1,090	¼ - 1,090	¼ - 890	¼ - 1,075
Fan Diameter / # Fan Blades	22 / 4	22 / 4	22 / 4	22 / 4	22 / 4	22 / 4	22 / 4
Outdoor Nominal CFM	3,800	3,800	3,800	3,800	3,800	3,800	3,800
Face Area (ft²)	17.0	17.0	17.0	17.0	17.0	17.0	17.0
Rows Deep / Fins per Inch	1 / 24	1 / 24	1 / 24	1 / 24	1 / 24	1 / 24	1 / 24
COMPRESSOR							
Quantity / Stage	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
Compressor RLA / LRA	13.1 / 83.1	13.1 / 83.1	6.1 / 41	13.1 / 83.1	13.1 / 83.1	6.1 / 41	4.4 / 33
ELECTRICAL DATA							
Voltage-Phase-Frequency	208/230-3-60	208/230-3-60	460-3-60	208/230-3-60	208/230-3-60	460-3-60	575-3-60
Outdoor Fan FLA	1.40	1.40	0.80	1.40	1.40	0.80	0.60
Total Unit Amps	17.4	18.3	8.8	17.4	18.3	8.8	7.3
Min. Circuit Ampacity ¹	21	22	10	21	22	10	8
Max. Overcurrent Protection (amps) ²	30	30	15	30	30	15	15
Power Supply Conduit Hole	1.125	1.125	1.125	1.125	1.125	1.125	1.125
Low-Voltage Conduit Hole	½"	½"	½"	½"	½"	½"	½"
OPERATING WEIGHT (LBS)							
SHIP WEIGHT (LBS)	605	605	605	605	605	605	605

¹ Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

² May use fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When a factory-installed powered convenience outlet is installed in the equipment, the unit MCA (Min. Circuit Ampacity) will increase by 7.5A for 208/230V units, increase by 3.75A for 460V units, and by 3A for 575V units. The MOP (Max. Overcurrent Protection) device must be sized accordingly.

	DCG060 0903D***A*	DCG060 0903B***A*	DCG060 0904B***A*	DCG060 1403D***A*	DCG060 1403B***A*	DCG060 1404B***A*	DCG060 1407B***A*
COOLING CAPACITY							
Total BTU/h	58,000	58,000	58,000	58,000	58,000	58,000	58,000
Sensible BTU/h	42,800	42,800	42,800	42,800	42,800	42,800	42,800
SEER / EER	13 / 11.1	13 / 11.1	13 / 11.1	13 / 11.1	13 / 11.1	13 / 11.1	13 / 11.1
Decibels	78	78	78	78	78	78	78
ARI Reference Nos.	6345726	6345726	6345727	6345726	6345726	6345727	6345728
GAS HEATING CAPACITY							
High Input /Output kBTU/h	92 / 74	92 / 74	92 / 74	138 / 110.4	138 / 110.4	138 / 110.4	138 / 110.4
Low Input /Output kBTU/h	69 / 55	69 / 55	69 / 55	103 / 83	103 / 83	103 / 83	103 / 83
Steady State Efficiency (AFUE)	80	80	80	80	80	80	80
Temperature Rise Range (°F)	20-50 / 15-45	20-50 / 15-45	20-50 / 15-45	35-65 / 25-55	35-65 / 25-55	35-65 / 25-55	35-65 / 25-55
No. of Burners	4	4	4	6	6	6	6
EVAPORATOR MOTOR / COIL							
Motor Type	Direct	Belt	Belt	Direct	Belt	Belt	Belt
Indoor Nominal CFM	1,900	1,900	1,900	1,900	1,900	1,900	1,900
Piston Size (Cooling)	0.086	0.086	0.086	0.086	0.086	0.086	0.086
Filter Size (#)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)	14 x 20 x 2 (4)
Drain Size (NPT)	¾"	¾"	¾"	¾"	¾"	¾"	¾"
R-410A Refrigerant Charge (oz.)	100.8	100.8	100.8	100.8	100.8	100.8	100.8
Face Area (ft²)	7.8	7.8	7.8	7.8	7.8	7.8	7.8
Rows Deep/ Fins per Inch	4 / 16	4 / 16	4 / 16	4 / 16	4 / 16	4 / 16	4 / 16
Tube Diameter - Material	5/16 - Copper	5/16 - Copper	5/16 - Copper	5/16 - Copper	5/16 - Copper	5/16 - Copper	5/16 - Copper
BELT DRIVE EVAP FAN DATA							
# of Wheels (D x W)	---	1 (11" x 10")	1 (11" x 10")	---	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")
Motor Sheave	---	VL44 X ¾"	VL44 X ¾"	---	VL44 X ¾"	VL44 X ¾"	VL44 X ¾"
Blower Sheave	---	AK61 X 1	AK61 X 1	---	AK61 X 1	AK61 X 1	AK61 X 1
Belt	---	AX5	AX53	---	AX53	AX53	AX53
CONDENSER FAN / COIL							
Horsepower / RPM	¼ / 1,090	¼ / 1,090	¼ / 1,090	¼ / 1,090	¼ / 1,090	¼ / 1,090	¼ / 1,075
Fan Diameter/ # Fan Blades	22 / 4	22 / 4	22 / 4	22 / 4	22 / 4	22 / 4	22 / 1
Outdoor Nominal CFM	3,800	3,800	3,800	3,800	3,800	3,800	3,800
Face Area (ft²)	13.0	13.0	13.0	13.0	13.0	13.0	13.0
Rows Deep/ Fins per Inch	2 / 27	2 / 27	2 / 27	2 / 27	2 / 27	2 / 27	2 / 27
Tube Diameter - Material	5MM - Copper	5MM - Copper	5MM - Copper	5MM - Copper	5MM - Copper	5MM - Copper	5MM - Copper
COMPRESSOR							
Quantity / Stage	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single	1 / Single
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
Compressor RLA / LRA	16 / 110	16 / 110	7.8 / 52	16 / 110	16 / 110	7.8 / 52	5.7 / 38.9
ELECTRICAL DATA							
Voltage-Phase-Frequency	208/230-3-60	208/230-3-60	460-3-60	208/230-3-60	208/230-3-60	460-3-60	575-3-60
Outdoor Fan HP / FLA	¼ / 1.40	¼ / 1.40	¼ / 0.8	¼ / 1.40	¼ / 1.40	¼ / 0.8	¼ / 0.6
Min. Circuit Ampacity ¹	29	25	13	29	25	12	10
Max. Overcurrent Protection ²	45 amps	40 amps	20 amps	40 amps	40 amps	20 amps	15 amps
Entrance Power Supply	1.125	1.125	1.125	1.125	1.125	1.125	1.125
Entrance Control Voltage	½"	½"	½"	½"	½"	½"	½"
OPERATING WEIGHT (LBS)	625	625	625	625	625	625	625
SHIP WEIGHT (LBS)	650	650	650	650	650	650	650

¹ Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

² May use fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When a factory-installed powered convenience outlet is installed in the equipment, the unit MCA (Min. Circuit Ampacity) will increase by 7.5A for 208/230V units, increase by 3.75A for 460V units, and by 3A for 575V units. The MOP (Max. Overcurrent Protection) device must be sized accordingly.

	DCG072 1403B***A*	DCG072 1403V***A*	DCG072 1404B***A*	DCG072 1404V***A*	DCG072 1407B***A*	DCG072 1407V***A*
COOLING CAPACITY						
Total BTU/h	71,000	69,000	71,000	69,000	71,000	69,000
Sensible BTU/h	49,800	51,000	49,800	51,000	49,800	51,000
EER / IEER	11.0 / 11.2	11.2/15.5	11.0 / 11.2	11.2/15.5	11.0 / 11.2	11.2/15.5
Decibels	78	78	78	78	78	78
AHRI Number	6345695	8952850	6345695	8952850	6345695	8952850
HEATING CAPACITY						
High Input / Output KBTU/h	138 / 110.4	138 / 110.4	138 / 110.4	138 / 110.4	138 / 110.4	138 / 110.4
Low Input/ Output KBTU/h	103 / 83	103 / 83	103 / 83	103 / 83	103 / 83	103 / 83
Steady State Efficiency	80	80	80	80	80	80
Temperature Rise Range (°F)	30-60 / 15-45	30-60 / 15-45	30-60 / 15-45	30-60 / 15-45	30-60 / 15-45	30-60 / 15-45
No. of Burners	6	6	6	6	6	6
EVAPORATOR MOTOR / COIL						
Motor Type	Belt Drive	2-speed Belt Drive	Belt Drive	2-speed Belt Drive	Belt Drive	2-speed Belt Drive
# of Wheels (D x W)	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")	1 (11" x 10")
Indoor Nominal CFM	2,350	2,350	2,350	2,350	2,350	2,350
Indoor Motor FLA (Cooling)	5.0	6.0	2.5	2.9	2.3	2.4
Horsepower - RPM	1.5-1,725	2.0-1,725	1.5-1,725	2.0-1,725	1.5-1,725	2.0-1,725
Piston Size (Cooling)	0.094	TXV	0.094	TXV	0.094	TXV
Filter Size (Qty)	(4) 16" x 20" x 2"	(4) 16" x 20" x 2"	(4) 16" x 20" x 2"	(4) 16" x 20" x 2"	(4) 16" x 20" x 2"	(4) 16" x 20" x 2"
Drain Size (NPT)	¾"	¾"	¾"	¾"	¾"	¾"
R-410A Refrigerant Charge (oz.)	146.0	146.0	146.0	146.0	146.0	146.0
Evaporator Coil Face Area (ft²)	8.9	8.9	8.9	8.9	8.9	8.9
Rows Deep/ Fins per Inch	4/ 16	4/ 16	4/ 16	4/ 16	4/ 16	4/ 16
Motor Sheave	VL44 X 7/8	VL44 X 7/8	VL44 X 7/8	1VM50 X 7/8	VL44 X 7/8	VL44 X 7/8
Blower Sheave	AK59 X 1	AK59 X 1	AK59 X 1	AK59 X 1	AK59 X 1	AK59 X 1
Belt	AX53	AX53	AX53	AX53	AX53	AX53
CONDENSER FAN / COIL						
Quantity of Condenser Fan Motors	1	1	1	1	1	1
Horsepower - RPM	⅓ - 1,075	⅓ - 1,075	⅓ - 1,075	⅓ - 1,075	⅓ - 1,075	⅓ - 1,075
Fan Diameter/ # Fan Blades	22/ 4	22/ 4	22/ 4	22/ 4	22/ 4	22/ 4
Outdoor Nominal CFM	4,200	4,200	4,200	4,200	4,200	4,200
Face Area (ft²)	19	19	19	19	19	19
Rows Deep/ Fins per Inch	2/ 27	2/ 27	2/ 27	2/ 27	2/ 27	2/ 27
COMPRESSOR						
Quantity / Stage	1 / Single	1 / Two	1 / Single	1 / Two	1 / Single	1 / Two
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
Compressor RLA / LRA	19/ 123	17.6/136	9.7/ 62	8.5/66.1	7.4/ 50	6.3/55.3
ELECTRICAL DATA						
Voltage/ Phase/ Frequency	208-230/ 3/ 60	208-230/ 3/ 60	460/ 3/ 60	460/ 3/ 60	575/ 3/ 60	575/ 3/ 60
Outdoor Fan FLA	1.90	2.00	1.20	0.90	0.90	0.70
Total Unit Amps	25.9	25.6	13.4	12.3	10.6	9.4
Min. Circuit Ampacity¹	31	30	16	14.4	12	11.0
Max. Overcurrent Protection²	45 amps	45 amps	25 amps	20 amps	15 amps	15 amps
Entrance Power Supply	1.125"	1.125"	1.125"	1.125"	1.125"	1.125"
Entrance Control Voltage	½"	½"	½"	½"	½"	½"
OPERATING WEIGHT (LBS)	690	690	690	690	690	690
SHIP WEIGHT (LBS)	715	715	715	715	715	715

¹ Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

² May use fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When a factory-installed powered convenience outlet is installed in the equipment, the unit MCA (Min. Circuit Ampacity) will increase by 7.5A for 208/230V units, increase by 3.75A for 460V units, and by 3A for 575V units. The MOP (Max. Overcurrent Protection) device must be sized accordingly.

www.daikinac.com

		OUTDOOR AMBIENT TEMPERATURE												115																	
		65						75						85						95						105					
IDB	AIRFLOW	59	63	67	71	75	79	83	87	91	95	99	103	107	111	115	119	123	127	131	135	139	143	147	151	155	159	163	167	171	
		ENTERING INDOOR WET BULB TEMPERATURE																													
80		MBh	35.1	35.9	38.3	41.0	44.3	47.6	50.9	54.2	57.5	60.8	64.1	67.4	70.7	74.0	77.3	80.6	83.9	87.2	90.5	93.8	97.1	100.4	103.7	107.0	110.3	113.6	116.9	120.2	
		S/T	0.90	0.85	0.69	0.51	0.93	0.88	0.71	0.53	0.35	0.17	-0.01	-0.19	-0.37	-0.55	-0.73	-0.91	-1.09	-1.27	-1.45	-1.63	-1.81	-1.99	-2.17	-2.35	-2.53	-2.71	-2.89	-3.07	
	1350	ΔT	22	21	18	14	22	21	18	15	12	10	8	6	4	2	0	-2	-4	-6	-8	-10	-12	-14	-16	-18	-20	-22	-24	-26	
		kW	2.47	2.52	2.60	2.67	2.65	2.70	2.78	2.87	2.95	3.04	3.12	3.20	3.28	3.36	3.44	3.52	3.60	3.68	3.76	3.84	3.92	4.00	4.08	4.16	4.24	4.32	4.40	4.48	
		Amps	8.6	8.8	9.0	9.2	9.1	9.3	9.5	9.8	10.1	10.4	10.7	11.0	11.3	11.6	11.9	12.2	12.5	12.8	13.1	13.4	13.7	14.0	14.3	14.6	14.9	15.2	15.5	15.8	
		HI PR	225	242	256	267	253	272	287	299	287	309	326	340	352	364	376	388	400	412	424	436	448	460	472	484	496	508	520	532	544
		LO PR	109	116	127	135	116	123	134	143	120	128	139	148	126	134	146	156	166	176	186	196	206	216	226	236	246	256	266	276	
		MBh	34.1	34.8	37.2	39.8	43.3	46.6	49.9	53.2	56.5	59.8	63.1	66.4	69.7	73.0	76.3	79.6	82.9	86.2	89.5	92.8	96.1	99.4	102.7	106.0	109.3	112.6	115.9	119.2	122.5
		S/T	0.86	0.81	0.66	0.49	0.89	0.84	0.68	0.51	0.34	0.17	-0.01	-0.19	-0.37	-0.55	-0.73	-0.91	-1.09	-1.27	-1.45	-1.63	-1.81	-1.99	-2.17	-2.35	-2.53	-2.71	-2.89	-3.07	
		ΔT	22	22	19	15	23	22	19	15	12	10	8	6	4	2	0	-2	-4	-6	-8	-10	-12	-14	-16	-18	-20	-22	-24	-26	-28
	kW	2.46	2.50	2.58	2.65	2.63	2.68	2.76	2.85	2.93	3.02	3.10	3.19	3.27	3.36	3.44	3.52	3.60	3.68	3.76	3.84	3.92	4.00	4.08	4.16	4.24	4.32	4.40	4.48	4.56	
1050		Amps	8.6	8.7	8.9	9.2	9.1	9.2	9.5	9.7	9.6	9.8	10.1	10.4	10.7	11.0	11.3	11.6	11.9	12.2	12.5	12.8	13.1	13.4	13.7	14.0	14.3	14.6	14.9	15.2	
		HI PR	223	240	253	264	250	269	284	296	284	306	323	337	350	363	376	389	402	415	428	441	454	467	480	493	506	519	532	545	
		LO PR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	163	172	181	190	199	208	217	226	235	244	253	262	
		MBh	31.4	32.1	34.3	36.7	40.7	44.3	47.9	51.5	55.1	58.7	62.3	65.9	69.5	73.1	76.7	80.3	83.9	87.5	91.1	94.7	98.3	101.9	105.5	109.1	112.7	116.3	119.9	123.5	127.1
		S/T	0.83	0.78	0.63	0.47	0.86	0.81	0.66	0.49	0.32	0.15	-0.02	-0.19	-0.36	-0.53	-0.70	-0.87	-1.04	-1.21	-1.38	-1.55	-1.72	-1.89	-2.06	-2.23	-2.40	-2.57	-2.74	-2.91	
		ΔT	23	22	19	15	23	22	19	15	12	10	8	6	4	2	0	-2	-4	-6	-8	-10	-12	-14	-16	-18	-20	-22	-24	-26	-28
		kW	2.40	2.45	2.52	2.59	2.57	2.62	2.70	2.78	2.86	2.95	3.03	3.11	3.19	3.27	3.35	3.43	3.51	3.59	3.67	3.75	3.83	3.91	3.99	4.07	4.15	4.23	4.31	4.39	
		Amps	8.4	8.5	8.7	9.0	8.9	9.0	9.3	9.5	9.4	9.6	9.9	10.1	10.4	10.7	11.0	11.3	11.6	11.9	12.2	12.5	12.8	13.1	13.4	13.7	14.0	14.3	14.6	14.9	
		HI PR	216	233	246	256	243	261	276	287	276	297	313	327	341	355	369	383	397	411	425	439	453	467	481	495	509	523	537	551	565
		LO PR	105	112	122	130	111	118	129	137	115	123	134	143	121	129	141	150	159	168	177	186	195	204	213	222	231	240	249	258	267
85		MBh	35.7	36.4	38.1	40.7	44.3	47.9	51.5	55.1	58.7	62.3	65.9	69.5	73.1	76.7	80.3	83.9	87.5	91.1	94.7	98.3	101.9	105.5	109.1	112.7	116.3	119.9	123.5	127.1	
		S/T	0.95	0.91	0.82	0.67	0.98	0.93	0.85	0.69	0.52	0.35	0.18	0.01	-0.16	-0.32	-0.48	-0.64	-0.80	-0.96	-1.12	-1.28	-1.44	-1.60	-1.76	-1.92	-2.08	-2.24	-2.40	-2.56	
	1350	ΔT	23	23	21	18	23	23	21	18	15	12	10	8	6	4	2	0	-2	-4	-6	-8	-10	-12	-14	-16	-18	-20	-22	-24	
		kW	2.49	2.54	2.61	2.69	2.67	2.72	2.80	2.89	2.97	3.06	3.14	3.22	3.30	3.38	3.46	3.54	3.62	3.70	3.78	3.86	3.94	4.02	4.10	4.18	4.26	4.34	4.42	4.50	
		Amps	8.7	8.8	9.0	9.3	9.2	9.4	9.6	9.9	9.8	10.0	10.2	10.5	10.8	11.1	11.4	11.7	12.0	12.3	12.6	12.9	13.2	13.5	13.8	14.1	14.4	14.7	15.0	15.3	
		HI PR	227	245	258	269	255	274	290	302	290	312	330	344	358	372	386	400	414	428	442	456	470	484	498	512	526	540	554	568	
		LO PR	110	117	128	137	117	124	135	144	121	129	141	150	127	135	148	158	167	176	185	194	203	212	221	230	239	248	257	266	
		MBh	34.7	35.3	37.0	39.5	43.9	47.5	51.1	54.7	58.3	61.9	65.5	69.1	72.7	76.3	79.9	83.5	87.1	90.7	94.3	97.9	101.5	105.1	108.7	112.3	115.9	119.5	123.1	126.7	
		S/T	0.90	0.87	0.79	0.64	0.93	0.90	0.81	0.66	0.50	0.34	0.18	0.02	-0.14	-0.30	-0.46	-0.62	-0.78	-0.94	-1.10	-1.26	-1.42	-1.58	-1.74	-1.90	-2.06	-2.22	-2.38	-2.54	
		ΔT	24	24	22	19	24	24	23	20	17	14	12	10	8	6	4	2	0	-2	-4	-6	-8	-10	-12	-14	-16	-18	-20	-22	
	kW	2.47	2.52	2.60	2.67	2.65	2.70	2.78	2.87	2.95	3.04	3.12	3.20	3.28	3.36	3.44	3.52	3.60	3.68	3.76	3.84	3.92	4.00	4.08	4.16	4.24	4.32	4.40	4.48		
1200		Amps	8.6	8.8	9.0	9.2	9.1	9.3	9.5	9.8	9.7	9.9	10.1	10.4	10.7	11.0	11.3	11.6	11.9	12.2	12.5	12.8	13.1	13.4	13.7	14.0	14.3	14.6	14.9	15.2	
		HI PR	225	242	256	267	253	272	287	299	287	309	326	340	352	364	376	388	400	412	424	436	448	460	472	484	496	508	520	532	
		LO PR	109	116	127	135	116	123	134	143	120	128	139	148	126	134	146	156	166	176	186	196	206	216	226	236	246	256	266	276	
		MBh	32.0	32.6	34.2	36.4	41.1	44.7	48.3	51.9	55.5	59.1	62.7	66.3	69.9	73.5	77.1	80.7	84.3	87.9	91.5	95.1	98.7	102.3	105.9	109.5	113.1	116.7	120.3	123.9	
		S/T	0.87	0.84	0.76	0.61	0.90	0.87	0.78	0.64	0.49	0.34	0.19	0.04	-0.11	-0.26	-0.41	-0.56	-0.71	-0.86	-1.01	-1.16	-1.31	-1.46	-1.61	-1.76	-1.91	-2.06	-2.21		
		ΔT	24	24	23	20	25	24	23	20	17	14	12	10	8	6	4	2	0	-2	-4	-6	-8	-10	-12	-14	-16	-18	-20	-22	
		kW	2.42	2.47	2.54	2.61	2.59	2.64	2.72	2.80	2.88	2.97	3.06	3.14	3.22	3.30	3.38	3.46	3.54	3.62	3.70	3.78	3.86	3.94	4.02	4.10	4.18	4.26	4.34		
		Amps	8.5	8.6	8.8	9.0	8.9	9.1	9.3	9.6	9.5	9.7	9.9	10.2	10.4	10.7	11.0	11.3	11.6	11.9	12.2	12.5	12.8	13.1	13.4	13.7	14.0	14.3	14.6	14.9	
		HI PR	218	235	248	259	245	264	278	290	279	300	317	330	341	351	361	371	381	391	401	411	421	431	441	451	461	471	481	491	
		LO PR	106	113	123	131	112	119	130	139	116	124	135	144	122	130	142	151	160</												

		OUTDOOR AMBIENT TEMPERATURE																									
		65				75				85				95				105				115					
		ENTERING INDOOR WET BULB TEMPERATURE																									
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70		MIBh	44.6	46.2	50.6	-	43.5	45.1	49.5	-	42.5	44.1	48.3	-	41.5	43.0	47.1	-	39.4	40.8	44.7	-	36.5	37.8	41.4	-	
		S/T	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.45	-	0.81	0.68	0.47	-	0.84	0.70	0.49	-	0.85	0.71	0.49	-	
		ΔT	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	16	14	10	-	
	1800	kW	3.13	3.19	3.29	-	3.36	3.43	3.53	-	3.56	3.63	3.75	-	3.74	3.82	3.94	-	3.89	3.97	4.10	-	4.02	4.10	4.23	-	
		Amps	10.2	10.4	10.6	-	10.8	11.0	11.3	-	11.5	11.7	12.0	-	12.1	12.3	12.6	-	12.7	12.9	13.3	-	13.3	13.5	13.9	-	
		HI PR	239	257	271	-	268	288	304	-	305	328	346	-	347	373	394	-	390	420	444	-	431	464	490	-	
		LO PR	110	117	128	-	116	124	135	-	121	129	141	-	127	135	148	-	133	142	155	-	138	147	160	-	
		MIBh	43.3	44.9	49.2	-	42.3	43.8	48.0	-	41.3	42.8	46.9	-	40.3	41.7	45.7	-	38.3	39.6	43.4	-	35.4	36.7	40.2	-	
		S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.81	0.68	0.47	-	
		ΔT	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-	
1400		kW	3.11	3.17	3.27	-	3.33	3.40	3.51	-	3.53	3.61	3.72	-	3.71	3.79	3.90	-	3.86	3.94	4.06	-	3.99	4.07	4.20	-	
		Amps	10.1	10.3	10.6	-	10.7	10.9	11.2	-	11.4	11.6	11.9	-	12.0	12.2	12.5	-	12.6	12.8	13.2	-	13.2	13.4	13.8	-	
		HI PR	236	254	269	-	265	285	301	-	302	325	343	-	344	370	390	-	386	416	439	-	427	460	485	-	
		LO PR	109	116	127	-	115	123	134	-	120	128	139	-	126	134	146	-	132	140	153	-	136	145	158	-	
		MIBh	40.0	41.4	45.4	-	39.0	40.4	44.3	-	38.1	39.5	43.3	-	37.2	38.5	42.2	-	35.3	36.6	40.1	-	32.7	33.9	37.1	-	
		S/T	0.68	0.57	0.39	-	0.70	0.59	0.41	-	0.72	0.60	0.42	-	0.75	0.62	0.43	-	0.77	0.65	0.45	-	0.78	0.65	0.45	-	
		ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-	
		kW	3.04	3.10	3.19	-	3.26	3.32	3.42	-	3.45	3.52	3.63	-	3.62	3.70	3.81	-	3.76	3.84	3.97	-	3.89	3.97	4.10	-	
		Amps	9.9	10.1	10.3	-	10.5	10.7	11.0	-	11.2	11.4	11.7	-	11.7	12.0	12.3	-	12.3	12.6	12.9	-	12.9	13.1	13.5	-	
		HI PR	229	247	261	-	257	277	292	-	293	315	332	-	333	359	379	-	375	403	426	-	414	446	471	-	
	LO PR	106	113	123	-	112	119	130	-	116	124	135	-	122	130	142	-	128	136	149	-	132	141	154	-		
75		MIBh	45.3	46.7	50.5	54.2	44.3	45.6	49.4	53.0	43.2	44.5	48.2	51.7	42.2	43.4	47.0	50.4	40.1	41.3	44.7	47.9	37.1	38.2	41.4	44.4	
		S/T	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.89	0.80	0.60	0.39	0.92	0.82	0.62	0.40	0.96	0.86	0.65	0.42	0.96	0.86	0.65	0.42	
		ΔT	19	18	15	10	20	18	15	10	20	18	15	10	20	18	15	10	20	18	15	10	18	17	14	10	
	1800	kW	3.16	3.22	3.32	3.42	3.39	3.46	3.56	3.67	3.59	3.66	3.78	3.90	3.77	3.85	3.97	4.09	3.92	4.00	4.13	4.26	4.05	4.14	4.27	4.41	
		Amps	10.3	10.4	10.7	11.0	10.9	11.1	11.3	11.7	11.6	11.8	12.1	12.4	12.2	12.4	12.7	13.1	12.8	13.0	13.4	13.8	13.4	13.6	14.0	14.4	
		HI PR	241	260	274	286	271	291	307	321	308	331	350	365	351	377	398	415	394	424	448	467	436	469	495	516	
		LO PR	111	118	129	138	118	125	137	146	122	130	142	151	128	137	149	159	135	143	156	167	139	148	162	172	
		MIBh	44.0	45.3	49.1	52.7	43.0	44.3	47.9	51.4	42.0	43.2	46.8	50.2	41.0	42.2	45.6	49.0	38.9	40.1	43.4	46.5	36.0	37.1	40.2	43.1	
		S/T	0.80	0.72	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.59	0.38	0.91	0.82	0.62	0.40	0.92	0.82	0.62	0.40	
		ΔT	20	19	15	11	21	19	15	11	21	19	15	11	21	19	16	11	20	19	15	11	19	18	14	10	
1600		kW	3.13	3.20	3.29	3.39	3.36	3.43	3.53	3.64	3.56	3.63	3.75	3.87	3.74	3.82	3.94	4.06	3.89	3.97	4.10	4.23	4.02	4.10	4.24	4.37	
		Amps	10.2	10.4	10.6	10.9	10.8	11.0	11.3	11.6	11.5	11.7	12.0	12.3	12.1	12.3	12.6	13.0	12.7	12.9	13.3	13.7	13.3	13.5	13.9	14.3	
		HI PR	239	257	271	283	268	288	304	318	305	328	346	361	347	373	394	411	390	420	444	463	431	464	490	511	
		LO PR	110	117	128	136	116	124	135	144	121	129	141	150	127	135	148	157	133	142	155	165	138	147	160	171	
		MIBh	40.6	41.8	45.3	48.6	39.7	40.9	44.2	47.5	38.7	39.9	43.2	46.3	37.8	38.9	42.1	45.2	35.9	37.0	40.0	42.9	33.3	34.2	37.1	39.8	
		S/T	0.77	0.69	0.52	0.34	0.80	0.72	0.54	0.35	0.82	0.73	0.56	0.36	0.85	0.76	0.57	0.37	0.88	0.79	0.60	0.38	0.89	0.79	0.60	0.39	
		ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10	
		kW	3.06	3.12	3.22	3.31	3.28	3.35	3.45	3.56	3.48	3.55	3.66	3.77	3.65	3.73	3.84	3.96	3.80	3.88	4.00	4.13	3.92	4.00	4.13	4.27	
		Amps	10.0	10.2	10.4	10.7	10.6	10.8	11.0	11.3	11.3	11.5	11.7	12.1	11.8	12.1	12.4	12.7	12.4	12.6	13.0	13.4	13.0	13.2	13.6	14.0	
		HI PR	232	249	263	275	260	280	295	308	296	318	336	350	337	362	383	399	379	408	430	449	418	450	475	496	
	LO PR	107	114	124	132	113	120	131	140	117	125	136	145	123	131	143	153	129	138	150	160	134	142	155	165		
		Shaded area reflects ACCA (TVA) Rating conditions																								kW = Total system power Amps = outdoor unit amps (comp.+fan)	

		OUTDOOR AMBIENT TEMPERATURE																													
		65					75					85					95					105					115				
IDB	AIRFLOW	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75
80	1800	MBh	46.1	47.2	50.4	53.9	45.1	46.1	49.2	52.6	56.1	44.0	45.0	48.0	51.4	54.9	42.9	43.9	46.9	50.1	53.5	40.8	41.7	44.5	47.6	50.9	37.8	38.6	41.2	44.1	47.4
		S/T	0.92	0.86	0.70	0.53	0.95	0.90	0.73	0.54	0.37	1.00	0.92	0.75	0.56	0.39	1.00	0.95	0.77	0.58	0.41	1.00	1.00	0.80	0.60	0.41	1.00	1.00	0.81	0.60	0.41
		ΔT	22	21	18	14	22	21	18	15	12	22	21	18	15	12	22	21	18	15	12	21	21	18	15	19	20	17	14	11	8
		kW	3.18	3.24	3.34	3.44	3.41	3.48	3.59	3.70	3.81	3.93	3.62	3.69	3.81	3.93	4.04	3.80	3.88	4.00	4.13	4.25	3.95	4.04	4.16	4.30	4.08	4.17	4.31	4.45	4.58
		Amps	10.3	10.5	10.8	11.1	10.9	11.1	11.4	11.7	12.0	12.3	11.7	11.9	12.2	12.5	12.8	12.3	12.5	12.8	13.2	13.5	12.9	13.1	13.5	13.9	13.5	13.7	14.1	14.5	14.8
	1600	HI PR	244	262	277	289	273	294	311	324	337	311	335	353	368	381	394	354	381	402	420	433	398	429	453	472	440	474	500	522	544
		LO PR	112	120	131	139	119	126	138	147	156	124	131	143	153	162	130	138	151	160	169	136	145	158	168	141	150	163	174	183	192
		MBh	44.8	45.8	48.9	52.3	43.8	44.7	47.8	51.1	54.4	42.7	43.7	46.6	49.9	53.2	41.7	42.6	45.5	48.6	51.9	39.6	40.5	43.2	46.2	36.7	37.5	40.0	42.8	45.6	48.4
		S/T	0.88	0.82	0.67	0.50	0.91	0.85	0.70	0.52	0.35	0.93	0.88	0.71	0.53	0.36	0.96	0.90	0.74	0.55	0.38	1.00	0.94	0.76	0.57	1.00	0.95	0.77	0.58	0.41	0.24
		ΔT	23	22	19	15	23	22	19	15	12	23	22	19	15	12	23	22	19	15	12	21	22	19	15	21	20	18	14	11	8
85	1800	kW	3.16	3.22	3.32	3.42	3.39	3.46	3.56	3.67	3.78	3.59	3.66	3.78	3.90	4.01	3.77	3.85	3.97	4.10	4.22	3.92	4.00	4.13	4.26	4.05	4.14	4.27	4.41	4.54	
		Amps	10.3	10.4	10.7	11.0	10.9	11.1	11.3	11.7	12.0	11.6	11.8	12.1	12.4	12.7	12.2	12.4	12.7	13.1	13.4	12.8	13.0	13.4	13.8	13.4	13.6	14.0	14.4	14.7	
		HI PR	241	260	274	286	271	291	308	321	334	308	331	350	365	378	391	351	377	398	415	428	394	424	448	467	436	469	495	516	537
		LO PR	111	118	129	138	118	125	137	146	155	122	130	142	151	160	128	137	149	159	168	135	143	156	167	139	148	162	172	181	190
		MBh	41.4	42.3	45.1	48.3	40.4	41.3	44.1	47.1	50.1	39.4	40.3	43.0	46.0	49.0	38.5	39.3	42.0	44.9	47.8	36.5	37.3	39.9	42.6	33.9	34.6	37.0	39.5	42.0	44.5
	1600	S/T	0.85	0.79	0.65	0.48	0.88	0.82	0.67	0.50	0.33	0.90	0.84	0.69	0.51	0.34	0.93	0.87	0.71	0.53	0.36	0.96	0.90	0.74	0.55	0.97	0.91	0.74	0.55	0.38	0.21
		ΔT	23	22	19	15	23	22	19	16	13	23	22	19	16	13	23	22	19	16	13	21	22	19	15	22	21	18	14	11	8
		kW	3.09	3.15	3.24	3.34	3.31	3.38	3.48	3.59	3.70	3.50	3.58	3.69	3.80	3.91	3.68	3.76	3.87	4.00	4.11	3.83	3.91	4.03	4.16	3.95	4.04	4.17	4.30	4.43	4.56
		Amps	10.1	10.2	10.5	10.8	10.7	10.8	11.1	11.4	11.7	11.3	11.5	11.8	12.2	12.5	11.9	12.1	12.4	12.8	13.1	12.5	12.7	13.1	13.5	13.1	13.3	13.7	14.1	14.4	14.7
		HI PR	234	252	266	277	263	282	298	311	324	299	321	339	354	367	340	366	386	403	416	383	412	435	453	423	455	480	501	522	543
LO PR	108	115	125	134	114	121	133	141	150	119	126	138	147	156	125	133	145	154	163	131	139	152	162	135	144	157	167	176	185		

IDB = Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI Rating conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																115				
		65				75				85				95				105				
		ENTERING INDOOR WET BULB TEMPERATURE																				
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	2150	MBh	56.8	58.9	64.5	-	55.5	57.5	63.0	-	54.2	56.2	61.5	-	52.9	54.8	60.0	-	50.2	52.1	57.0	-
		S/T	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.84	0.70	0.49	-	0.87	0.72	0.50	-	0.90	0.75	0.52	-
		ΔT	19	17	13	-	19	17	13	-	19	17	13	-	20	17	13	-	19	17	13	-
		kW	4.07	4.15	4.28	-	4.38	4.48	4.62	-	4.66	4.76	4.92	-	4.90	5.01	5.18	-	5.11	5.23	5.40	-
		HI PR	242	261	275	-	272	293	309	-	309	333	352	-	352	379	400	-	396	427	450	-
	LO PR	107	114	125	-	114	121	132	-	118	126	137	-	124	132	144	-	130	138	151	-	
70	1900	MBh	55.2	57.2	62.7	-	53.9	55.9	61.2	-	52.6	54.5	59.7	-	51.3	53.2	58.3	-	48.8	50.5	55.4	-
		S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-
		ΔT	20	17	13	-	20	18	13	-	20	18	13	-	21	18	14	-	20	18	13	-
		kW	4.03	4.12	4.25	-	4.35	4.44	4.58	-	4.62	4.72	4.88	-	4.86	4.97	5.14	-	5.07	5.18	5.36	-
		HI PR	240	258	273	-	269	290	306	-	306	330	348	-	349	375	396	-	392	422	446	-
	LO PR	106	113	124	-	112	120	131	-	117	124	136	-	123	131	143	-	129	137	149	-	
1650		MBh	50.9	52.8	57.8	-	49.7	51.6	56.5	-	48.6	50.3	55.1	-	47.4	49.1	53.8	-	45.0	46.7	51.1	-
		S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-
		ΔT	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-
		kW	3.94	4.02	4.15	-	4.24	4.33	4.47	-	4.51	4.61	4.76	-	4.74	4.85	5.01	-	4.94	5.05	5.22	-
		HI PR	233	251	265	-	261	281	297	-	297	320	338	-	338	364	385	-	381	410	433	-
	LO PR	103	110	120	-	109	116	127	-	113	121	132	-	119	127	138	-	125	133	145	-	
75	2150	MBh	57.8	59.5	64.4	69.1	56.5	58.1	62.9	67.5	55.1	56.7	61.4	65.9	53.8	55.4	59.9	64.3	51.1	52.6	56.9	61.1
		S/T	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.41	0.96	0.85	0.65	0.42	0.99	0.88	0.67	0.43	1.00	0.92	0.69	0.45
		ΔT	22	20	17	12	22	21	17	12	23	21	17	12	23	21	17	12	22	21	17	12
		kW	4.10	4.19	4.32	4.46	4.42	4.51	4.66	4.81	4.70	4.80	4.96	5.13	4.95	5.06	5.22	5.40	5.16	5.27	5.45	5.64
		HI PR	245	264	278	290	275	296	312	326	313	336	355	370	356	383	404	422	400	431	455	475
	LO PR	109	116	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	
75	1900	MBh	56.1	57.8	62.5	67.1	54.8	56.4	61.1	65.6	53.5	55.1	59.6	64.0	52.2	53.7	58.2	62.4	49.6	51.1	55.3	59.3
		S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.98	0.87	0.66	0.43
		ΔT	23	21	18	12	24	22	18	12	24	22	18	12	24	22	18	12	23	22	18	12
		kW	4.07	4.15	4.28	4.42	4.38	4.48	4.62	4.77	4.66	4.76	4.92	5.08	4.91	5.01	5.18	5.36	5.11	5.23	5.40	5.59
		HI PR	242	261	276	287	272	293	309	322	309	333	352	367	352	379.2	400	418	396	427	451	470
	LO PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	
75	1650	MBh	51.8	53.3	57.7	62.0	50.6	52.1	56.4	60.5	49.4	50.8	55.0	59.1	48.2	49.6	53.7	57.6	45.8	47.1	51.0	54.7
		S/T	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.59	0.38	0.91	0.81	0.61	0.39	0.94	0.84	0.64	0.41
		ΔT	24	22	18	12	24	22	18	13	24	22	18	13	24	22	18	13	24	22	18	13
		kW	3.97	4.05	4.18	4.32	4.27	4.37	4.51	4.65	4.54	4.64	4.80	4.95	4.78	4.89	5.05	5.22	4.99	5.10	5.27	5.44
		HI PR	235	253	267	279	264	284	300	313	300	323	341	356	342	368	388	405	385	414	437	456
	LO PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	
		Shaded area reflects ACCA (TVA) Rating conditions																kW = Total system power Amps = outdoor unit amps (comp.+fan)				
		DB = Entering Indoor Dry Bulb Temperature																				
		High and low pressures are measured at the liquid and suction service valves.																				

		OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		ENTERING INDOOR WET BULB TEMPERATURE																							
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
	MBh	58.8	60.1	64.2	68.7	57.5	58.7	62.7	67.1	56.1	57.3	61.2	65.5	54.7	55.9	59.7	63.9	52.0	53.1	56.8	60.7	59	63	67	71
	S/T	1.00	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	1.00	0.80	0.60	1.00	1.00	0.83	0.62	1.00	1.00	0.86	0.64	1.00	1.00	0.86	0.65
	ΔT	25	24	21	17	25	24	21	17	24	25	21	17	23	24	21	17	22	23	21	17	21	21	19	16
	kW	4.13	4.22	4.36	4.50	4.45	4.55	4.70	4.85	4.74	4.84	5.00	5.17	4.99	5.10	5.27	5.45	5.20	5.32	5.50	5.68	5.39	5.51	5.69	5.89
	HI PR	247	266	281	293	278	299	315	329	316	340	359	374	360	387	409	426	404	435	460	479	447	481	508	530
80	LO PR	110	117	127	136	116	123	135	143	120	128	140	149	126	135	147	156	133	141	154	164	137	146	159	170
	MBh	57.1	58.4	62.4	66.7	55.8	57.0	60.9	65.1	54.5	55.6	59.5	63.6	53.1	54.3	58.0	62.0	50.5	51.6	55.1	58.9	46.8	47.8	51.0	54.6
	S/T	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62
	ΔT	26	25	22	17	26	25	22	18	26	25	22	18	26	25	22	18	24	25	22	17	23	23	20	16
	kW	4.10	4.19	4.32	4.46	4.42	4.51	4.66	4.81	4.70	4.80	4.96	5.13	4.95	5.06	5.23	5.40	5.16	5.27	5.45	5.64	5.34	5.46	5.64	5.84
	HI PR	245	264	278	290	275	296	312	326	313	336	355	370	356	383	405	422	400	431	455	475	442	476	503	524
	LO PR	109	116	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168
	MBh	52.7	53.9	57.5	61.5	51.5	52.6	56.2	60.1	50.3	51.4	54.9	58.7	49.0	50.1	53.5	57.2	46.6	47.6	50.9	54.4	43.2	44.1	47.1	50.4
	S/T	0.91	0.85	0.69	0.52	0.94	0.88	0.72	0.54	0.96	0.90	0.74	0.55	0.99	0.93	0.76	0.57	1.03	0.97	0.79	0.59	1.04	0.98	0.79	0.59
	ΔT	27	26	22	18	27	26	22	18	27	26	22	18	27	26	23	18	27	26	22	18	25	24	21	17
1650	kW	4.00	4.09	4.21	4.35	4.31	4.40	4.54	4.69	4.58	4.68	4.84	5.00	4.82	4.93	5.09	5.26	5.03	5.14	5.31	5.49	5.20	5.32	5.50	5.69
	HI PR	238	256	270	282	267	287	303	316	303	326	344	359	345	372	392	409	388	418	441	460	429	462	488	509
	LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163

	2150																
	MBh	59.9	61.0	63.9	68.2	58.5	59.6	62.4	66.6	57.1	58.2	60.9	65.0	55.7	56.8	59.4	63.4
	S/T	1.00	1.00	0.90	0.7	1.00	1.00	0.93	0.8	1.00	1.00	0.96	0.8	1.00	1.00	0.99	0.8
	ΔT	26	26	25	21	25	25	25	22	24	25	25	22	24	24	25	22
	kW	4.16	4.25	4.39	4.5	4.49	4.59	4.74	4.9	4.78	4.88	5.04	5.2	5.03	5.14	5.31	5.5
85	HI PR	250	269	284	296.1	280	302	319	332.2	319	343	362	377.9	363	391	413	430.4
	LO PR	111	118	129	137.0	117	124	136	144.7	122	129	141	150.4	128	136	148	158.0
	MBh	58.1	59.2	62.0	66.2	56.8	57.9	60.6	64.6	55.4	56.5	59.2	63.1	54.1	55.1	57.7	61.6
	S/T	0.99	0.95	0.86	0.7	1.00	0.99	0.89	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.94	0.8
	ΔT	28	27	26	22	27	28	26	23	27	27	26	23	26	27	26	23
	kW	4.13	4.22	4.36	4.5	4.45	4.55	4.70	4.9	4.74	4.84	5.00	5.2	4.99	5.10	5.27	5.4
	HI PR	247	266	281	293.2	278	299	315	329.0	316	340	359	374.1	360	387	409	426.1
	LO PR	110	117	127	135.6	116	123	135	143.3	120	128	140	148.9	126	135	147	156.5
	MBh	53.6	54.7	57.3	61.1	52.4	53.4	55.9	59.7	51.1	52.1	54.6	58.2	49.9	50.9	53.3	56.8
	S/T	0.95	0.92	0.83	0.7	0.99	0.95	0.86	0.7	1.00	0.97	0.88	0.7	1.00	1.00	0.91	0.7
1650	ΔT	28	28	26	23	29	28	27	23	28	28	27	23	28	28	27	23
	kW	4.03	4.12	4.25	4.4	4.34	4.44	4.58	4.7	4.62	4.72	4.88	5.0	4.86	4.97	5.14	5.3
	HI PR	240	258	273	284.4	269	290	306	319.1	306	330	348	362.9	349	375	396	413.3
	LO PR	106	113	124	131.6	112	120	131	139.0	117	124	136	144.5	123	131	142	151.8
	MBh	43.9	44.8	47.8	50.0	43.9	44.8	47.8	50.0	43.9	44.8	47.8	50.0	43.9	44.8	47.8	50.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.95	0.8
	ΔT	24	25	25	21.5	25	25	25	22	24	25	25	22	26	27	27	23
	kW	5.43	5.55	5.74	5.9	5.43	5.55	5.74	5.9	5.43	5.55	5.74	5.9	5.25	5.36	5.54	5.7
	HI PR	451	486	513	535.0	451	486	513	535.0	451	486	513	535.0	409	440	464	484.2
	LO PR	138	147	161	171.3	138	147	161	171.3	138	147	161	171.3	134	142	155	165.6
	MBh	47.6	48.5	50.8	54.2	47.6	48.5	50.8	54.2	47.6	48.5	50.8	54.2	51.4	52.3	54.8	58.5
	S/T	1.00	1.00	0.99	0.8	1.00	1.00	0.98	0.8	1.00	1.00	0.98	0.8	1.00	1.00	0.98	0.8
	ΔT	23	23	24	21.0	23	23	24	21.0	23	23	24	21.0	25	25	26	22
	kW	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.20	5.32	5.50	5.7
	HI PR	447	481	508	529.7	447	481	508	529.7	447	481	508	529.7	404	435	460	479.4
	LO PR	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	133	141	154	164.0
	MBh	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	47.4	48.3	50.6	54.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	24	25	25	21.5	24	25	25	22	26	27	27	23	26	27	27	23
	kW	5.25	5.37	5.55	5.7	5.25	5.37	5.55	5.7	5.07	5.18	5.36	5.5	5.07	5.18	5.36	5.5
	HI PR	433	466	493	513.8	433	466	493	513.8	433	466	493	513.8	392	422	446	465.0
	LO PR	133	141	154	164.5	133	141	154	164.5	133	141	154	164.5	129	137	149	159.0
	MBh	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	129	137	149	159.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	23	23	24	21.0	23	23	24	21.0	23	23	24	21.0	25	25	26	22
	kW	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.20	5.32	5.50	5.7
	HI PR	447	481	508	529.7	447	481	508	529.7	447	481	508	529.7	404	435	460	479.4
	LO PR	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	133	141	154	164.0
	MBh	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	47.4	48.3	50.6	54.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	24	25	25	21.5	24	25	25	22	26	27	27	23	26	27	27	23
	kW	5.25	5.37	5.55	5.7	5.25	5.37	5.55	5.7	5.07	5.18	5.36	5.5	5.07	5.18	5.36	5.5
	HI PR	433	466	493	513.8	433	466	493	513.8	433	466	493	513.8	392	422	446	465.0
	LO PR	133	141	154	164.5	133	141	154	164.5	133	141	154	164.5	129	137	149	159.0
	MBh	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	129	137	149	159.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	23	23	24	21.0	23	23	24	21.0	23	23	24	21.0	25	25	26	22
	kW	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.20	5.32	5.50	5.7
	HI PR	447	481	508	529.7	447	481	508	529.7	447	481	508	529.7	404	435	460	479.4
	LO PR	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	133	141	154	164.0
	MBh	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	47.4	48.3	50.6	54.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	24	25	25	21.5	24	25	25	22	26	27	27	23	26	27	27	23
	kW	5.25	5.37	5.55	5.7	5.25	5.37	5.55	5.7	5.07	5.18	5.36	5.5	5.07	5.18	5.36	5.5
	HI PR	433	466	493	513.8	433	466	493	513.8	433	466	493	513.8	392	422	446	465.0
	LO PR	133	141	154	164.5	133	141	154	164.5	133	141	154	164.5	129	137	149	159.0
	MBh	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	129	137	149	159.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	23	23	24	21.0	23	23	24	21.0	23	23	24	21.0	25	25	26	22
	kW	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.20	5.32	5.50	5.7
	HI PR	447	481	508	529.7	447	481	508	529.7	447	481	508	529.7	404	435	460	479.4
	LO PR	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	133	141	154	164.0
	MBh	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	47.4	48.3	50.6	54.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	24	25	25	21.5	24	25	25	22	26	27	27	23	26	27	27	23
	kW	5.25	5.37	5.55	5.7	5.25	5.37	5.55	5.7	5.07	5.18	5.36	5.5	5.07	5.18	5.36	5.5
	HI PR	433	466	493	513.8	433	466	493	513.8	433	466	493	513.8	392	422	446	465.0
	LO PR	133	141	154	164.5	133	141	154	164.5	133	141	154	164.5	129	137	149	159.0
	MBh	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	129	137	149	159.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	23	23	24	21.0	23	23	24	21.0	23	23	24	21.0	25	25	26	22
	kW	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.39	5.51	5.69	5.9	5.20	5.32	5.50	5.7
	HI PR	447	481	508	529.7	447	481	508	529.7	447	481	508	529.7	404	435	460	479.4
	LO PR	137	146	159	169.6	137	146	159	169.6	137	146	159	169.6	133	141	154	164.0
	MBh	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	43.9	44.8	46.9	50.0	47.4	48.3	50.6	54.0
	S/T	1.00	1.00	0.95	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.94	0.8
	ΔT	24	25	25	21.5	24	25	25	22	26	27	27	23	26	27	27	23
	kW	5.25	5.37	5.55	5.7	5.25	5.37	5.55	5.7	5.07	5.18	5.36	5.5	5.07	5.18	5.36	5.5
	HI PR	433	466	493	513.8	433	466	493	513.8	433	466	493	513.8	392	422	446	465.0
	LO PR	133	141	154	164.5	133	141	154	164.5	133	141	154	164.5	129	137	149	159.0
	MBh	13															

IDB = Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI Rating conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																																				
		65						75						85						95						105						115						
		ENTERING INDOOR WET BULB TEMPERATURE																																				
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71									
2650	MBh	69.6	72.1	79.0	-	68.0	70.4	77.2	-	66.3	68.8	75.3	-	64.7	67.1	73.5	-	61.5	63.7	69.8	-	57.0	59.0	64.7	-	0.86	0.72	0.50	-									
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-									
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-	17	15	11	-									
	kW	5.10	5.20	5.35	-	5.47	5.58	5.75	-	5.79	5.91	6.09	-	6.08	6.21	6.40	-	6.32	6.46	6.66	-	6.53	6.67	6.89	-	6.53	6.67	6.89	-									
	HI PR	235	253	267	-	263	283	299	-	299	322	340	-	341	367	388	-	384	413	436	-	424	456	482	-	424	456	482	-									
70	LO PR	108	115	125	-	114	121	132	-	118	126	137	-	124	132	144	-	130	138	151	-	135	143	156	-	135	143	156	-									
	MBh	67.5	70.0	76.7	-	66.0	68.4	74.9	-	64.4	66.8	73.1	-	62.8	65.1	71.4	-	59.7	61.9	67.8	-	55.3	57.3	62.8	-	55.3	57.3	62.8	-									
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-	0.82	0.69	0.48	-									
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-	18	15	12	-									
	kW	5.06	5.16	5.31	-	5.43	5.54	5.70	-	5.75	5.87	6.05	-	6.03	6.16	6.35	-	6.27	6.41	6.61	-	6.48	6.62	6.83	-	6.48	6.62	6.83	-									
2050	HI PR	232	250	264	-	261	281	296	-	297	319	337	-	338	363	384	-	380	409	432	-	420	452	477	-	420	452	477	-									
	LO PR	107	113	124	-	113	120	131	-	117	125	136	-	123	131	143	-	129	137	150	-	133	142	155	-	133	142	155	-									
	MBh	62.3	64.6	70.8	-	60.9	63.1	69.2	-	59.4	61.6	67.5	-	58.0	60.1	65.9	-	55.1	57.1	62.6	-	51.0	52.9	58.0	-	51.0	52.9	58.0	-									
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-	0.80	0.66	0.46	-									
	ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-	18	16	12	-									
75	kW	4.95	5.05	5.19	-	5.30	5.41	5.57	-	5.61	5.73	5.90	-	5.89	6.01	6.20	-	6.12	6.25	6.45	-	6.33	6.46	6.67	-	6.33	6.46	6.67	-									
	HI PR	225	243	256	-	253	272	287	-	288	310	327	-	328	353	372	-	369	397	419	-	407	438	463	-	407	438	463	-									
	LO PR	103	110	120	-	109	116	127	-	114	121	132	-	119	127	139	-	125	133	145	-	129	138	150	-	129	138	150	-									
	MBh	70.8	72.8	78.9	84.6	69.1	71.2	77.0	82.7	67.5	69.5	75.2	80.7	65.8	67.8	73.3	78.7	62.5	64.4	69.7	74.8	57.9	59.6	64.5	69.3	57.9	59.6	64.5	69.3									
	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43	0.98	0.88	0.67	0.43									
2650	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10	20	18	15	10									
	kW	5.14	5.24	5.40	5.56	5.51	5.62	5.79	5.97	5.84	5.96	6.14	6.34	6.13	6.26	6.45	6.66	6.37	6.51	6.72	6.93	6.59	6.73	6.94	7.17	6.59	6.73	6.94	7.17									
	HI PR	237	255	269	281	266	286	302	315	303	326	344	359	345	371	392	408	388	417	441	459	428	461	487	508	428	461	487	508									
	LO PR	109	116	126	135	115	122	133	142	119	127	139	148	125	133	146	155	131	140	153	163	136	145	158	168	136	145	158	168									
	MBh	68.7	70.7	76.6	82.2	67.1	69.1	74.8	80.3	65.5	67.4	73.0	78.3	63.9	65.8	71.2	76.4	60.7	62.5	67.7	72.6	56.2	57.9	62.7	67.3	56.2	57.9	62.7	67.3									
2350	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41	0.94	0.84	0.63	0.41									
	ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	12	21	19	16	11	21	19	16	11									
	kW	5.10	5.20	5.36	5.52	5.47	5.58	5.75	5.93	5.79	5.91	6.10	6.29	6.08	6.21	6.40	6.61	6.32	6.46	6.66	6.88	6.54	6.68	6.89	7.11	6.54	6.68	6.89	7.11									
	HI PR	235	253	267	278	263	283	299	312	300	322	340	355	341	367.1	388	404	384	413	436	455	424	456	482	503	424	456	482	503									
	LO PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	138	151	161	135	143	156	167	135	143	156	167									
2050	MBh	63.4	65.3	70.7	75.8	61.9	63.8	69.0	74.1	60.5	62.2	67.4	72.3	59.0	60.7	65.7	70.5	56.0	57.7	62.4	67.0	51.9	53.4	57.8	62.1	51.9	53.4	57.8	62.1									
	S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39	0.90	0.81	0.61	0.39									
	ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	21	19	16	11									
	kW	4.99	5.08	5.23	5.39	5.34	5.45	5.61	5.79	5.66	5.77	5.95	6.14	5.94	6.06	6.25	6.45	6.17	6.30	6.50	6.71	6.38	6.51	6.72	6.94	6.38	6.51	6.72	6.94									
	HI PR	228	245	259	270	255	275	290	303	291	313	330	344	331	356	376	392	372	401	423	441	411	443	467	488	411	443	467	488									
75	LO PR	104	111	121	129	110	117	128	136	115	122	133	142	120	128	140	149	126	134	147	156	131	139	152	162	131	139	152	162									
	DB = Entering Indoor Dry Bulb Temperature																		Shaded area reflects ACCA (TVA) Rating conditions										kW = Total system power									
	High and low pressures are measured at the liquid and suction service valves.																		Ampps = outdoor unit ampps (comp.+fan)																			

IDB = Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) Rating conditions

kW = Total system power

Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
		ENTERING INDOOR WET BULB TEMPERATURE																								
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71					
80	2650	MBh	72.0	73.6	78.6	84.0	70.3	71.9	76.8	82.1	68.7	70.2	75.0	80.1	67.0	68.4	73.1	78.2	63.6	65.0	69.5	74.3	58.9	60.2	64.4	68.8
		S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62
		ΔT	23	22	20	16	24	23	20	16	24	23	20	16	23	23	20	16	22	23	20	16	20	21	18	15
		kW	5.18	5.28	5.44	5.60	5.55	5.67	5.84	6.02	5.88	6.01	6.19	6.39	6.18	6.31	6.51	6.71	6.43	6.56	6.77	6.99	6.64	6.78	7.00	7.23
		HI PR	239	258	272	284	269	289	305	318	306	329	347	362	348	375	396	413	392	421	445	464	433	466	492	513
	LO PR	110	117	128	136	116	123	135	144	121	128	140	149	127	135	147	157	133	141	154	164	137	146	160	170	
80	2350	MBh	69.9	71.4	76.3	81.6	68.3	69.8	74.6	79.7	66.7	68.1	72.8	77.8	65.0	66.5	71.0	75.9	61.8	63.1	67.5	72.1	57.2	58.5	62.5	66.8
		S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59
		ΔT	24	23	20	16	25	24	21	17	25	24	21	17	25	24	21	17	24	24	21	16	22	22	19	15
		kW	5.14	5.24	5.40	5.56	5.51	5.62	5.79	5.97	5.84	5.96	6.14	6.34	6.13	6.26	6.45	6.66	6.38	6.51	6.72	6.93	6.59	6.73	6.94	7.17
		HI PR	237	255	269	281	266	286	302	315	303	326	344	359	345	371	392	408	388	417	441	459	428	461	487	508
	LO PR	109	116	126	135	115	122	133	142	119	127	139	148	125	133	146	155	131	140	153	163	136	145	158	168	
2050	2050	MBh	64.5	65.9	70.4	75.3	63.0	64.4	68.8	73.6	61.5	62.9	67.2	71.8	60.0	61.3	65.5	70.1	57.0	58.3	62.3	66.6	52.8	54.0	57.7	61.6
		S/T	0.86	0.81	0.66	0.49	0.89	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57
		ΔT	25	24	21	17	25	24	21	17	25	24	21	17	26	24	21	17	25	24	21	17	23	23	20	16
		kW	5.02	5.12	5.27	5.43	5.38	5.49	5.66	5.83	5.70	5.82	6.00	6.19	5.98	6.11	6.30	6.50	6.22	6.35	6.55	6.76	6.43	6.57	6.77	6.99
		HI PR	230	247	261	273	258	278	293	306	293	316	334	348	334	360	380	396	376	405	427	446	415	447	472	492
	LO PR	106	112	123	130	111	119	129	138	116	123	135	143	122	129	141	151	128	136	148	158	132	140	153	163	

	2650	MBh	73.3	74.7	78.2	83.5	71.6	73.0	76.4	81.5	69.9	71.2	74.6	79.6	68.2	69.5	72.8	77.6	64.7	66.0	69.1	73.7	60.0	61.1	64.0	68.3
		S/T	0.98	0.95	0.86	0.7	1.00	0.98	0.89	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.94	0.8	1.00	1.00	0.98	0.8	1.00	1.00	0.98	0.8
		ΔT	25	25	23	20	25	25	24	20	24	25	24	20	24	24	24	21	22	23	23	20	21	21	22	18.9
		kW	5.21	5.32	5.48	5.6	5.59	5.71	5.88	6.1	5.93	6.05	6.24	6.4	6.23	6.36	6.56	6.8	6.48	6.62	6.83	7.0	6.69	6.84	7.06	7.3
		HI PR	242	260	275	286.7	271	292	308	321.7	309	332	351	365.8	352	378	399	416.6	395	426	449	468.7	437	470	497	517.9
85	2350	LO PR	111	118	129	137.2	117	125	136	145.0	122	130	141	150.7	128	136	149	158.3	134	143	156	165.9	139	148	161	171.6
		MBh	71.1	72.5	75.9	81.0	69.5	70.8	74.2	79.1	67.8	69.1	72.4	77.3	66.2	67.5	70.6	75.4	62.9	64.1	67.1	71.6	58.2	59.4	62.2	66.3
		S/T	0.94	0.91	0.82	0.7	0.97	0.94	0.85	0.7	1.00	0.96	0.87	0.7	1.00	0.99	0.90	0.7	1.00	1.00	0.93	0.8	1.00	1.00	0.94	0.8
		ΔT	26	26	24	21	26	26	25	21	26	26	25	21	26	26	25	21	25	25	24	21	23	23	23	19.8
		kW	5.18	5.28	5.44	5.6	5.55	5.67	5.84	6.0	5.88	6.01	6.19	6.4	6.18	6.31	6.51	6.7	6.43	6.56	6.77	7.0	6.64	6.78	7.00	7.2
	2050	HI PR	239	258	272	283.8	269	289	305	318.5	306	329	347	362.2	348	375	396	412.5	392	421	445	464.1	433	466	492	512.8
		LO PR	110	117	128	135.9	116	123	135	143.6	121	128	140	149.2	127	135	147	156.7	133	141	154	164.2	137	146	160	169.9
		MBh	65.7	66.9	70.1	74.8	64.1	65.4	68.5	73.0	62.6	63.8	66.8	71.3	61.1	62.3	65.2	69.6	58.0	59.1	61.9	66.1	53.7	54.8	57.4	61.2
		S/T	0.91	0.87	0.79	0.6	0.94	0.91	0.82	0.7	0.96	0.93	0.84	0.7	0.99	0.96	0.86	0.7	1.00	0.99	0.90	0.7	1.00	1.00	0.91	0.7
		ΔT	27	26	25	21	27	27	25	22	27	27	25	22	27	27	25	22	26	26	25	22	24	25	23	20.2
		kW	5.06	5.16	5.31	5.5	5.42	5.53	5.70	5.9	5.75	5.87	6.05	6.2	6.03	6.16	6.35	6.6	6.27	6.41	6.61	6.8	6.48	6.62	6.83	7.1
		HI PR	232	250	264	275.3	261	280	296	308.9	296	319	337	351.3	338	363	384	400.1	380	409	432	450.2	420	452	477	497.4
		LO PR	107	113	124	131.8	113	120	131	139.3	117	124	136	144.7	123	131	143	152.0	129	137	150	159.3	133	142	155	164.8
		MBh	65.7	66.9	70.1	74.8	64.1	65.4	68.5	73.0	62.6	63.8	66.8	71.3	61.1	62.3	65.2	69.6	58.0	59.1	61.9	66.1	53.7	54.8	57.4	61.2
		S/T	0.91	0.87	0.79	0.6	0.94	0.91	0.82	0.7	0.96	0.93	0.84	0.7	0.99	0.96	0.86	0.7	1.00	0.99	0.90	0.7	1.00	1.00	0.91	0.7

IDB = Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI Rating conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

IDB		AIRFLOW		OUTDOOR AMBIENT TEMPERATURE																		115													
				65						75						85								95						105					
				ENTERING INDOOR WET BULB TEMPERATURE																															
70		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
		MBh	67.6	70.1	76.8	-	66.0	68.5	75.0	-	64.5	66.8	73.2	-	62.9	65.2	71.4	-	59.8	61.9	67.9	-	55.3	57.4	62.9	-	55.3	57.4	62.9	-	55.3	57.4	62.9	-	
	2525	S/T	0.72	0.60	0.42	-	0.75	0.63	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.69	0.48	-	0.83	0.69	0.48	-	0.83	0.69	0.48	-	0.83	0.69	0.48	-	
		Delta T	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	14	11	-	17	14	11	-	17	14	11	-	
		KW	4.89	4.98	5.13	-	5.23	5.34	5.50	-	5.54	5.65	5.82	-	5.81	5.93	6.11	-	6.04	6.16	6.36	-	6.24	6.37	6.57	-	6.24	6.37	6.57	-	6.24	6.37	6.57	-	
75		HI PR	231	248	262	-	259	279	294	-	294	317	335	-	335	361	381	-	377	406	429	-	417	449	474	-	417	449	474	-	417	449	474	-	
		LO PR	110	117	128	-	116	124	135	-	121	129	140	-	127	135	147	-	133	142	155	-	138	146	160	-	138	146	160	-	138	146	160	-	
		MBh	65.6	68.0	74.5	-	64.1	66.5	72.8	-	62.6	64.9	71.1	-	61.1	63.3	69.3	-	58.0	60.1	65.9	-	53.7	55.7	61.0	-	53.7	55.7	61.0	-	53.7	55.7	61.0	-	
	2250	S/T	0.69	0.58	0.40	-	0.71	0.60	0.41	-	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.79	0.66	0.45	-	0.79	0.66	0.46	-	0.79	0.66	0.46	-	0.79	0.66	0.46	-	
		Delta T	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-	17	15	11	-	17	15	11	-	
1991		KW	4.85	4.95	5.09	-	5.19	5.30	5.46	-	5.50	5.61	5.78	-	5.76	5.88	6.06	-	5.99	6.12	6.31	-	6.19	6.32	6.51	-	6.19	6.32	6.51	-	6.19	6.32	6.51	-	
		HI PR	228	246	260	-	256	276	291	-	292	314	331	-	332	357	377	-	374	402	424	-	413	444	469	-	413	444	469	-	413	444	469	-	
		LO PR	109	116	127	-	115	123	134	-	120	127	139	-	126	134	146	-	132	140	153	-	136	145	158	-	136	145	158	-	136	145	158	-	
		MBh	62.4	64.6	70.8	-	60.9	63.1	69.2	-	59.5	61.6	67.5	-	58.0	60.1	65.9	-	55.1	57.1	62.6	-	51.1	52.9	58.0	-	51.1	52.9	58.0	-	51.1	52.9	58.0	-	
	2525	S/T	0.66	0.55	0.38	-	0.68	0.57	0.40	-	0.70	0.59	0.41	-	0.72	0.61	0.42	-	0.75	0.63	0.44	-	0.76	0.63	0.44	-	0.76	0.63	0.44	-	0.76	0.63	0.44	-	
2525		Delta T	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-	18	15	12	-	18	15	12	-	
		KW	4.78	4.87	5.01	-	5.12	5.22	5.37	-	5.41	5.52	5.69	-	5.67	5.79	5.97	-	5.90	6.02	6.21	-	6.09	6.22	6.41	-	6.09	6.22	6.41	-	6.09	6.22	6.41	-	
		HI PR	224	241	254	-	251	270	285	-	286	307	325	-	325	350	370	-	366	394	416	-	404	435	460	-	404	435	460	-	404	435	460	-	
		LO PR	107	114	124	-	113	120	131	-	117	125	136	-	123	131	143	-	129	137	150	-	134	142	155	-	134	142	155	-	134	142	155	-	
		MBh	62.4	64.6	70.8	-	60.9	63.1	69.2	-	59.5	61.6	67.5	-	58.0	60.1	65.9	-	55.1	57.1	62.6	-	51.1	52.9	58.0	-	51.1	52.9	58.0	-	51.1	52.9	58.0	-	
75		S/T	0.78	0.70	0.53	0.34	0.81	0.73	0.55	0.35	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.90	0.81	0.61	0.39	0.90	0.81	0.61	0.39	0.90	0.81	0.61	0.39	
	2525	Delta T	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	
		KW	4.92	5.02	5.17	5.32	5.27	5.38	5.54	5.71	5.58	5.70	5.87	6.05	5.85	5.98	6.16	6.35	6.09	6.21	6.41	6.61	6.29	6.42	6.62	6.83	6.29	6.42	6.62	6.83	6.29	6.42	6.62	6.83	
		HI PR	233	251	265	276	262	281	297	310	297	320	338	353	339	365	385	402	381	410	433	452	421	453	479	499	421	453	479	499	421	453	479	499	
		LO PR	111	118	129	138	118	125	136	145	122	130	142	151	128	136	149	159	134	143	156	166	139	148	161	172	139	148	161	172	139	148	161	172	
2250		MBh	66.8	68.7	74.4	79.8	65.2	67.1	72.7	78.0	63.7	65.5	70.9	76.1	62.1	63.9	69.2	74.3	59.0	60.7	65.7	70.6	54.6	56.3	60.9	65.4	54.6	56.3	60.9	65.4	54.6	56.3	60.9	65.4	
		S/T	0.78	0.70	0.53	0.34	0.81	0.73	0.55	0.35	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.90	0.81	0.61	0.39	0.90	0.81	0.61	0.39	0.90	0.81	0.61	0.39	
	2525	Delta T	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	19	15	10	20	19	15	10	20	19	15	10	
		KW	4.89	4.98	5.13	5.28	5.23	5.34	5.50	5.66	5.54	5.65	5.82	6.00	5.81	5.93	6.11	6.30	6.04	6.16	6.36	6.56	6.24	6.37	6.57	6.78	6.24	6.37	6.57	6.78	6.24	6.37	6.57	6.78	
		HI PR	231	248	262	274	259	279	294	307	294	317	335	349	335	361	381	398	377	406	429	447	417	449	474	494	417	449	474	494	417	449	474	494	
1991		LO PR	110	117	128	136	116	124	135	144	121	129	140	150	127	135	148	157	133	142	155	165	138	146	160	170	138	146	160	170	138	146	160	170	
		MBh	63.4	65.3	70.7	75.9	61.9	63.8	69.0	74.1	60.5	62.3	67.4	72.3	59.0	60.7	65.7	70.6	56.0	57.7	62.5	67.0	51.9	53.5	57.9	62.1	51.9	53.5	57.9	62.1	51.9	53.5	57.9	62.1	
		S/T	0.75	0.67	0.51	0.33	0.78	0.70	0.53	0.34	0.80	0.71	0.54	0.35	0.82	0.74	0.56	0.36	0.86	0.76	0.58	0.37	0.86	0.77	0.58	0.38	0.86	0.77	0.58	0.38	0.86	0.77	0.58	0.38	
	2525	Delta T	22	20	17	11	22	20	17	12	22	21	17	12	22	21	17	12	22	20	17	12	21	19	16	11	21	19	16	11	21	19	16	11	
		KW	4.82	4.91	5.05	5.20	5.16	5.26	5.41	5.58	5.46	5.57	5.73	5.91	5.72	5.84	6.02	6.20	5.94	6.07	6.26	6.45	6.14	6.27	6.46	6.67	6.14	6.27	6.46	6.67	6.14	6.27	6.46	6.67	
75		AMPS	10.5	10.8	11.1	11.4	11.3	11.5	11.9	12.3	12.2	12.4	12.8	13.3	12.9	13.2	13.6	14.1	13.7	14.0	14.5	15.0	14.5	14.8	15.3	15.8	14.5	14.8	15.3	15.8	14.5	14.8	15.3	15.8	
		HI PR	226	243	257	268	254	273	288	301	289	311	328	342	329	354	374	390	370	398	420	438	409	440	464	484	409	440	464	484	409	440	464	484	
		LO PR	108	115	125	133	114	121	132	141	118	126	138	147	124	132	145	154	130	139	151	161	135	144	157	167	135	144	157	167	135	144	157	167	
		MBh	63.4	65.3	70.7	75.9	61.9	63.8	69.0	74.1	60.5	62.3	67.4	72.3	59.0	60.7	65.7	70.6	56.0	57.7	62.5	67.0	51.9	53.5	57.9	62.1	51.9	53.5	57.9	62.1	51.9	53.5	57.9	62.1	
	2525	S/T	0.75	0.67	0.51	0.33	0.78	0.70	0.53	0.34	0.80	0.71	0.54	0.35	0.82	0.74	0.56	0.36	0.86	0.76</															

		OUTDOOR AMBIENT TEMPERATURE																													
		65					75					85					95					105					115				
		ENTERING INDOOR WET BULB TEMPERATURE																													
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71						
2525	MBh	70.0	71.5	76.4	81.7	68.4	69.8	74.6	79.8	66.7	68.2	72.8	77.9	65.1	66.5	71.1	76.0	61.8	63.2	67.5	72.2	57.3	58.5	62.5	66.9						
	S/T	0.90	0.85	0.69	0.51	0.93	0.88	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.93	0.75	0.56	1.00	0.96	0.78	0.59	1.00	0.97	0.79	0.59						
	Delta T	23	22	19	15	23	22	19	15	23	22	19	16	24	22	20	16	23	22	19	15	21	21	18	14						
	KW	4.96	5.06	5.21	5.36	5.31	5.42	5.58	5.75	5.63	5.74	5.91	6.10	5.90	6.02	6.21	6.40	6.13	6.26	6.46	6.66	6.34	6.47	6.67	6.89						
	HI PR	235	253	268	279	264	284	300	313	300	323	341	356	342	368	389	406	385	414	437	456	425	458	483	504						
2250	LO PR	112	120	130	139	119	126	138	147	123	131	143	153	130	138	150	160	136	144	158	168	140	149	163	174						
	MBh	67.9	69.4	74.2	79.3	66.4	67.8	72.5	77.4	64.8	66.2	70.7	75.6	63.2	64.6	69.0	73.8	60.0	61.4	65.6	70.1	55.6	56.8	60.7	64.9						
	S/T	0.86	0.81	0.66	0.49	0.89	0.84	0.68	0.51	0.91	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.75	0.56						
	Delta T	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	22	19	15						
	KW	4.92	5.02	5.17	5.32	5.27	5.38	5.54	5.71	5.58	5.70	5.87	6.05	5.85	5.98	6.16	6.35	6.09	6.21	6.41	6.61	6.29	6.42	6.62	6.83						
1991	HI PR	233	251	265	276	262	281	297	310	297	320	338	353	339	365	385	402	381	410	433	452	421	453	479	499						
	LO PR	111	118	129	138	118	125	136	145	122	130	142	151	128	136	149	159	134	143	156	166	139	148	162	172						
	MBh	64.5	66.0	70.5	75.3	63.0	64.4	68.8	73.6	61.5	62.9	67.2	71.8	60.0	61.4	65.6	70.1	57.0	58.3	62.3	66.6	52.8	54.0	57.7	61.7						
	S/T	0.82	0.77	0.63	0.47	0.85	0.80	0.65	0.49	0.88	0.82	0.67	0.50	0.90	0.85	0.69	0.52	0.94	0.88	0.72	0.54	0.95	0.89	0.72	0.54						
	Delta T	25	24	20	16	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	16	23	22	19	15						
1991	KW	4.85	4.95	5.09	5.24	5.19	5.30	5.46	5.62	5.50	5.61	5.78	5.96	5.76	5.88	6.06	6.25	5.99	6.12	6.31	6.50	6.19	6.32	6.51	6.72						
	HI PR	228	246	260	271	256	276	291	304	292	314	331	346	332	357	377	394	374	402	424	443	413	444	469	489						
	LO PR	109	116	127	135	115	123	134	142	120	127	139	148	126	134	146	156	132	140	153	163	136	145	158	169						
	MBh	64.5	66.0	70.5	75.3	63.0	64.4	68.8	73.6	61.5	62.9	67.2	71.8	60.0	61.4	65.6	70.1	57.0	58.3	62.3	66.6	52.8	54.0	57.7	61.7						
	S/T	0.82	0.77	0.63	0.47	0.85	0.80	0.65	0.49	0.88	0.82	0.67	0.50	0.90	0.85	0.69	0.52	0.94	0.88	0.72	0.54	0.95	0.89	0.72	0.54						

	2525	MBh	71.2	72.6	76.0	81.1	69.5	70.9	74.3	79.2	67.9	69.2	72.5	77.3	66.2	67.5	70.7	75.4	62.9	64.1	67.2	71.7	58.3	59.4	62.2	66.4	
		S/T	0.95	0.91	0.82	0.67	0.98	0.95	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.94	0.76	1.00	1.00	0.94	0.77	
		Delta T	25	24	23	20	25	24	23	20	25	24	23	20	25	24	25	23	20	23	23	20	21	22	21	19	
		KW	5.00	5.09	5.24	5.40	5.35	5.46	5.62	5.80	5.67	5.78	5.96	6.15	5.67	5.78	5.96	6.15	6.46	6.18	6.31	6.51	6.72	6.39	6.52	6.73	6.94
		HI PR	238	256	270	282	267	287	303	316	303	327	345	360	303	327	345	360	410	389	418	442	461	430	462	488	509
85	2250	LO PR	113	121	132	140	120	128	139	148	125	133	145	154	131	139	152	162	137	146	159	170	142	151	165	175	
		MBh	69.1	70.5	73.8	78.7	67.5	68.8	72.1	76.9	65.9	67.2	70.4	75.1	64.3	65.6	68.7	73.2	61.1	62.3	65.2	69.6	56.6	57.7	60.4	64.5	
		S/T	0.90	0.87	0.79	0.64	0.93	0.90	0.81	0.66	0.96	0.92	0.83	0.68	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.73	1.00	1.00	0.90	0.73	
		Delta T	25	25	24	20	26	25	24	21	26	25	24	21	26	26	24	21	21	25	25	24	21	23	24	22	19
		KW	4.96	5.06	5.21	5.36	5.31	5.42	5.58	5.75	5.63	5.74	5.91	6.10	5.63	5.74	5.91	6.10	6.40	6.13	6.26	6.46	6.66	6.34	6.47	6.67	6.89
	1991	HI PR	235	253	268	279	264	284	300	313	300	323	341	356	342	368	389	406	385	414	437	456	425	458	483	504	
		LO PR	112	120	130	139	119	126	138	147	123	131	143	153	130	138	150	160	136	144	158	168	140	149	163	174	
		MBh	65.7	66.9	70.1	74.8	64.1	65.4	68.5	73.1	62.6	63.8	66.9	71.3	61.1	62.3	65.2	69.6	58.0	59.2	62.0	66.1	53.8	54.8	57.4	61.2	
		S/T	0.86	0.83	0.75	0.61	0.89	0.86	0.78	0.63	0.92	0.89	0.80	0.65	0.95	0.91	0.82	0.67	0.98	0.95	0.86	0.69	0.99	0.96	0.86	0.70	
		Delta T	26	26	24	21	27	26	25	21	27	26	25	21	27	26	25	22	22	26	26	24	21	25	24	23	20
		KW	4.89	4.98	5.13	5.28	5.23	5.34	5.50	5.66	5.54	5.65	5.82	6.00	5.81	5.93	6.11	6.30	6.04	6.16	6.36	6.56	6.24	6.37	6.57	6.78	
		HI PR	231	248	262	273	259	279	294	307	294	317	335	349	335	361	381	397	377	406	429	447	417	449	474	494	
		LO PR	110	117	128	136	116	124	135	144	121	129	140	150	127	135	147	157	133	142	155	165	138	146	160	170	
		MBh	65.7	66.9	70.1	74.8	64.1	65.4	68.5	73.1	62.6	63.8	66.9	71.3	61.1	62.3	65.2	69.6	58.0	59.2	62.0	66.1	53.8	54.8	57.4	61.2	
		S/T	0.86	0.83	0.75	0.61	0.89	0.86	0.78	0.63	0.92	0.89	0.80	0.65	0.95	0.91	0.82	0.67	0.98	0.95	0.86	0.69	0.99	0.96	0.86	0.70	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI Rating conditions

kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

STANDARD BELT DRIVE — HORIZONTAL

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.2	---	---	---	---	---	---	---	---	1524	0.32	1340	0.25
0.4	---	---	---	---	1628	0.41	1396	0.32	1171	0.24	900	0.16
0.6	---	---	1541	0.43	1284	0.32	1024	0.23	714	0.14	---	---
0.8	1444	0.45	1193	0.33	936	0.24	---	---	---	---	---	---
1.0	1111	0.34	806	0.23	---	---	---	---	---	---	---	---
1.2	744	0.22	---	---	---	---	---	---	---	---	---	---

HIGH-STATIC BELT DRIVE — HORIZONTAL

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.6	---	---	---	---	---	---	---	---	1568	0.45	1266	0.32
0.8	---	---	---	---	---	---	1492	0.47	1194	0.34	922	0.23
1.0	---	---	---	---	1476	0.52	1163	0.37	856	0.24	---	---
1.2	---	---	1458	0.57	1146	0.41	802	0.25	---	---	---	---
1.4	1458	0.63	1139	0.46	782	0.30	---	---	---	---	---	---
1.6	1139	0.52	844	0.36	---	---	---	---	---	---	---	---
1.8	844	0.42	---	---	---	---	---	---	---	---	---	---

STANDARD BELT DRIVE — DOWN SHOT

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.2	---	---	---	---	---	---	1596	0.36	1368	0.28	1162	0.21
0.4	---	---	---	---	1468	0.37	1224	0.28	981	0.20	---	---
0.6	1610	0.51	1383	0.39	1124	0.28	856	0.19	---	---	---	---
0.8	1293	0.40	1021	0.29	776	0.20	---	---	---	---	---	---
1.0	948	0.29	614	0.17	---	---	---	---	---	---	---	---

HIGH-STATIC BELT DRIVE — DOWN SHOT

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.6	---	---	---	---	---	---	1655	0.53	1389	0.39	1103	0.28
0.8	---	---	---	---	1640	0.57	1342	0.43	1035	0.29	775	0.19
1.0	---	---	1638	0.63	1326	0.47	1002	0.32	713	0.19	---	---
1.2	1638	0.69	1307	0.52	984	0.36	---	---	---	---	---	---
1.4	1307	0.58	1002	0.42	---	---	---	---	---	---	---	---
1.6	1002	0.48	717	0.32	---	---	---	---	---	---	---	---
1.8	717	0.38	---	---	---	---	---	---	---	---	---	---

Note: Tables represent dry coil without filter; to compensate for filter, add 0.08" to measured E.S.P. SCFM correction for wet coil = 4%.

STANDARD DIRECT DRIVE — HORIZONTAL

CFM	STATIC	AMPS	WATTS	RPM	SPEED TAP
1293	0.1	1.72	364	715	Low
1235	0.2	1.67	354	759	
1173	0.3	1.62	342	803	
1124	0.4	1.58	330	841	
1056	0.5	1.54	316	880	
978	0.6	1.47	298	913	
1500	0.1	2.13	462	808	Med
1434	0.2	2.10	448	838	
1381	0.3	2.04	436	869	
1318	0.4	2.00	424	902	
1238	0.5	1.94	406	929	
1163	0.6	1.88	392	951	
1055	0.7	1.80	370	990	
936	0.8	1.72	350	1017	
1441	0.4	2.35	504	940	High
1355	0.5	2.28	484	962	
1264	0.6	2.21	468	989	
1157	0.7	2.13	446	1012	
1027	0.8	2.03	418	1034	
840	0.9	1.90	388	1067	

NOTE: Assumes dry coil with filter in place; SCFM correction for wet coil = 4%

STANDARD DIRECT DRIVE — DOWN SHOT

CFM	STATIC	AMPS	WATTS	RPM	SPEED TAP
1313	0.10	1.68	356	748	Low
1247	0.20	1.63	344	786	
1178	0.30	1.59	334	832	
1094	0.40	1.55	324	869	
1002	0.50	1.50	312	913	
919	0.60	1.45	296	940	
1471	0.10	2.11	454	830	Med
1400	0.20	2.06	440	863	
1354	0.30	2.02	432	896	
1271	0.40	1.95	416	929	
1188	0.50	1.90	398	957	
1083	0.60	1.82	378	984	
955	0.70	1.74	356	1012	High
1470	0.30	2.37	510	935	
1390	0.40	2.31	492	957	
1310	0.50	2.25	476	978	
1206	0.60	2.17	454	1000	
1098	0.70	2.09	436	1023	
966	0.80	1.99	412	1045	

AIRFLOW DATA — 4 TONS

STANDARD DIRECT DRIVE — HORIZONTAL

CFM	STATIC	AMPS	WATTS	RPM	SPEED TAP
1592	0.1	2.54	543	815	Low
1528	0.2	2.43	521	858	
1464	0.3	2.32	499	901	
1380	0.4	2.21	475	930	
1296	0.5	2.10	451	959	
1828	0.1	3.08	665	892	Med
1700	0.2	2.75	601	924	
1606	0.3	2.61	563	966	
1531	0.4	2.48	537	990	
1401	0.5	2.32	503	1023	
1287	0.6	2.22	477	1045	
1123	0.7	2.05	441	1073	
1926	0.1	3.34	740	937	High
1825	0.2	3.18	700	965	
1712	0.3	3.03	660	989	
1598	0.4	2.87	626	1015	
1482	0.5	2.76	596	1032	
1357	0.6	2.62	564	1049	

Note: Assumes dry coil with filter in place; SCFM correction for wet coil = 4%

STANDARD DIRECT DRIVE — DOWN SHOT

CFM	STATIC	AMPS	WATTS	RPM	SPEED TAP
1612	0.1	2.60	554	789	Low
1548	0.2	2.49	532	832	
1484	0.3	2.38	510	875	
1400	0.4	2.27	486	904	
1316	0.5	2.16	462	933	
1846	0.1	3.14	676	866	Med
1718	0.2	2.81	612	898	
1624	0.3	2.67	574	940	
1549	0.4	2.54	548	964	
1419	0.5	2.38	514	997	
1305	0.6	2.28	488	1019	
1141	0.7	2.11	452	1047	High
1954	0.1	3.43	758	924	
1853	0.2	3.27	718	952	
1740	0.3	3.12	678	976	
1626	0.4	2.96	644	1002	
1510	0.5	2.85	614	1019	
1385	0.6	2.71	582	1036	

STANDARD BELT DRIVE — HORIZONTAL

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.2	---	---	---	---	---	---	---	---	1800	0.47	1556	0.35
0.4	---	---	---	---	2002	0.65	1708	0.49	1438	0.36	1167	0.22
0.6	---	---	1910	0.67	1612	0.50	1330	0.37	1030	0.23	---	---
0.8	1813	0.69	1571	0.54	1222	0.36	989	0.25	---	---	---	---
1.0	1478	0.56	1142	0.32	---	---	---	---	---	---	---	---
1.2	1107	0.41	---	---	---	---	---	---	---	---	---	---

HIGH-STATIC BELT DRIVE — HORIZONTAL

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.6	---	---	---	---	---	---	---	---	1894	0.66	1585	0.49
0.8	---	---	---	---	---	---	1839	0.71	1532	0.53	1223	0.37
1.0	---	---	---	---	1782	0.73	1477	0.55	1170	0.39	---	---
1.2	---	---	1786	0.80	1445	0.59	1115	0.40	---	---	---	---
1.4	1764	0.86	1426	0.64	1107	0.46	---	---	---	---	---	---
1.6	1446	0.72	1098	0.50	---	---	---	---	---	---	---	---
1.8	1099	0.56	---	---	---	---	---	---	---	---	---	---

STANDARD BELT DRIVE — DOWN SHOT

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.2	---	---	---	---	---	---	1891	0.56	1632	0.42	1391	0.30
0.4	---	---	---	---	1796	0.57	1533	0.43	1290	0.31	1055	0.19
0.6	1948	0.74	1744	0.61	1446	0.44	1206	0.32	910	0.19	---	---
0.8	1654	0.63	1409	0.48	1096	0.31	---	---	---	---	---	---
1.0	1337	0.50	987	0.28	---	---	---	---	---	---	---	---

HIGH-STATIC BELT DRIVE — DOWN SHOT

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.6	---	---	---	---	---	---	1989	0.77	1712	0.59	1433	0.44
0.8	---	---	---	---	1929	0.79	1662	0.63	1384	0.47	1106	0.33
1.0	---	---	1952	0.88	1622	0.67	1335	0.49	1056	0.34	---	---
1.2	1897	0.93	1611	0.73	1315	0.54	1008	0.36	---	---	---	---
1.4	1616	0.80	1298	0.59	1007	0.42	---	---	---	---	---	---
1.6	1316	0.66	1007	0.46	---	---	---	---	---	---	---	---
1.8	---	---	---	---	---	---	---	---	---	---	---	---

Note: Tables represent dry coil without filter; to compensate for filter, add 0.08" to measured E.S.P. SCFM correction for wet coil = 4%.

STANDARD DIRECT-DRIVE — HORIZONTAL

CFM	STATIC	AMPS	WATTS	RPM	SPEED TAP
1416	0.1	1.63	176	588	T1
1295	0.2	1.61	174	621	
1200	0.3	1.68	186	660	
1133	0.4	1.79	196	704	
1045	0.5	1.90	208	753	
1543	0.1	2.00	220	627	T2
1485	0.2	2.12	236	671	
1425	0.3	2.20	250	698	
1352	0.4	2.26	258	748	
1304	0.5	2.39	274	786	
2107	0.1	4.02	502	797	T3
2031	0.2	4.13	518	819	
1980	0.3	4.27	536	858	
1954	0.4	4.37	554	880	
1887	0.5	4.48	572	913	
1839	0.6	4.58	582	940	
1782	0.7	4.72	602	968	
2224	0.1	4.73	592	832	T4
2165	0.2	4.79	612	860	
2123	0.3	4.91	630	891	
2079	0.4	5.01	642	913	
2029	0.5	5.14	666	946	
1978	0.6	5.26	676	969	
1926	0.7	5.38	698	1001	
1872	0.8	5.48	712	1028	
1817	0.9	5.58	722	1056	
2318	0.1	5.42	700	874	T5
2296	0.2	5.55	720	903	
2228	0.3	5.66	734	929	
2193	0.4	5.76	748	950	
2145	0.5	5.90	766	979	
2097	0.6	5.99	784	1012	
2054	0.7	6.10	798	1034	
1991	0.8	6.15	810	1050	
1952	0.9	6.26	826	1079	

STANDARD DIRECT-DRIVE — DOWN SHOT

CFM	STATIC	AMPS	WATTS	RPM	SPEED TAP
1237	0.1	1.64	180	638	T1
1191	0.2	1.75	194	682	
1127	0.3	1.80	200	715	
1065	0.4	1.89	214	753	
994	0.5	1.97	220	797	
1437	0.1	2.13	248	687	T2
1384	0.2	2.24	254	726	
1312	0.3	2.29	262	759	
1245	0.4	2.42	280	803	
1185	0.5	2.54	294	847	
1988	0.1	4.49	558	885	T3
1942	0.2	4.58	574	907	
1882	0.3	4.69	582	935	
1847	0.4	4.80	600	962	
1784	0.5	4.87	612	990	
1762	0.6	4.97	626	1008	
1688	0.7	5.05	642	1039	
2106	0.1	5.14	650	924	T4
2050	0.2	5.26	670	951	
1993	0.3	5.32	678	969	
1960	0.4	5.47	696	1001	
1920	0.5	5.54	706	1021	
1880	0.6	5.61	726	1041	
1810	0.7	5.73	736	1072	
1760	0.8	5.81	750	1093	
1694	0.9	5.84	752	1122	
2199	0.1	5.87	762	968	T5
2146	0.2	5.96	772	989	
2121	0.3	6.06	788	1012	
2066	0.4	6.15	804	1039	
2010	0.5	6.21	814	1056	
1978	0.6	6.32	834	1084	
1919	0.7	6.28	830	1102	
1837	0.8	6.22	814	1122	
1738	0.9	6.04	786	1127	

NOTES

- Assumes dry coil with filter in place; SCFM correction for wet coil = 4%
- Five-ton models are shipped from the factory with speed tap set on T4.

STANDARD BELT DRIVE — HORIZONTAL

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.2	---	---	---	---	2460	0.96	2251	0.80	2073	0.65	1862	0.51
0.4	---	---	2408	1.00	2206	0.84	1982	0.68	1808	0.55	1572	0.41
0.6	2402	1.08	2173	0.89	1943	0.72	1701	0.55	1511	0.43	---	---
0.8	2153	0.95	1917	0.77	1667	0.59	---	---	---	---	---	---
1.0	1888	0.82	1634	0.63	---	---	---	---	---	---	---	---
1.2	1601	0.67	---	---	---	---	---	---	---	---	---	---

HIGH-STATIC BELT DRIVE — HORIZONTAL

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.6	---	---	---	---	---	---	---	---	2219	0.95	1970	0.75
0.8	---	---	---	---	---	---	2215	1.04	1956	0.82	1697	0.62
1.0	---	---	---	---	2240	1.15	1957	0.90	1681	0.67	---	---
1.2	---	---	2260	1.26	1983	1.00	1683	0.74	---	---	---	---
1.4	2288	1.38	2009	1.10	1711	0.84	---	---	---	---	---	---
1.6	2032	1.21	1741	0.93	---	---	---	---	---	---	---	---
1.8	1776	1.04	---	---	---	---	---	---	---	---	---	---

STANDARD BELT DRIVE — DOWN SHOT

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.2	---	---	2210	0.91	2041	0.76	1869	0.63	1739	0.52	1565	0.40
0.4	2197	0.98	2021	0.82	1841	0.67	1660	0.54	1521	0.44	1339	0.32
0.6	2002	0.88	1822	0.72	1635	0.58	1445	0.44	1288	0.35	---	---
0.8	1799	0.77	1610	0.62	1425	0.48	---	---	---	---	---	---
1.0	1587	0.67	1384	0.51	---	---	---	---	---	---	---	---

HIGH-STATIC BELT DRIVE — DOWN SHOT

ESP (" H ₂ O)	TURNS OPEN											
	0		1		2		3		4		5	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.6	---	---	---	---	2262	1.16	2051	0.95	1851	0.76	1657	0.60
0.8	---	---	2277	1.27	2070	1.05	1852	0.84	1646	0.66	---	---
1.0	2304	1.39	2089	1.15	1872	0.93	1647	0.72	---	---	---	---
1.2	2104	1.26	1893	1.03	1668	0.81	---	---	---	---	---	---
1.4	1912	1.13	1690	0.90	---	---	---	---	---	---	---	---
1.6	1720	1.00	---	---	---	---	---	---	---	---	---	---

Note: Tables represent dry coil without filter; to compensate for filter, add 0.08" to measured E.S.P. SCFM correction for wet coil = 4%.

DCG072 STANDARD BELT DRIVE AND TWO-SPEED STANDARD BELT DRIVE AT HIGH SPEED - HORIZONTAL

ESP (In W.C.)	0 TURNS		1 TURN		2 TURNS		3 TURNS		4 TURNS		5 TURNS	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.2	---	---	---	---	---	---	2749	1.18	2573	0.96	2402	0.79
0.4	---	---	---	---	2680	1.22	2544	1.06	2346	0.84	2164	0.68
0.6	---	---	2655	1.31	2498	1.10	2306	0.92	2094	0.72	1890	0.57
0.8	2703	1.47	2486	1.20	2263	0.97	2076	0.81	---	---	---	---
1	2515	1.34	2272	1.07	2002	0.83	---	---	---	---	---	---
1.2	2253	1.16	2028	0.93	---	---	---	---	---	---	---	---

DCG072 STANDARD BELT DRIVE AND TWO-SPEED STANDARD BELT DRIVE AT HIGH SPEED - DOWN SHOT

ESP (In W.C.)	0 TURNS		1 TURN		2 TURNS		3 TURNS		4 TURNS		5 TURNS	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.2	---	---	---	---	2625	1.18	2486	1.02	2322	0.83	2152	0.68
0.4	2765	1.52	2596	1.28	2476	1.09	2327	0.94	2159	0.75	1938	0.59
0.6	2650	1.43	2452	1.18	2325	1.00	2070	0.80	1898	0.64	---	---
0.8	2443	1.29	2251	1.06	2068	0.86	1868	0.71	---	---	---	---
1	2258	1.17	2040	0.94	1806	0.73	---	---	---	---	---	---
1.2	2021	1.02	---	---	---	---	---	---	---	---	---	---

HIGH STATIC BELT DRIVE — HORIZONTAL

ESP (In W.C.)	0 TURNS		1 TURN		2 TURNS		3 TURNS		4 TURNS		5 TURNS	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.6	---	---	---	---	---	---	---	---	2677	1.29	2486	1.07
0.8	---	---	---	---	---	---	2690	1.42	2529	1.20	2263	0.94
1	---	---	---	---	2740	1.60	2471	1.27	2246	1.02	1972	0.79
1.2	---	---	2748	1.74	2518	1.44	2255	1.13	1970	0.87	---	---
1.4	2797	1.87	2562	1.59	2273	1.27	2025	0.99	---	---	---	---
1.6	2556	1.67	2314	1.40	2035	1.11	---	---	---	---	---	---
1.8	2342	1.50	2037	1.21	---	---	---	---	---	---	---	---
2	2137	1.35	---	---	---	---	---	---	---	---	---	---


HIGH STATIC BELT DRIVE — DOWN SHOT

ESP (In W.C.)	0 TURNS		1 TURN		2 TURNS		3 TURNS		4 TURNS		5 TURNS	
	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP	CFM	BHP
0.6	---	---	---	---	2793	1.64	2575	1.37	2407	1.15	2250	0.96
0.8	---	---	2775	1.76	2638	1.53	2407	1.25	2226	1.04	2011	0.84
1	2821	1.89	2660	1.67	2407	1.36	2194	1.12	2012	0.92	---	---
1.2	2696	1.79	2497	1.54	2228	1.23	1977	0.98	---	---	---	---
1.4	2455	1.59	2236	1.35	2013	1.10	---	---	---	---	---	---
1.6	2262	1.44	2032	1.20	---	---	---	---	---	---	---	---
1.8	2069	1.30	---	---	---	---	---	---	---	---	---	---

AIR FLOW PRESSURE DROP OF DOWN FLOW ECONOMIZER

AIRFLOW PRESSURE DROP OF DOWNFLOW ECONOMIZER FOR 3 TO 6 TON ROFTOP UNITS (100% RETURN AIR)											
SCF, in WG	800	1000	1200	1400	1600	1800	2000	2200	2400	2600	2800
	0.02	0.04	0.05	0.07	0.09	0.12	0.14	0.17	0.21	0.24	0.28

HIGH EFFICIENCY MERV 13 AIR FILTER OPTION

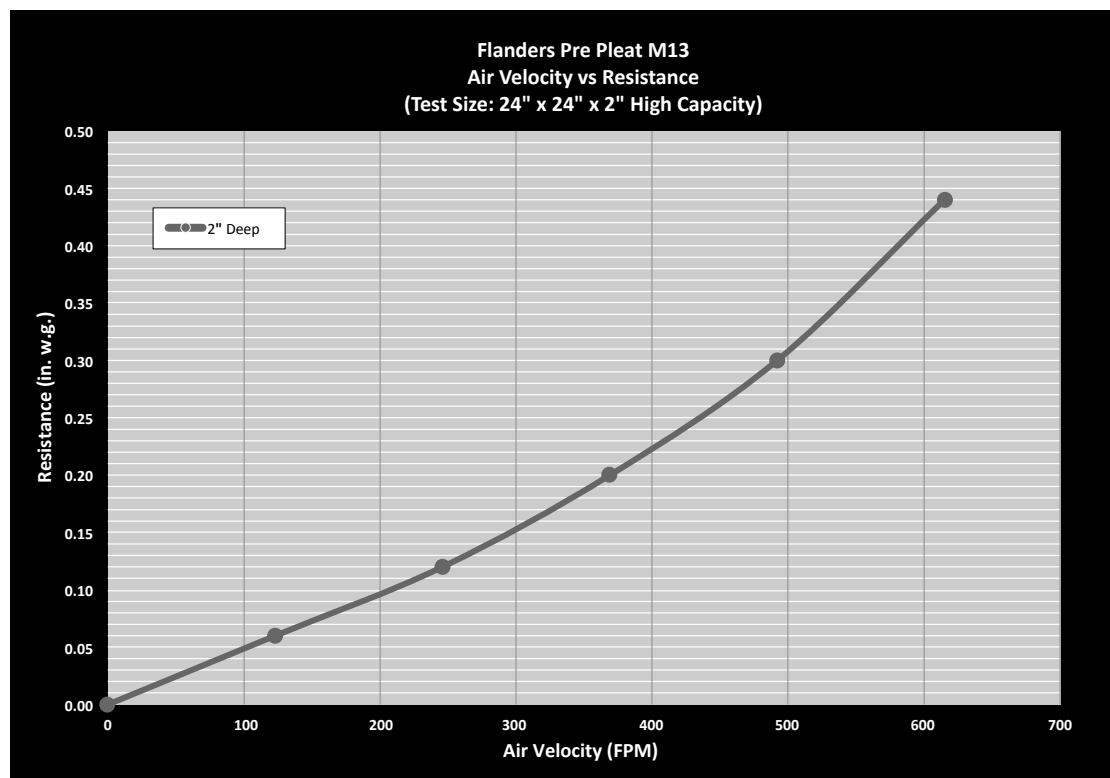

TONNAGE:	FILTER NOMINAL SIZE:	PART NUMBER:	ORDER QTY:
3	24 x 24 x 2	0160L00203	1
4	14 x 20 x 2	0160L00204	4
5, 6, 7.5	16 x 20 x 2	0160L00205	4
7.5(HP), 8.5, 10	16 X 24 X 2	0160L00206	4
12.5	20 x 25 x 2	0160L00202	4
15, 20	20 x 25 x 2	0160L00202	6
25	20 X 20 X 2	0160L00201	8


CRANKCASE HEATER SELECTION TABLE

ZP/ZPS...	COMPRESSOR DIAMETER	COMPRESSOR VOLTAGE			CRANKCASE HEATER WATTS
		230V	460V	575V	
16-31	5.5"	0163R00002S	0163R00031S	0163R00032S	40
39-83	6.58/7.3"	0130L00017S	0130L00018S	0130L00019S	70
103-137	9.14"	0130L00020S	0130L00021S	0130L00022S	90


DC*,DT* & DS* TONNAGE	COMPRESSOR VOLTAGE			CRANKCASE HEATER WATTS
	230V	460V	575V	
3 Ton	0163R00002S	0163R00031S	0163R00032S	40
4 Ton-12.5 Ton	0130L00017S	0130L00018S	0130L00019S	70
15-20 Ton**	0130L00017S	0130L00018S	0130L00019S	70
25 Ton	0130L00020S	0130L00021S	0130L00022S	90

*Includes C,G&H models.

**If Compressor Diameter is 9.14" then use 25 Ton Crankcase heaters.

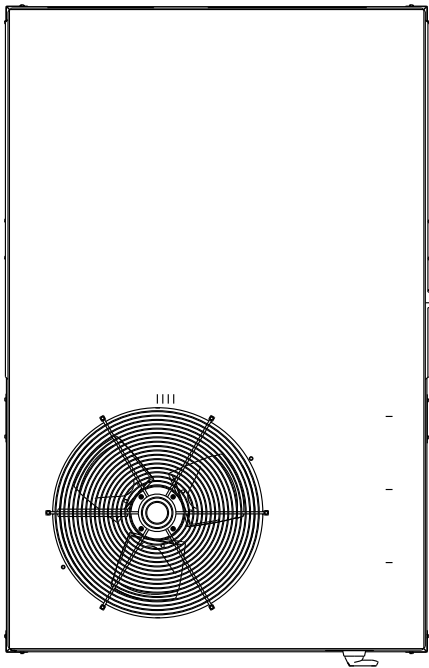


TOP VIEW

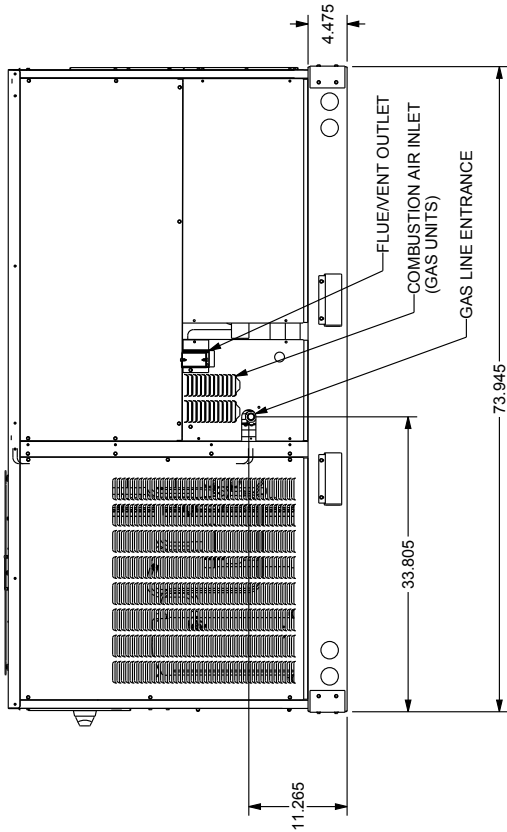

FRONT VIEW


MODEL TONNAGES	"A"	"B"	"C"
3 TON COMMERCIAL GAS, HT PUMP, AIR CONDITIONER	38.840	16.555	26.055
4 TON COMMERCIAL GAS, HT PUMP, AIR CONDITIONER	38.840	16.555	26.055
5 TON COMMERCIAL GAS, HT PUMP, AIR CONDITIONER	38.840	16.555	26.055
6 TON COMMERCIAL GAS, HT PUMP, AIR CONDITIONER	42.840	20.555	30.055

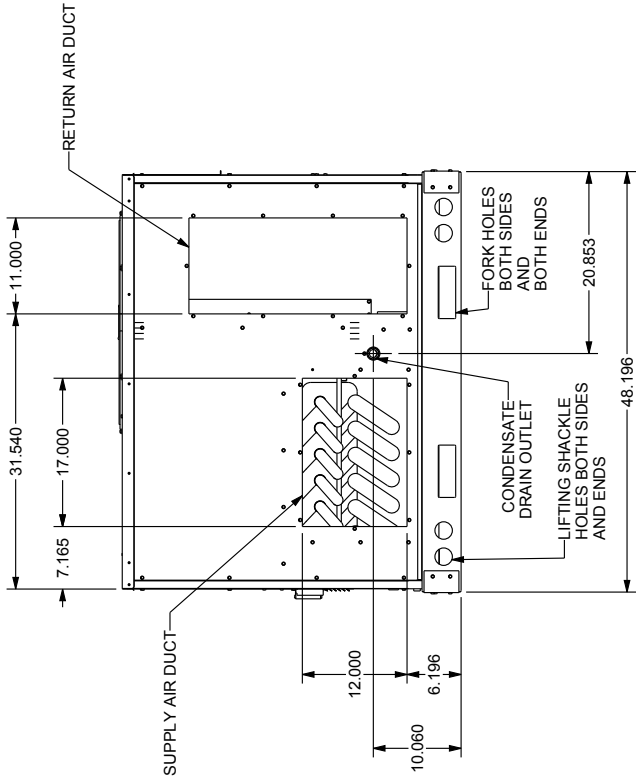

RIGHT END VIEW


DC*036-072***
3 THRU 6 TON COMMERCIAL

ALL DIMENSIONS GIVEN ARE IN INCHES.
ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE

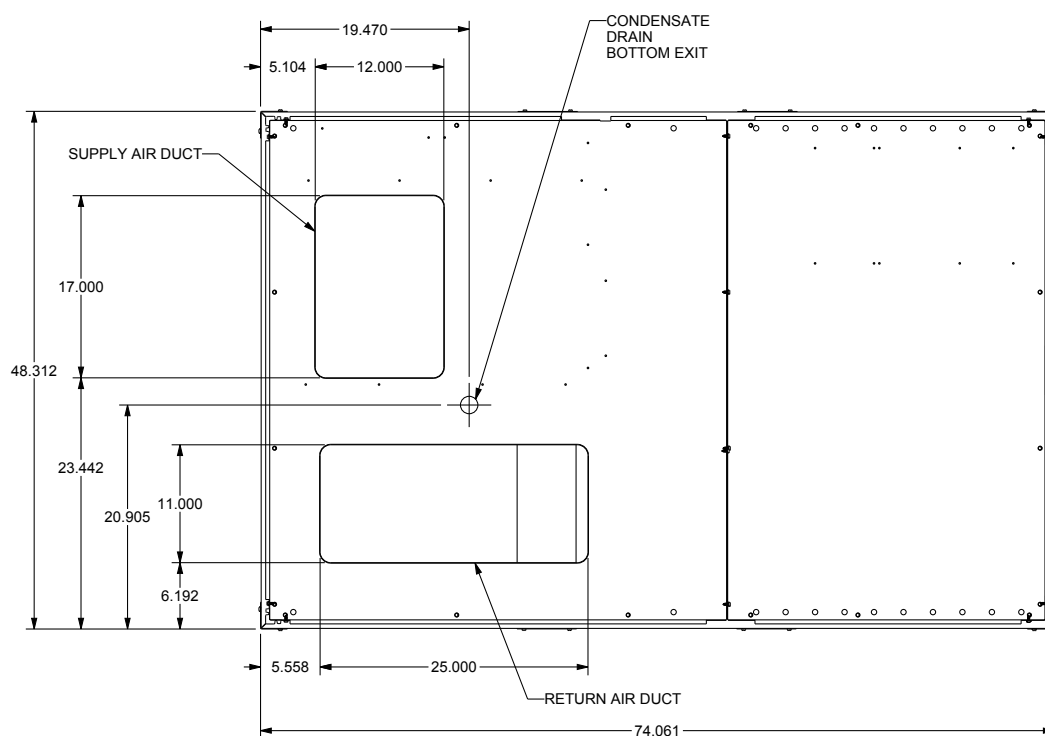


BASE PAN VIEW
(VIEWED FROM TOP)

MODEL TONNAGES	"A"	"B"	"C"
3 TON COMMERCIAL GAS, HT PUMP, AIR CONDITIONER	38.840	16.555	26.055
4 TON COMMERCIAL GAS, HT PUMP, AIR CONDITIONER	38.840	16.555	26.055
5 TON COMMERCIAL GAS, HT PUMP, AIR CONDITIONER	38.840	16.555	26.055
6 TON COMMERCIAL GAS, HT PUMP, AIR CONDITIONER	42.840	20.555	30.055


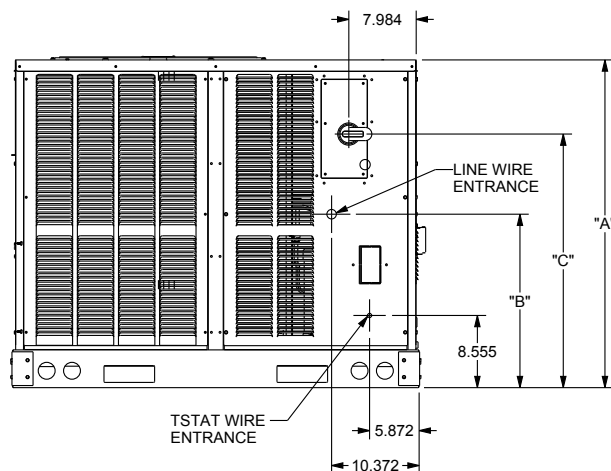


LEFT END VIEW


Maintain an adequate clearance around the unit for safety, service, maintenance, and proper unit operation. Leave a total clearance of 75" on the main control panel side of the unit for possible removal of fan shaft, coil, electric heat, and gas furnace. Leave a clearance of 48" on all other sides of the unit for possible compressor removal or service access, and to ensure proper ventilation and condenser airflow. Do not install the unit Beneath any obstruction. Install the unit away from all building exhausts to inhibit ingestion of exhaust air into the unit's fresh-air intake.

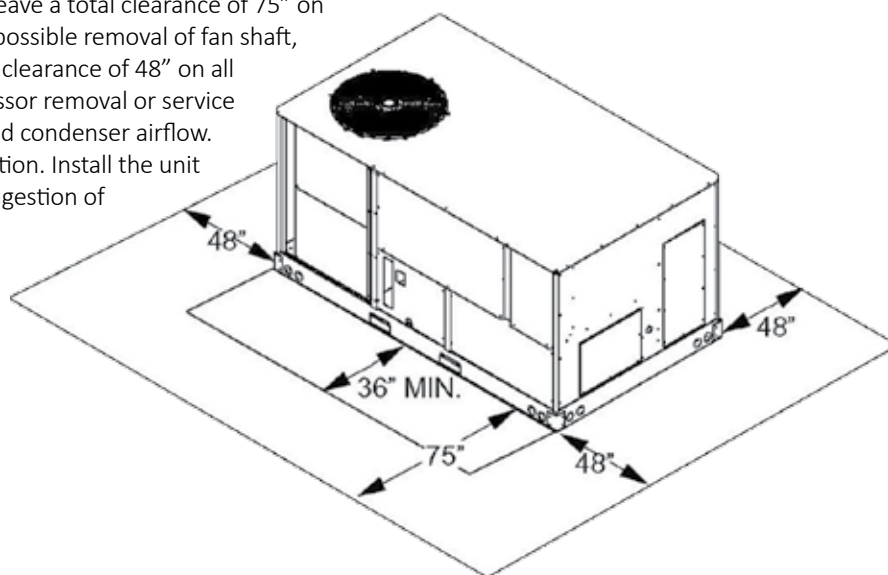

ELECTRICAL ENTRANCE LOCATIONS

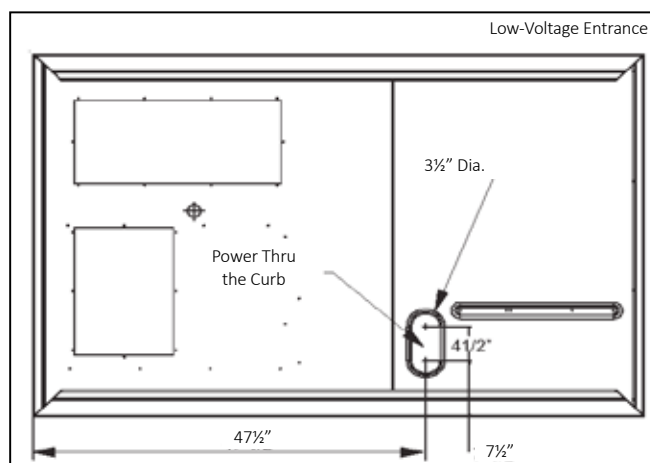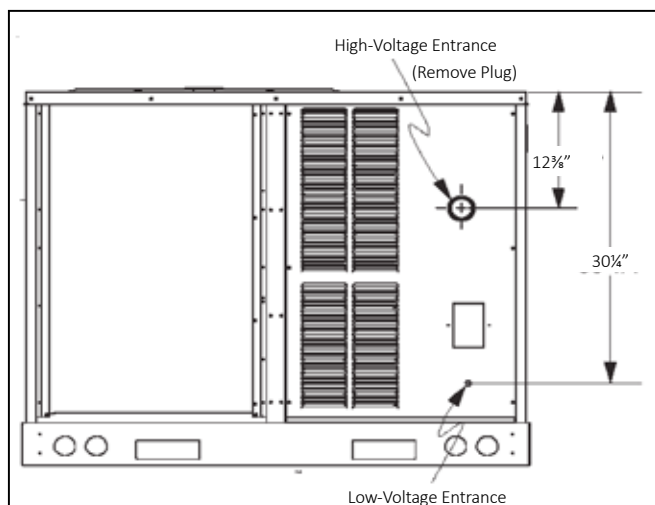

CORNER & CENTER-OF-GRAVITY LOCATIONS

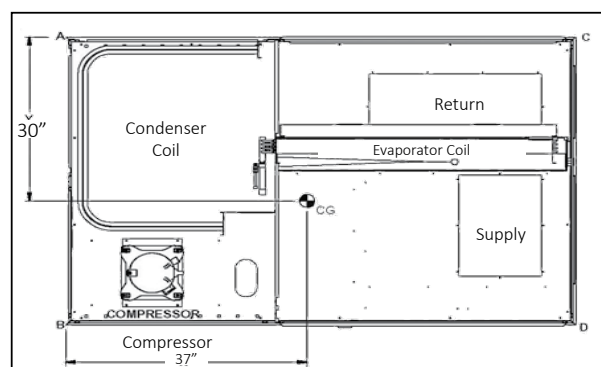

UNIT WEIGHTS	3-TON WEIGHTS	4-TON WEIGHTS	5-TON WEIGHTS	6-TON WEIGHTS
Corner Weight (A)	100	110	115	130
Corner Weight (B)	170	180	195	215
Corner Weight (C)	105	110	120	130
Corner Weight (D)	170	180	195	215
Unit Shipping Weight	560	605	650	715
Unit Operating Weight	545	580	625	690

Note: Weights are calculated without accessories installed.

Provisions for forks have been included in the unit base frame. No other fork locations are approved.

- Unit must be lifted by the four lifting holes located at the base frame corners.
- Lifting cables should be attached to the unit with shackles.
- The distance between the crane hook and the top of the unit must not be less than 60".
- Two spreader bars must span over the unit to prevent damage to the cabinet by the lift cables. Spreader bars must be of sufficient length so that cables do not come in contact with the unit during transport. Remove wood struts mounted beneath unit base frame before setting unit on roof curb. These struts are intended to protect unit base frame from fork lift damage. To remove the struts, extract the sheet metal retainers and pull the struts through the base of the unit. Refer to rigging label on the unit.

Important: If using bottom discharge with roof curb, duct-work should be attached to the curb prior to installing the unit. Duct-work dimensions are shown in Roof Curb Installation Instructions Manual.

Refer to the Roof Curb Installation Instructions for proper curb installation. Curbing must be installed in compliance with the National Roofing Contractors Association Manual.

Lower unit carefully onto roof mounting curb. While rigging the unit, the center of gravity will cause the condenser end to be lower than the supply air end.

Bring condenser end of unit into alignment with the curb. With condenser end of the unit resting on curb member and using curb as a fulcrum, lower opposite end of the unit until entire unit is seated on the curb. When a rectangular cantilever curb is used, take care to center the unit. Check for proper alignment and orientation of supply and return openings with duct.

To assist in determining rigging requirements, unit weights are shown below.

Curb installations must comply with local codes and should follow the established guidelines of the National Roofing Contractors Association.




Proper unit installation requires that the roof curb be firmly and permanently attached to the roof structure. Check for adequate fastening method prior to setting the unit on the curb.


Full perimeter roof curbs are available from the factory and are shipped unassembled. The installing contractor is responsible for field assembly, squaring, leveling, and mounting on the roof structure. All required hardware necessary for the assembly of the sheet metal curb is included in the curb accessory package.

- Determine sufficient structural support before locating and mounting the curb and package unit.
- Duct-work must be constructed using industry guidelines. The duct-work must be placed into the roof curb before mounting the package unit. Our full perimeter curbs include duct connection frames to be assembled with the curb. Cantilevered-type curbs are not available from the factory.
- Contractor furnishes curb insulation, cant strips, flashing, and general roofing material.
- Support curbs on parallel sides with roof members. To prevent damage to the unit, the roof members cannot penetrate supply and return duct openings.

Note: The unit and curb accessories are designed to allow vertical duct installation before unit placement. Duct installation after unit placement is not recommended.


See the manual shipped with the roof curb for assembly and installation instructions.

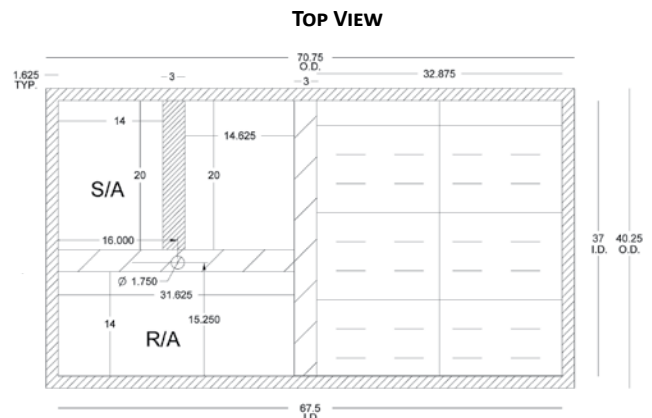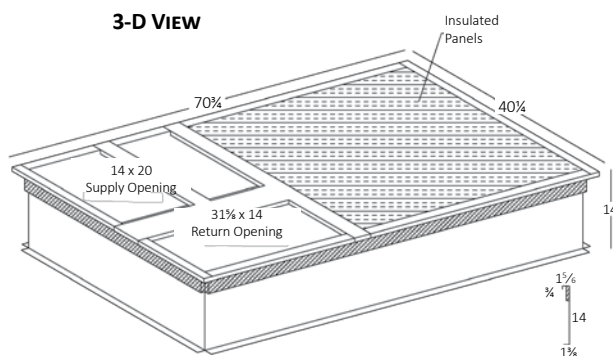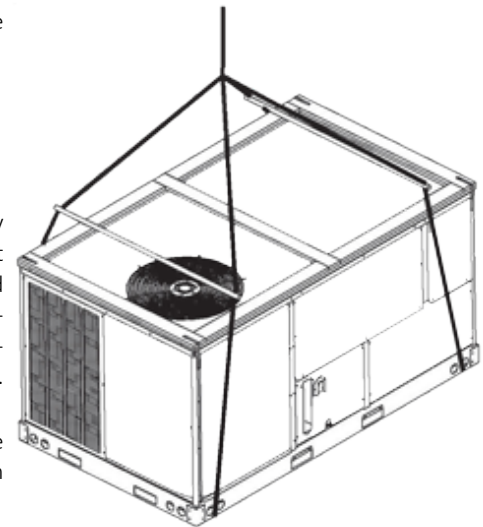

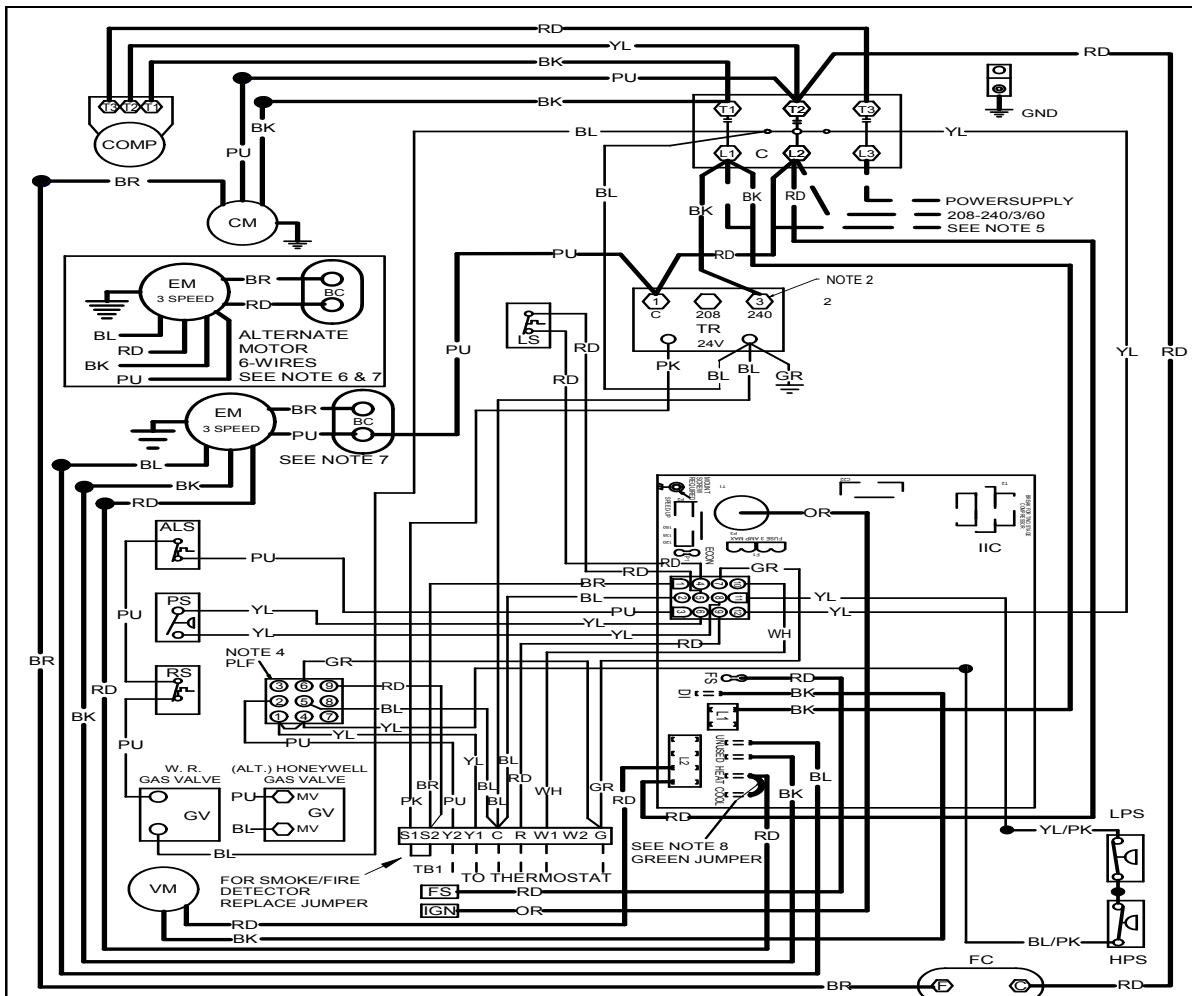

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.


WARNING

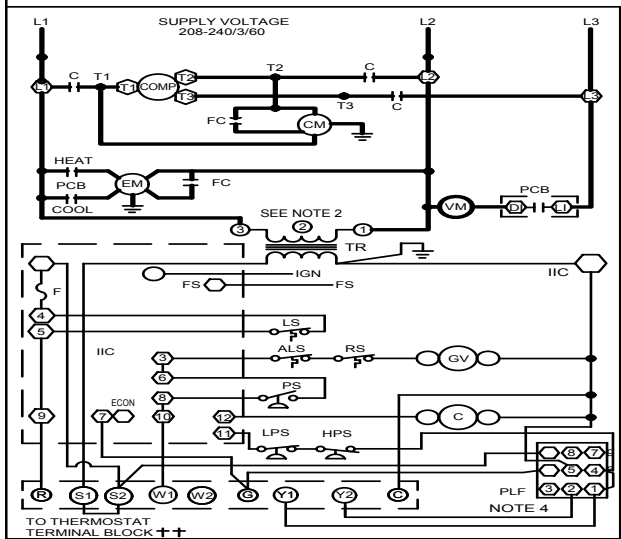

- COMPONENT LEGEND**
- ALS AUXILIARY LIMIT SWITCH
 - COMP COMPRESSOR
 - CM CONDENSER MOTOR
 - C CONTACTOR
 - EM EVAPORATOR MOTOR
 - F FUSE
 - FC FAN CAPACITOR
 - FS FLAME SENSOR
 - GND EQUIPMENT GROUND
 - GV GAS VALVE
 - HPS HIGH PRESSURE SWITCH
 - IIC INTEGRATED IGNITION CONTROL
 - IGN IGNITOR
 - LS LIMIT SWITCH
 - LPS LOW PRESSURE SWITCH
 - PLF FEMALE PLUG/CONNECTOR
 - PS PRESSURE SWITCH
 - RS ROLLOUT SWITCH
 - TB1 TERMINAL BLOCK (24V SIGNAL)
 - TR TRANSFORMER
 - VM VENT MOTOR
 - VMR VENT MOTOR RELAY
 - BC BLOWER CAPACITOR

- FACTORY WIRING**
- LINE VOLTAGE
 - LOW VOLTAGE
 - OPTIONAL
 - HIGH VOLTAGE
- FIELD WIRING**
- HIGH VOLTAGE
 - LOW VOLTAGE
- WIRE CODE**
- BK BLACK
 - BL BLUE
 - BR BROWN
 - GR GREEN
 - OR ORANGE
 - PK PINK
 - PU PURPLE
 - RD RED
 - WH WHITE
 - YL YELLOW
 - YL/PK BLUE WITH PINK STRIP
 - YL/PK YELLOW WITH PINK STRIP

- NOTES**
- REPLACEMENT WIRE MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL. (USE COPPER CONDUCTOR ONLY).
 - FOR 208 VOLT TRANSFORMER OPERATION MOVE BLACK WIRE FROM TERMINAL ① TO TERMINAL ② ON TRANSFORMER.
 - FOR DIFFERENT THAN FACTORY SPEED TAP. CHANGE COOL SPEED AT COOL TERMINAL. CHANGE HEATING SPEED AT HEAT TERMINAL ON CONTROL BOARD.
 - ACCESSORY ECONOMIZER PLUG ADJACENT TO BLOWER HOUSING IN RETURN AIR COMPARTMENT. REMOVE MALE PLUG AND ATTACH FEMALE PLUG TO ECONOMIZER ACCESSORY.
 - USE COPPER CONDUCTORS ONLY. USE NEC CLASS 2 WIRE.
 - PURPLE WIRE CONNECTS TO TRANSFORMER (PIN 1).
 - SPEED TAP TERMINATIONS SHOWN ON DIAGRAM ARE REPRESENTATIVE, BUT ACTUAL FACTORY SETTING MAY BE DIFFERENT BASED ON HEATING VALUE AND CAPACITY OF UNIT.
 - TO RUN DIFFERENT SPEED FOR HEATING AND COOLING, DISCONNECT GREEN JUMPER FROM "COOL" TERMINAL AND REPLACE WITH APPROPRIATE SPEED TAP. THEN PLACE DISCONNECTED END OF JUMPER ON "UNUSED" TERMINAL LEFT OPEN BY MOVING THE SPEED TAP.

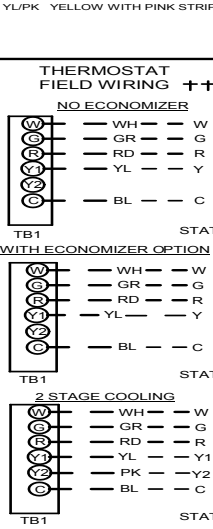


INSTALLER/SERVICEMAN

THE STATUS LIGHT ON THE FURNACE CONTROL MAY BE USED AS A GUIDE TO TROUBLESHOOTING THIS APPLIANCE. STATUS LIGHT CODES ARE AS FOLLOWS:

STATUS LIGHT	EQUIP. STATUS	CHECK
ON	NORMAL OPERATION	-
OFF	NO POWER OR INTERNAL CONTROL FAULT	CHECK INPUT POWER CHECK FUSE ON CONTROL REPLACE CONTROL
1 BLINK	IGNITION FAILURE OR OPEN ROLLOUT SWITCH OR OPEN AUX LIMIT SWITCH	GAS FLOW GAS PRESSURE GAS VALVE FLAME SENSOR FLAME ROLLOUT BAD SWITCH AUX. LIMIT OPEN
2 BLINKS	PRESSURE SWITCH OPEN	CHECK PRESSURE SWITCH
3 BLINKS	PRESSURE SWITCH CLOSED WITHOUT INDUCER ON	CHECK PRESSURE SWITCH
4 BLINKS	OPEN LIMIT SWITCH	MAIN LIMIT OPEN BAD SWITCH
5 BLINKS	FALSE FLAME SENSED	STICKING GAS VALVE
6 BLINKS	COMPRESSOR OUTPUT DELAY	3 MIN. COMP. ANTI-CYCLE TIMER


SEE UNIT RATING PLATE FOR TYPE AND SIZE OF OVERCURRENT PROTECTION.

208-240/3/60 0140L02902-A

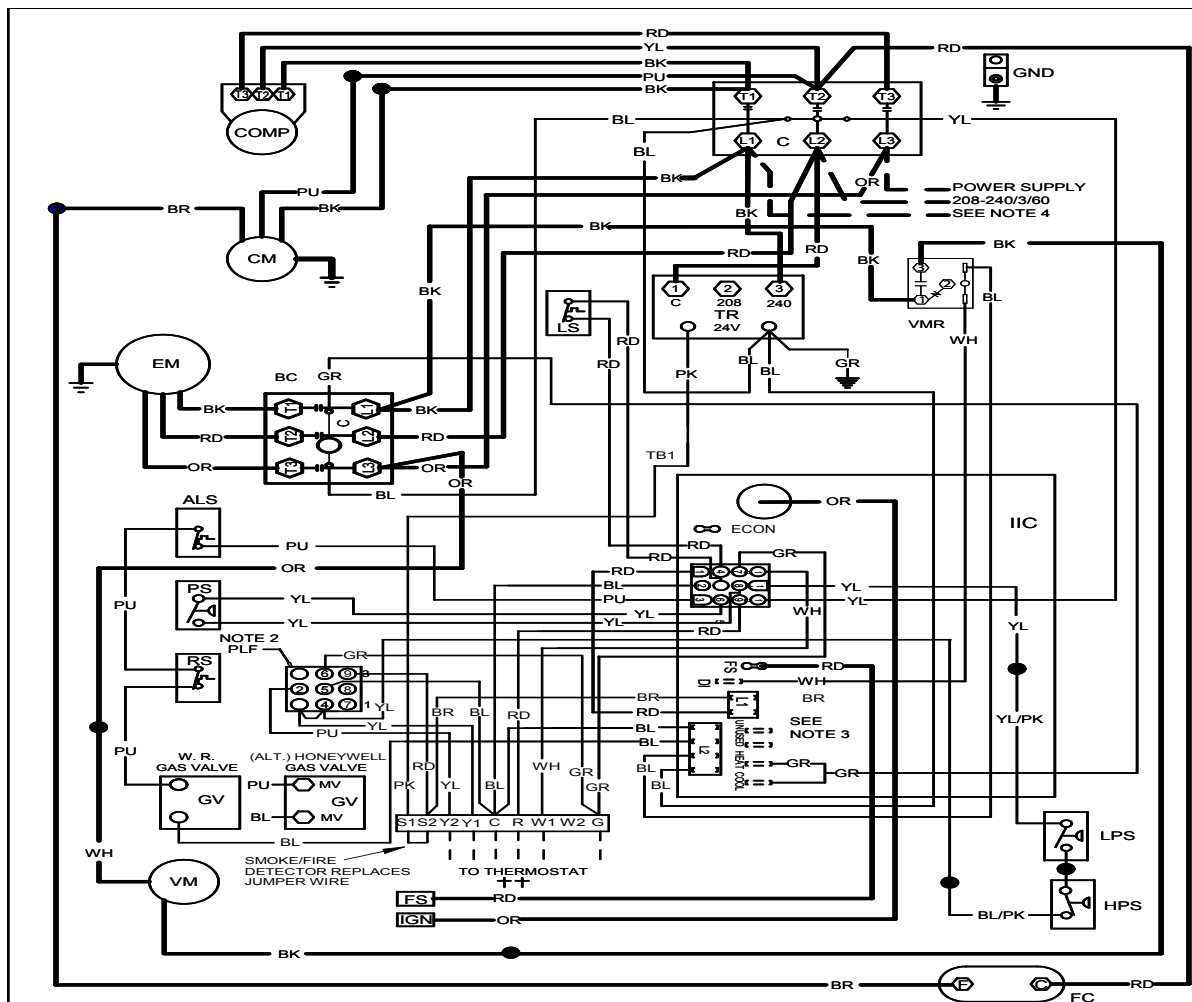

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.


WARNING

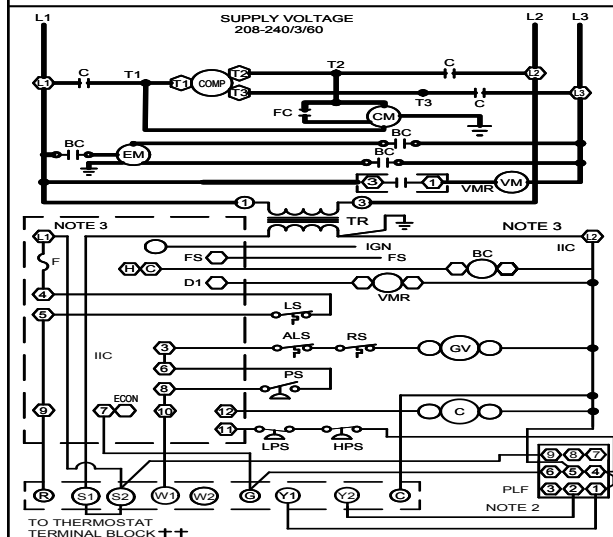

- COMPONENT LEGEND**
- ALS AUXILIARY LIMIT SWITCH
 - BC BLOWER CONTACTOR
 - COMP COMPRESSOR
 - CM CONDENSER MOTOR
 - C CONTACTOR
 - EM EVAPORATOR MOTOR
 - F FUSE
 - FC FAN CAPACITOR
 - FS FLAME SENSOR
 - GV GAS VALVE
 - GND EQUIPMENT GROUND
 - HPS HIGH PRESSURE SWITCH
 - IBR INDOOR BLOWER RELAY
 - IIC INTEGRATED IGNITION CONTROL
 - IGN IGNITOR
 - LPS LOW PRESSURE SWITCH
 - LS LIMIT SWITCH
 - PLF FEMALE PLUG/CONNECTOR
 - PS PRESSURE SWITCH
 - RS ROLLOUT SWITCH
 - TB1 TERMINAL BLOCK (24V SIGNAL)
 - TR TRANSFORMER
 - VM VENT MOTOR
 - VMR VENT MOTOR RELAY

- FACTORY WIRING**
- LINE VOLTAGE
 - - - LOW VOLTAGE
 - · - · - OPTIONAL HIGH VOLTAGE
- FIELD WIRING**
- HIGH VOLTAGE
 - - - LOW VOLTAGE
- WIRE CODE**
- BK BLACK
 - BL BLUE
 - BR BROWN
 - GR GREEN
 - OR ORANGE
 - PK PINK
 - PU PURPLE
 - RD RED
 - WH WHITE
 - YL YELLOW
 - BL/PK BLUE WITH PINK STRIP
 - YL/PK YELLOW WITH PINK STRIP

- NOTES**
- REPLACEMENT WIRE MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (USE COPPER CONDUCTOR ONLY).
 - ACCESSORY ECONOMIZER PLUG ADJACENT TO BLOWER HOUSING IN RETURN AIR COMPARTMENT. REMOVE MALE PLUG AND ATTACH FEMALE PLUG TO THE ECONOMIZER ACCESSORY.
 - L1 AND L2 ON IIC CONTROL IS 24V INPUT.
 - USE COPPER CONDUCTORS ONLY. ++ USE NEC CLASS 2 WIRE.
 - FOR 208 VOLT TRANSFORMER OPERATION, MOVE BLACK WIRE FROM TERMINAL (3) TO TERMINAL (1) ON TRANSFORMER.

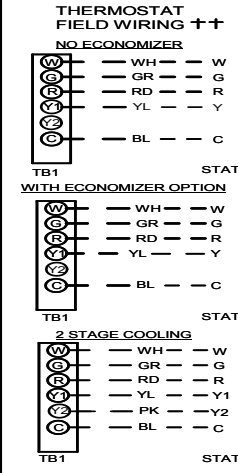

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.




INSTALLER/SERVICEMAN

THE STATUS LIGHT ON THE FURNACE CONTROL MAY BE USED AS A GUIDE TO TROUBLESHOOTING THIS APPLIANCE. STATUS LIGHT CODES ARE AS FOLLOWS:

STATUS LIGHT	EQUIP. STATUS	CHECK
ON	NORMAL OPERATION	-
OFF	NO POWER OR INTERNAL CONTROL	CHECK INPUT POWER CHECK FUSE ON CONTROL REPLACE CONTROL
1 BLINK	IGNITION FAILURE OPEN ROLLOUT SWITCH OPEN AUX. LIMIT SWITCH	GAS FLOW GAS PRESSURE GAS VALVE FLAME SENSOR FLAME ROLLOUT BAD SWITCH AUX. LIMIT OPEN
2 BLINKS	PRESSURE SWITCH OPEN	CHECK PRESSURE SWITCH
3 BLINKS	PRESSURE SWITCH CLOSED WITHOUT INDUCER ON	CHECK PRESSURE SWITCH
4 BLINKS	OPEN LIMIT SWITCH	MAIN LIMIT OPEN BAD SWITCH
5 BLINKS	FALSE FLAME SENSED	STICKING GAS VALVE
6 BLINKS	COMPRESSOR OUTPUT DELAY	3 MIN. COMP ANTI-CYCLE TIMER

SEE UNIT RATING PLATE FOR TYPE AND SIZE OF OVER CURRENT PROTECTION

208-240/3/60 0140L02901-A

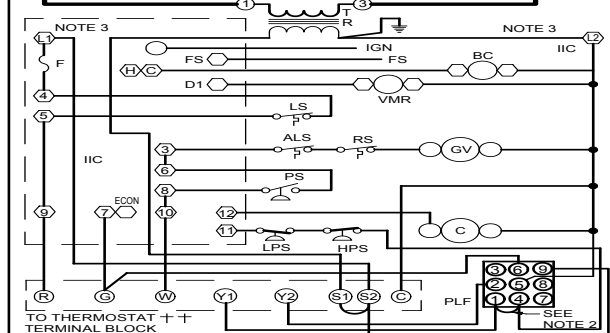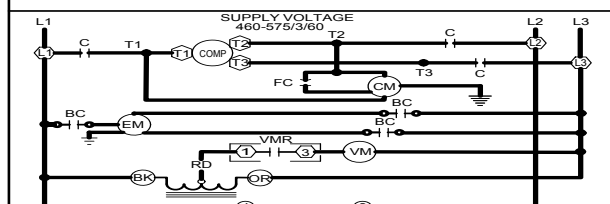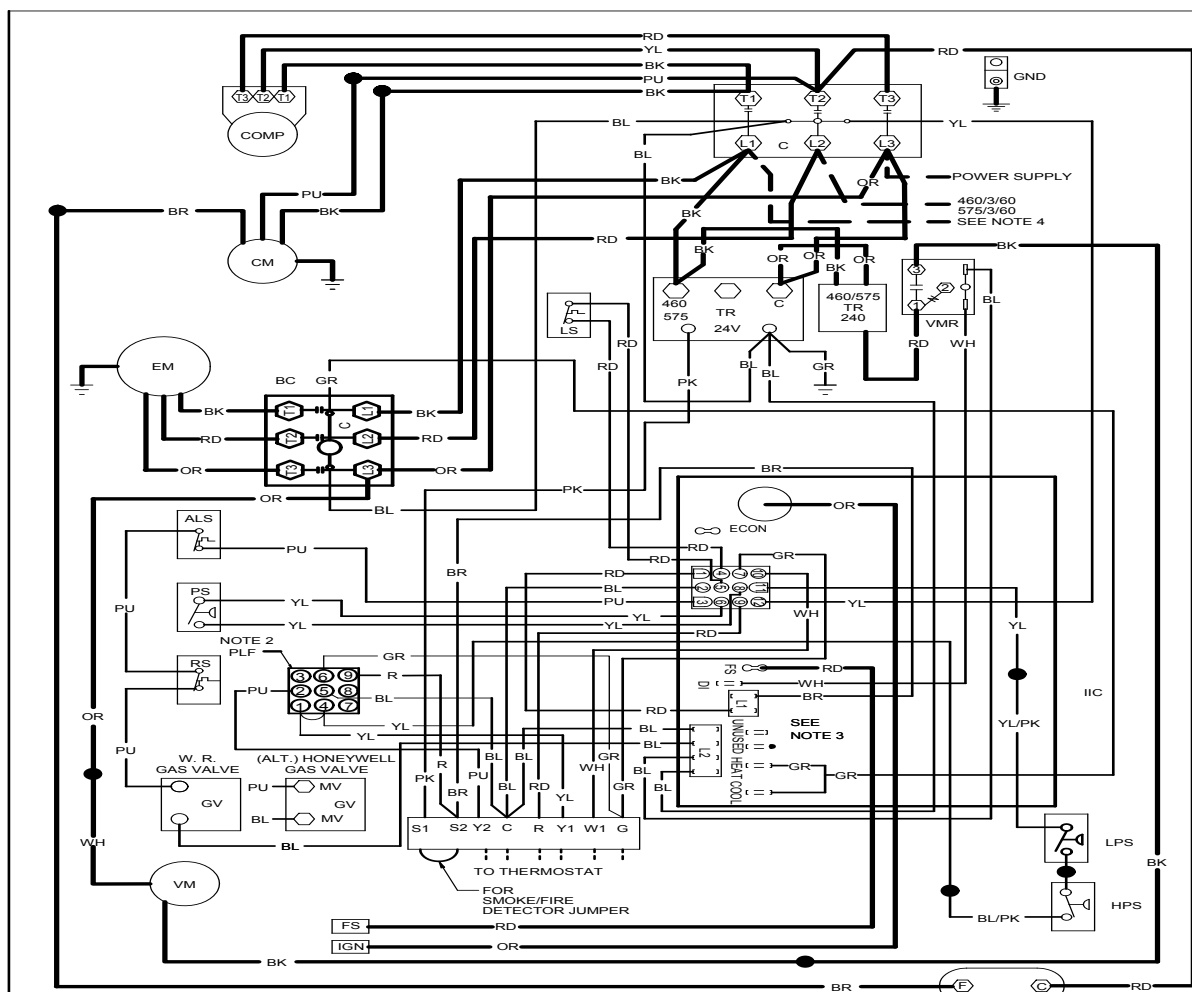

INSTALLER/SERVICEMAN

THE STATUS LIGHT ON THE FURNACE CONTROL MAY BE USED AS A GUIDE TO TROUBLESHOOTING THIS APPLIANCE. STATUS LIGHT CODES ARE AS FOLLOWS:

STATUS LIGHT	EQUIP. STATUS	CHECK
ON	NORMAL OPERATION	
OFF	NO POWER OR INTERNAL CONTROL	CHECK INPUT POWER CHECK FUSE ON CONTROL REPLACE CONTROL
1 BLINK	IGNITION FAILURE OPEN ROLLOUT SWITCH OPEN AUX. LIMIT SWITCH	GAS FLOW GAS PRESSURE GAS VALVE FLAME SENSOR FLAME ROLLOUT BAD SWITCH AUX. LIMIT OPEN
2 BLINKS	PRESSURE SWITCH OPEN	CHECK PRESSURE SWITCH
3 BLINKS	PRESSURE SWITCH CLOSED WITHOUT INDUCER ON	CHECK PRESSURE SWITCH
4 BLINKS	OPEN LIMIT SWITCH	MAIN LIMIT OPEN BAD SWITCH
5 BLINKS	FALSE FLAME SENSED	STICKING GAS VALVE
6 BLINKS	COMPRESSOR OUTSIDE COX	3 MIN. COMP AUX. LIMIT EXPIRED

COMPONENT LEGEND

ALS	AUXILIARY LIMIT SWITCH
BLC	BLOWER CONTACTOR
COMP	COMPRESSOR
CM	CONDENSER MOTOR
CON	CONTACTOR
EM	EVAPORATOR MOTOR
F	FUSE
FC	FAN CAPACITOR
FS	FLAME SENSOR
GND	EQUIPMENT GROUND
GV	GAS VALVE
HPS	HIGH PRESSURE SWITCH
IBR	INDOOR BLOWER RELAY
IIC	INTEGRATED IGNITION CONTROL
IGN	IGNITOR
LPS	LOW PRESSURE SWITCH
LS	LIMIT SWITCH
PLF	FEMALE PLUG/CONNECTOR
PS	PRESSURE SWITCH
RLT	ROLLOFF SWITCH
TB1	TERMINAL BLOCK (24V SIGNAL)
TR	TRANSFORMER
VMR	VENT MOTOR RELAY

NOTES

1. REPLACEMENT WIRE MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL. (USE COPPER CONDUCTOR ONLY).
2. ACCESSORY ECONOMIZER PLUG ADJACENT TO BLOWER HOUSING IN RETURN AIR COMPARTMENT. REMOVE MALE PLUG AND ATTACH FEMALE PLUG TO THE ECONOMIZER ACCESSORY.
3. L1 AND L2 ON IIC CONTROL IS 24V INPUT.
4. USE COPPER CONDUCTORS ONLY.
++ USE NEC CLASS 2 WIRE.

SEE UNIT RATING PLATE FOR TYPE AND
SIZE OF OVER CURRENT PROTECTION.

FACTORY

WIRING

=====	LINE VOLTAGE
=====	LOW VOLTAGE
-----	OPTIONAL HIGH VOLTAGE
-----	FIELD WIRING
-----	HIGH VOLTAGE
-----	LOW VOLTAGE

WIRE CODE

BK BLACK
BL BLUE
BR BROWN
GR GREEN
OR ORANGE
PK PINK
PU PURPLE
RD RED
WH WHITE
YL YELLOW
BL/PK BLUE WITH PINK STRIP
YL/PK YELLOW WITH PINK STRIP

THERMOSTAT FIELD WIRING

FIELD WIRING +

NO ECONOMIZER

(W)	—	WH	—	W
(G)	—	GR	—	G
(R)	—	RD	—	R
(Y1)	—	YL	—	Y
(Y2)				
(C)	—	BL	—	C

TB1	STA
-----	-----

WITH ECONOMIZER OPTION

 — WH — W

$$\begin{array}{c} \text{G} \\ \text{R} \end{array} \begin{array}{c} \text{--- GR --- G} \\ \text{--- RD --- R} \end{array}$$
$$\begin{array}{c} \text{Y1} \\ \text{Y1} \end{array} \quad \text{--- YL --- Y}$$

(Y2)	
------	--

— BL — — C

TB1	STA
-----	-----

2 STAGE COOLING

(W) — WH — W
 (G) — GR — G

$$\begin{array}{c} \text{SR} \\ \text{RD} \end{array} \quad \text{R}$$

Y1 — YL — Y1

Y2 — — PK — — Y2
C — — BL — — C

11

TB1	STA
-----	-----

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury or death.


⚠ WARNING

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.








460-575/3/60 0140L02903-A

SS-DCG3

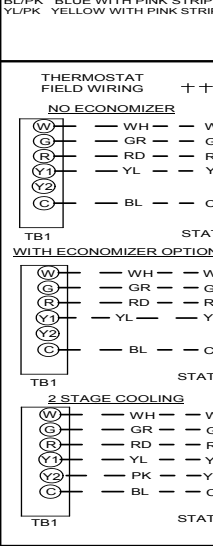



Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring

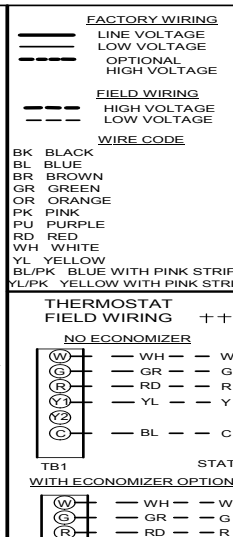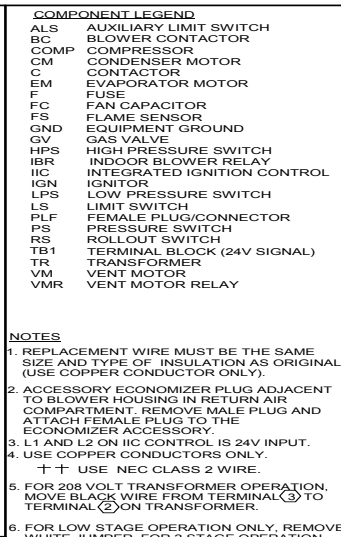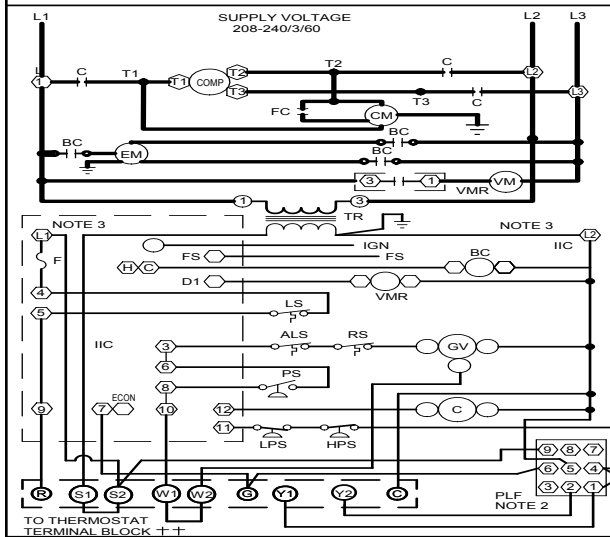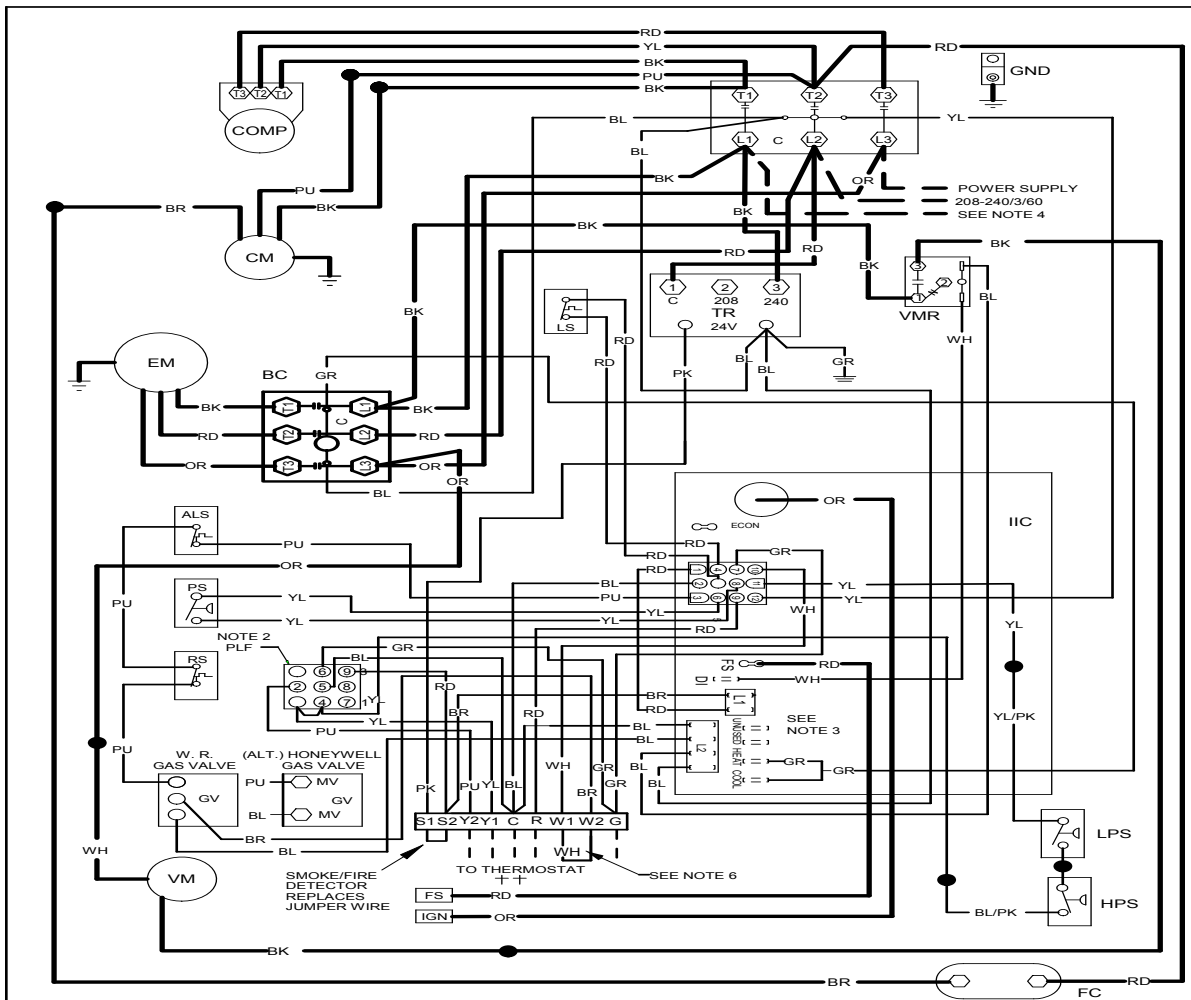

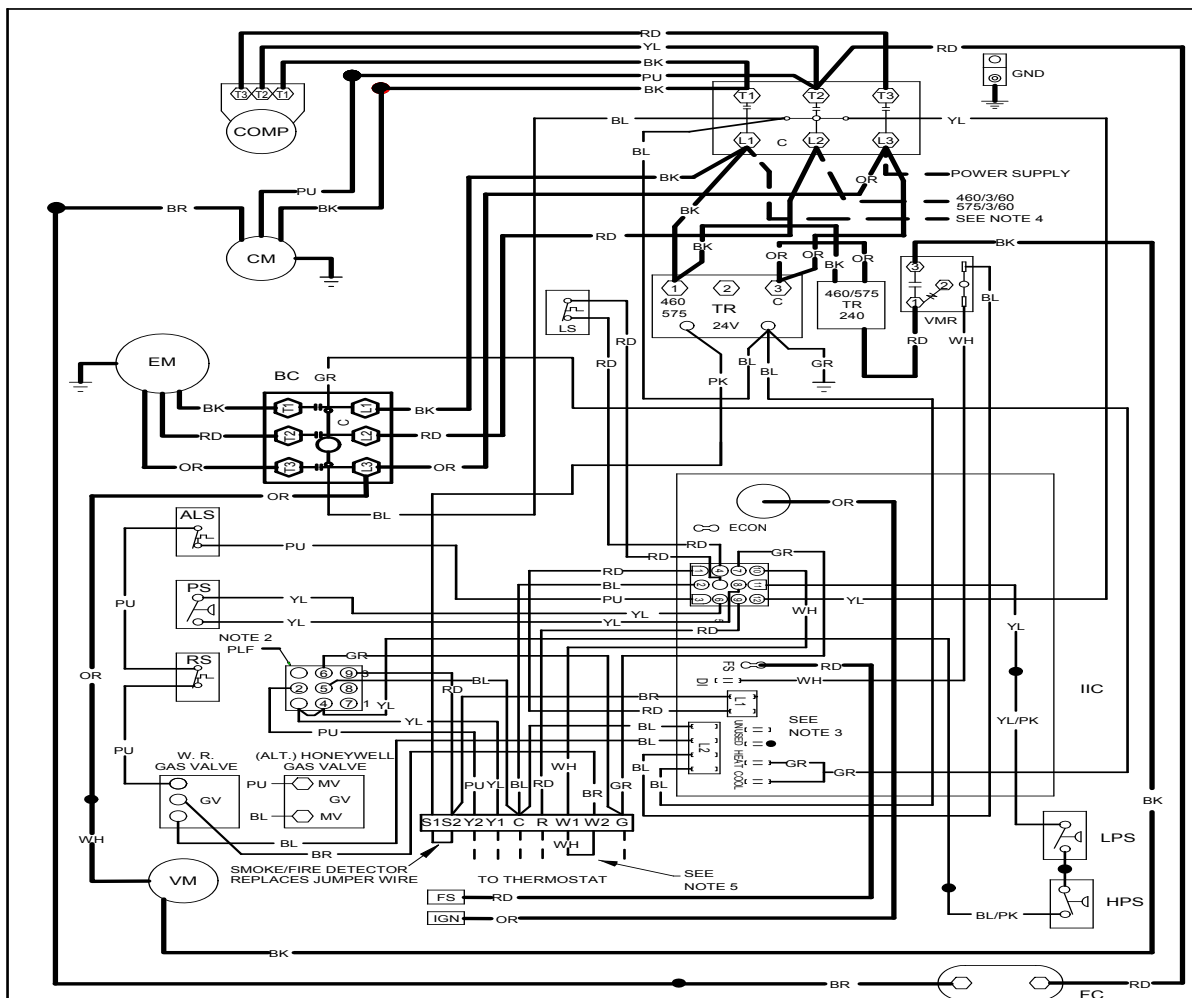

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.


WARNING

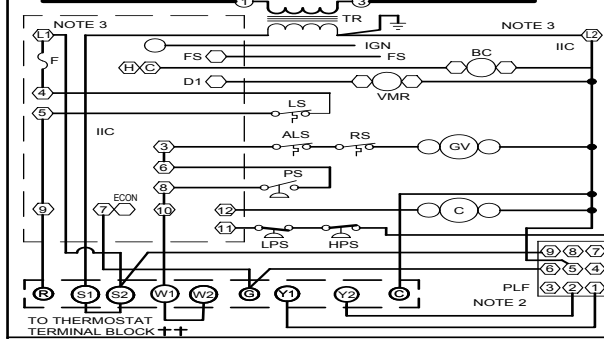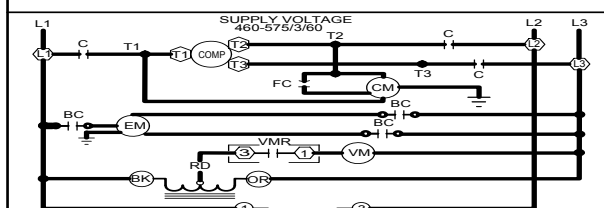

- COMPONENT LEGEND**
- ALS AUXILIARY LIMIT SWITCH
 - BC BLOWER CONTACTOR
 - COMP COMPRESSOR
 - CM CONDENSER MOTOR
 - C CONTACTOR
 - EM EVAPORATOR MOTOR
 - F FAN
 - FC FAN CAPACITOR
 - FS FLAME SENSOR
 - GND EQUIPMENT GROUND
 - GV GAS VALVE
 - HPS HIGH PRESSURE SWITCH
 - IBR INDOOR BLOWER RELAY
 - IIC INTEGRATED IGNITION CONTROL
 - IGN IGNITOR
 - LPS LOW PRESSURE SWITCH
 - LS LIMIT SWITCH
 - PLF FEMALE PLUG/CONNECTOR
 - PS PRESSURE SWITCH
 - RS ROLLOUT SWITCH
 - TB1 TERMINAL BLOCK (24V SIGNAL)
 - TR TRANSFORMER
 - VM VENT MOTOR
 - VMR VENT MOTOR RELAY

- NOTES**
- REPLACEMENT WIRE MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (USE COPPER CONDUCTOR ONLY).
 - ACCESSORY ECONOMIZER PLUG ADJACENT TO BLOWER HOUSING IN RETURN AIR COMPARTMENT. REMOVE MALE PLUG AND ATTACH FEMALE PLUG TO THE ECONOMIZER ACCESSORY.
 - L1 AND L2 ON IIC CONTROL IS 24V INPUT.
 - USE COPPER CONDUCTORS ONLY. ++ USE NEC CLASS 2 WIRE.
 - FOR LOW STAGE OPERATION ONLY, REMOVE WHITE JUMPER. FOR 2 STAGE OPERATION, REMOVE JUMPER AND CONNECT W2 TO W2 ON THERMOSTAT.

- FACTORY WIRING**
- LINE VOLTAGE
 - LOW VOLTAGE
 - OPTIONAL HIGH VOLTAGE
- FIELD WIRING**
- HIGH VOLTAGE
 - LOW VOLTAGE
- WIRE CODE**
- BK BLACK
 - BL BLUE
 - BR BROWN
 - GR GREEN
 - OR ORANGE
 - PK PINK
 - PU PURPLE
 - RD RED
 - WH WHITE
 - YL YELLOW
 - BL/PK BLUE WITH PINK STRIP
 - YL/PK YELLOW WITH PINK STRIP






INSTALLER/SERVICEMAN

THE STATUS LIGHT ON THE FURNACE CONTROL MAY BE USED AS A GUIDE TO TROUBLESHOOTING THIS APPLIANCE. STATUS LIGHT CODES ARE AS FOLLOWS:

STATUS LIGHT	EQUIP. STATUS	CHECK
ON	NORMAL OPERATION	-
OFF	NO POWER OR INTERNAL CONTROL	CHECK INPUT POWER CHECK FUSE ON CONTROL REPLACE CONTROL
1 BLINK	IGNITION FAILURE OPEN ROLLOUT SWITCH OPEN AUX. LIMIT SWITCH	GAS FLOW GAS PRESSURE GAS VALVE FLAME SENSOR FLAME ROLLOUT BAD SWITCH AUX. LIMIT OPEN
2 BLINKS	PRESSURE SWITCH OPEN	CHECK PRESSURE SWITCH
3 BLINKS	PRESSURE SWITCH CLOSED WITHOUT INDUCER ON	CHECK PRESSURE SWITCH
4 BLINKS	OPEN LIMIT SWITCH	MAIN LIMIT OPEN
5 BLINKS	FALSE FLAME	BAD SWITCH
6 BLINKS	3 MIN. COMP. OUTPUT DELAY	STICKING GAS VALVE 3 MIN. COMP. ANTI-CYCLE TIMER

SEE UNIT RATING PLATE FOR TYPE AND SIZE OF OVER CURRENT PROTECTION.

460-575/3/60 0140L02895-A

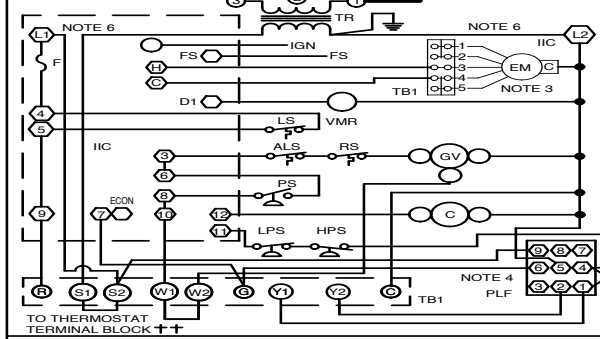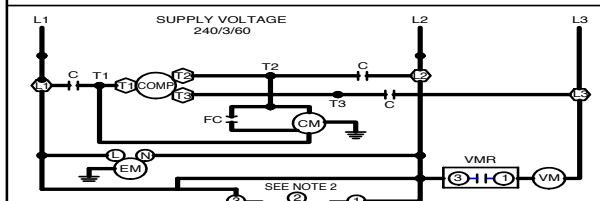
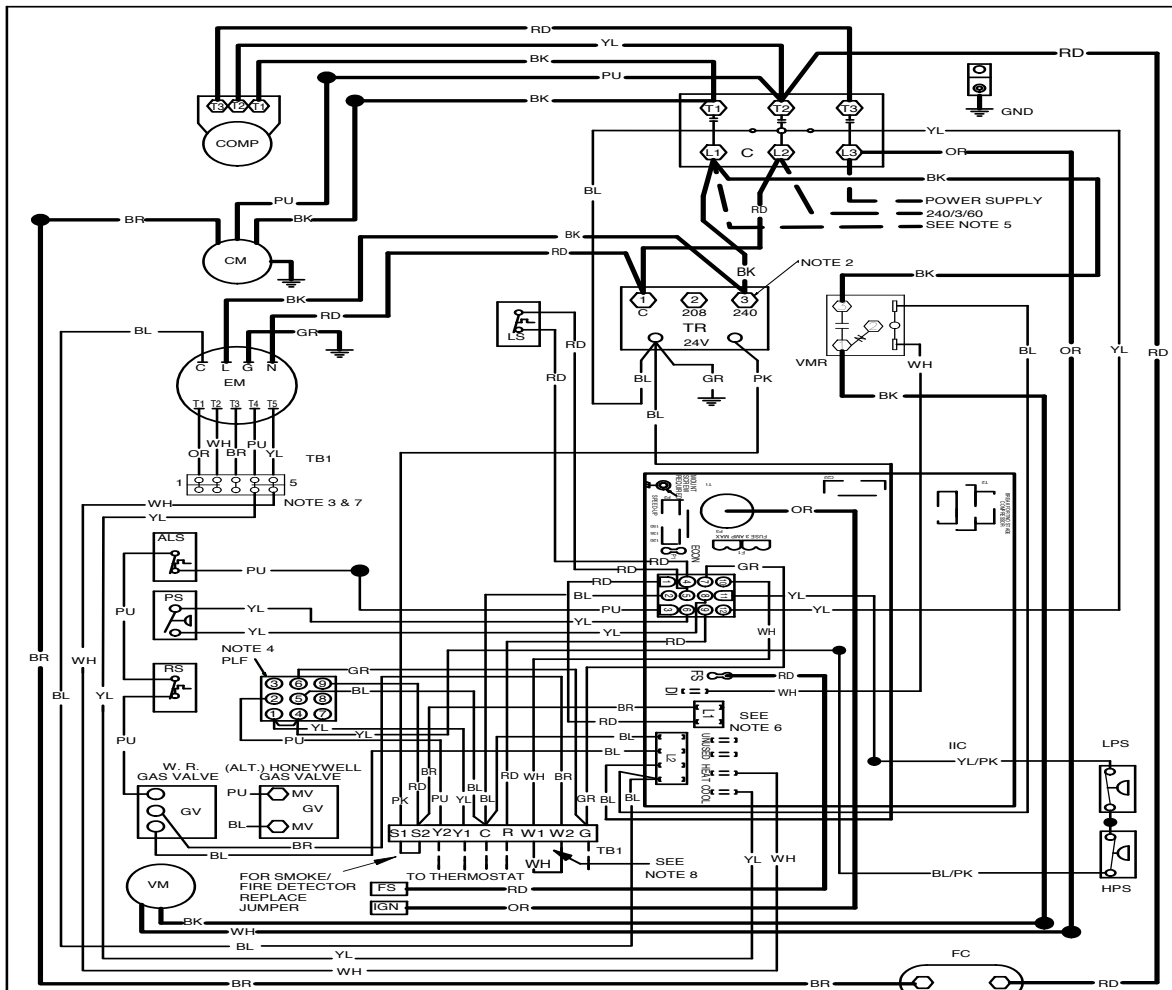


INSTALLER/SERVICEMAN

THE STATUS LIGHT ON THE FURNACE CONTROL MAY BE USED AS A GUIDE TO TROUBLESHOOTING THIS APPLIANCE. STATUS LIGHT CODES ARE AS FOLLOWS:

STATUS LIGHT	EQUIP. STATUS	CHECK
ON	NORMAL OPERATION	
OFF	NO POWER OR INTERNAL CONTROL FAULT	CHECK INPUT POWER CHECK FUSE ON CONTROL REPLACE CONTROL
1 BLINK	IGNITION FAILURE OR OPEN ROLLOUT SWITCH	CHECK GAS FLOW GAS PRESSURE GAS VALVE FLAME SENSOR FLAME ROLLOUT BAD SWITCH AUX. LIMIT OPEN
2 BLINKS	PRESSURE SWITCH OPEN	CHECK PRESSURE SWITCH
3 BLINKS	PRESSURE SWITCH CLOSED WITHOUT INDICER ON	CHECK PRESSURE SWITCH
4 BLINKS	OPEN LIMIT SWITCH	MAIN LIMIT OPEN
5 BLINKS	FALSE FLAME SENSED	BAD SWITCH
6 BLINKS	COMPRESSOR OUTPUT DELAY	STICKING GAS VALVE 3 MIN. COMP. ANTI-CYCLE TIMER

- COMPONENT LEGEND**
- ALS: AUXILIARY LIMIT SWITCH
 - COMP: COMPRESSOR
 - CM: CONDENSER MOTOR
 - C: CONTACTOR
 - EM: EVAPORATOR MOTOR
 - FC: FUSE
 - FC: FAN CAPACITOR
 - FS: FLAME SENSOR
 - GND: EQUIPMENT GROUND
 - GV: GAS VALVE
 - HPS: HIGH PRESSURE SWITCH
 - IIC: INTEGRATED IGNITION CONTROL
 - IGN: IGNITOR
 - LS: LIMIT SWITCH
 - LPS: LOW PRESSURE SWITCH
 - PLF: FEMALE PLUG/CONNECTOR
 - PS: PRESSURE SWITCH
 - RS: ROLLOUT SWITCH
 - TB1: TERMINAL BLOCK (24V SIGNAL)
 - TR: TRANSFORMER
 - VM: VENT MOTOR
 - VMR: VENT MOTOR RELAY
- NOTES**
- REPLACEMENT WIRE MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL. (USE COPPER CONDUCTOR ONLY).
 - FOR 208 VOLT TRANSFORMER OPERATION MOVE BLACK WIRES FROM TERMINAL ① TO TERMINAL ② ON TRANSFORMER.
 - FOR DIFFERENT THAN FACTORY SPEED TAP, CHANGE COOLING SPEED AT MOTOR T3 AND T4 TERMINALS. CHANGE HEATING SPEED AT MOTOR T1, T2, AND T5 TERMINALS.
 - ACCESSORY ECONOMIZER PLUG ADJACENT TO BLOWER HOUSING IN RETURN AIR COMPARTMENT. REMOVE MALE PLUG AND ATTACH FEMALE PLUG TO ECONOMIZER ACCESSORY.
 - USE COPPER CONDUCTORS ONLY.
 - L1 AND L2 ON ICC CONTROL IS 24V INPUT.
 - SPEED TAP TERMINATIONS SHOWN ON DIAGRAM ARE REPRESENTATIVE, BUT ACTUAL FACTORY SETTINGS MAY BE DIFFERENT BASED ON THE HEATING VALUE OF THE UNIT.
 - FOR LOW STAGE OPERATION ONLY, REMOVE WHITE JUMPER. FOR 2 STAGE OPERATION, REMOVE JUMPER AND CONNECT W2 TO W2 ON THERMOSTAT.

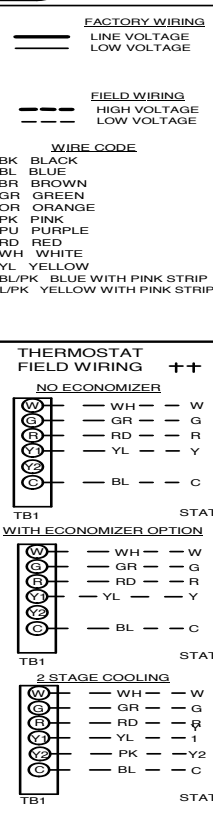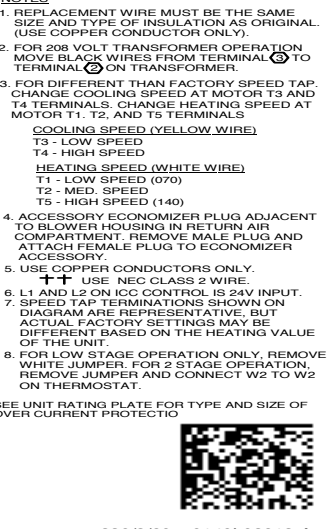


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

WARNING

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.



0140L04969-A

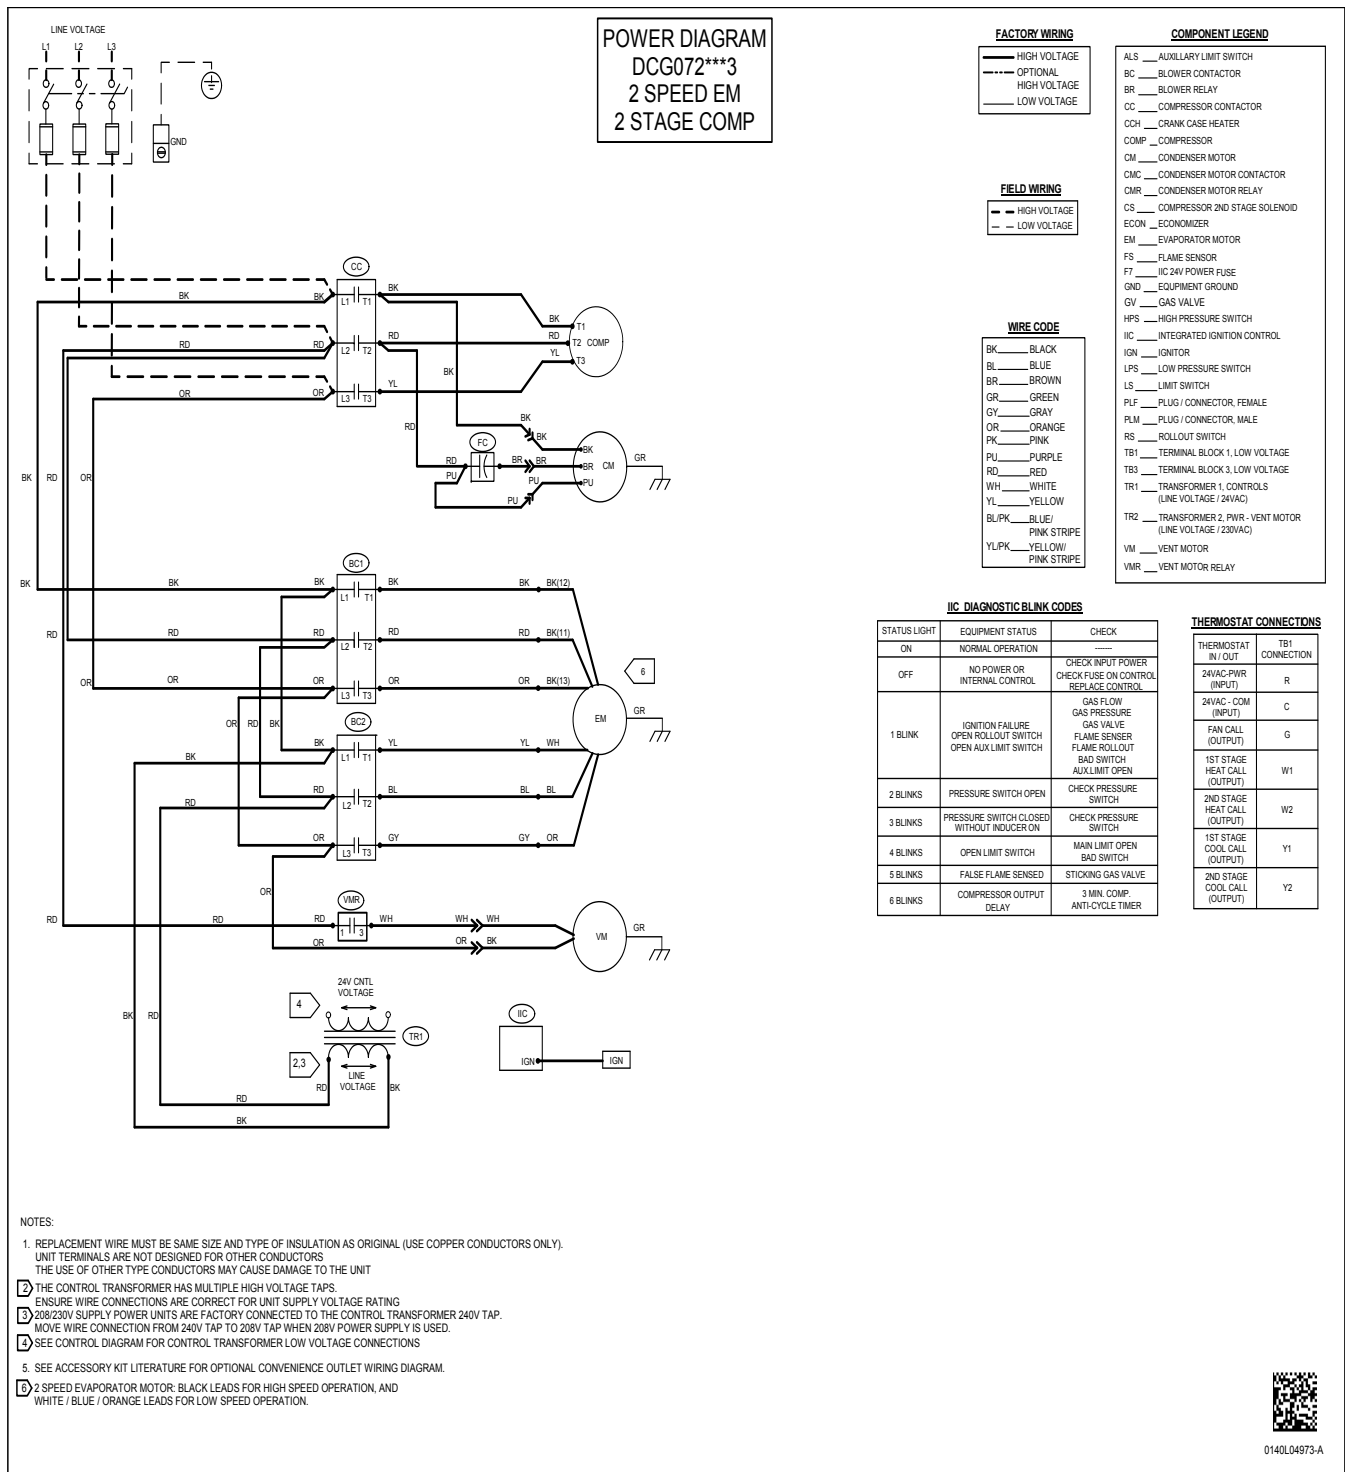


Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.



WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



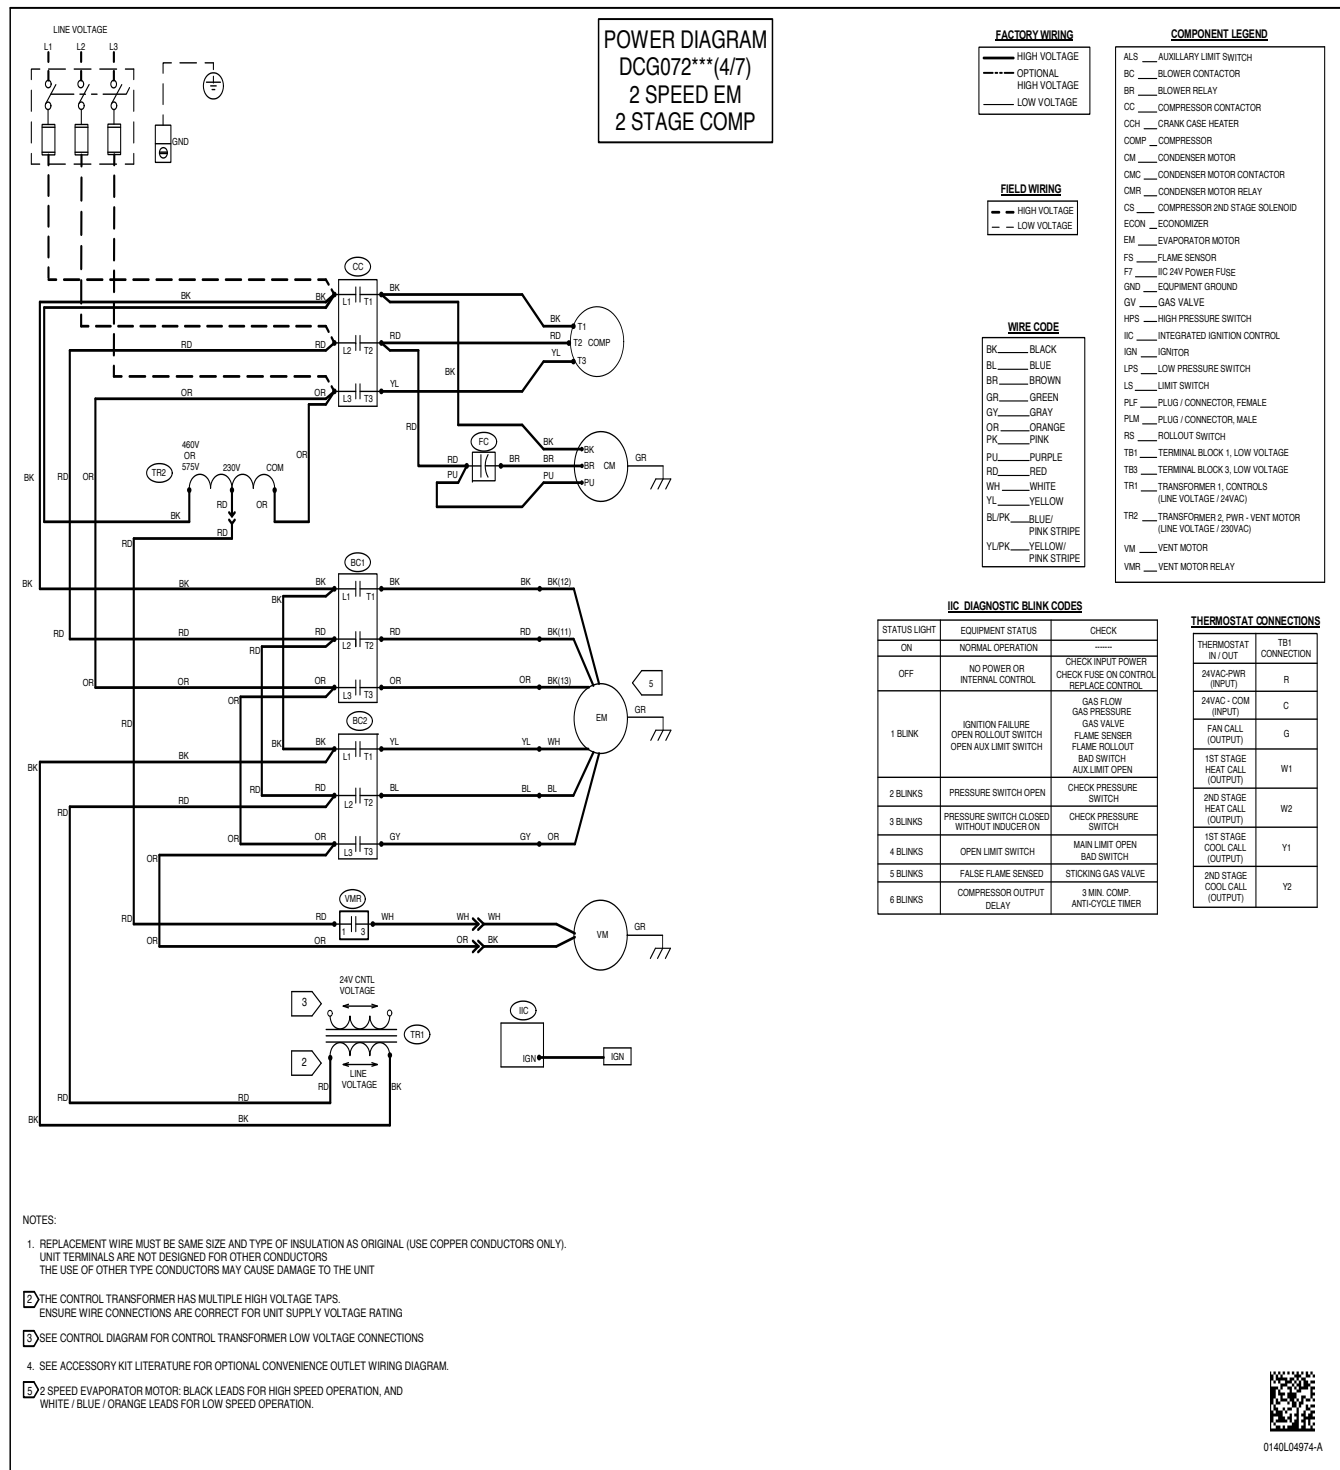

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WARNING


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



0140L04974-A

WIRING DIAGRAMS FOR MODELS WITH DDC CONTROLS

FOR COMPLETE INFORMATION AND INSTALLATION INSTRUCTIONS FOR MODELS
WITH DDC CONTROLS, SEE MANUAL DK-DDC-TGD-XXX

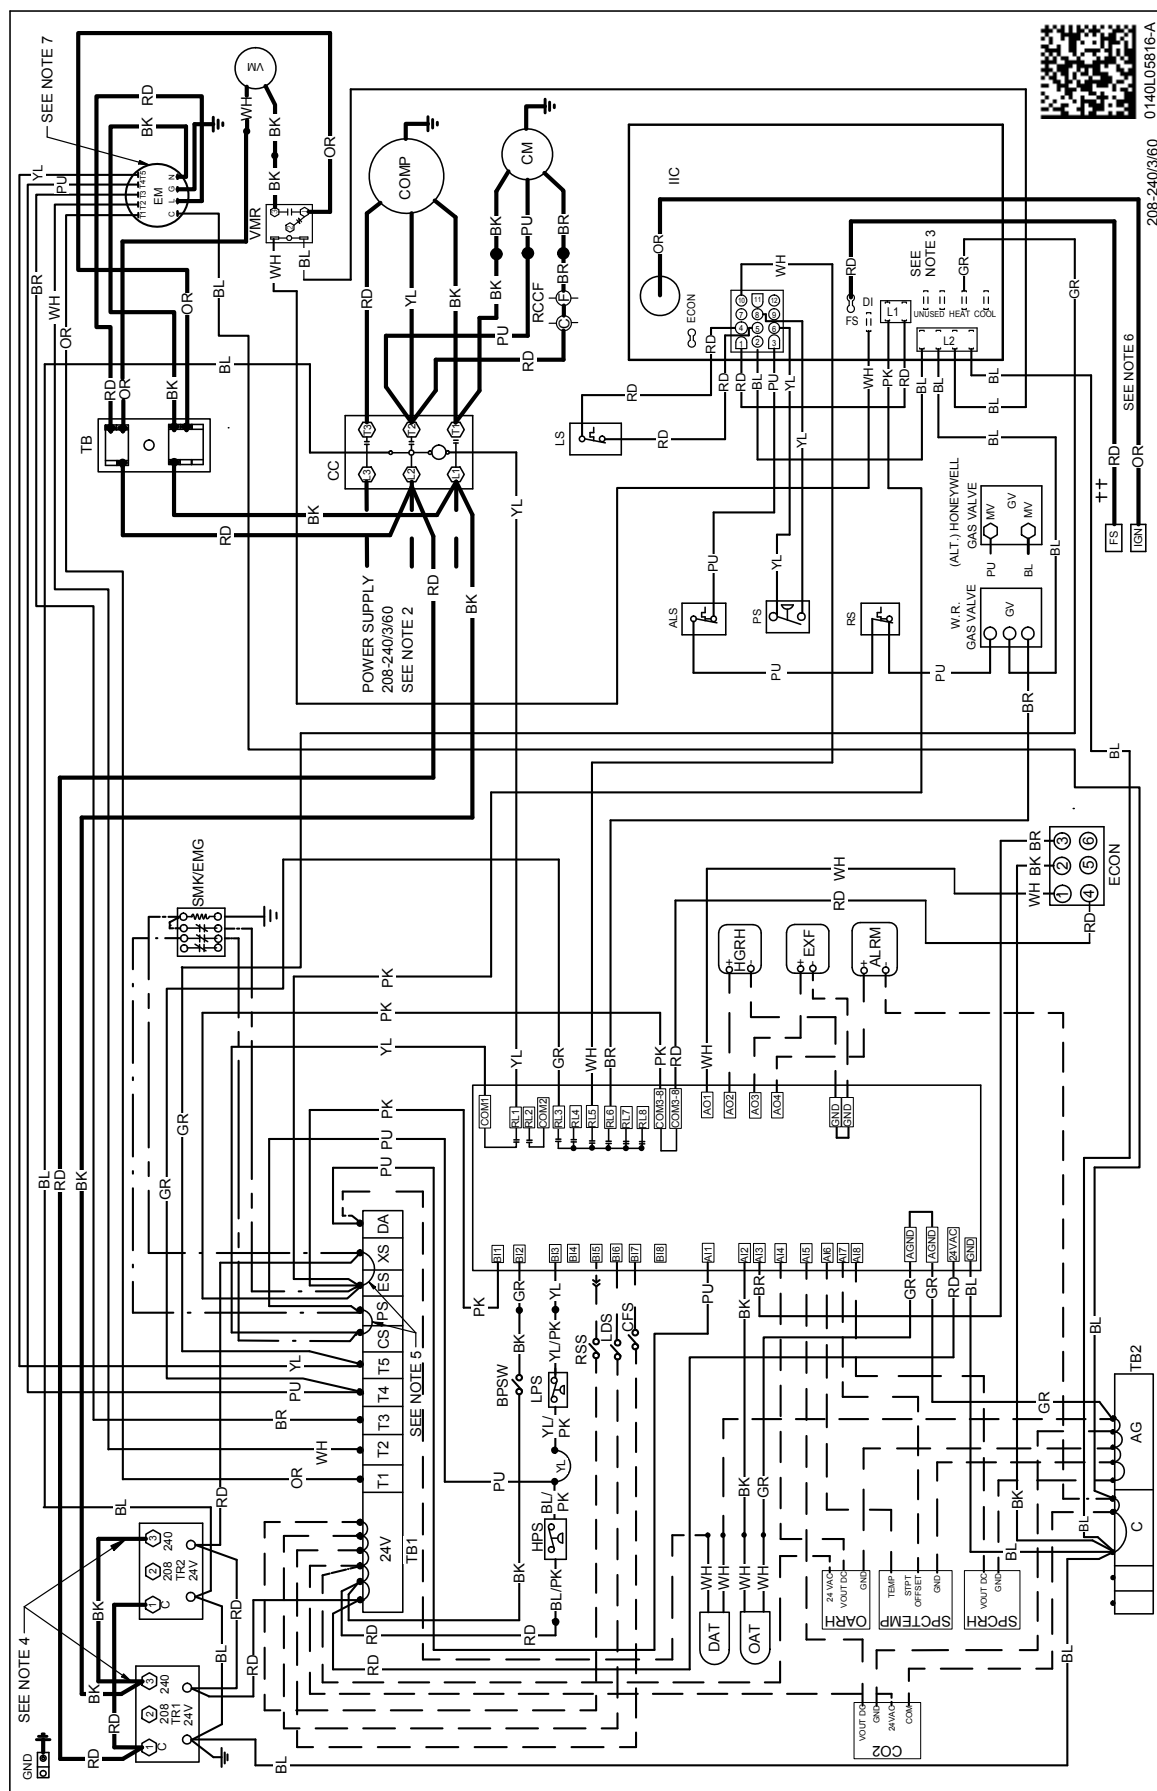


Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.



WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

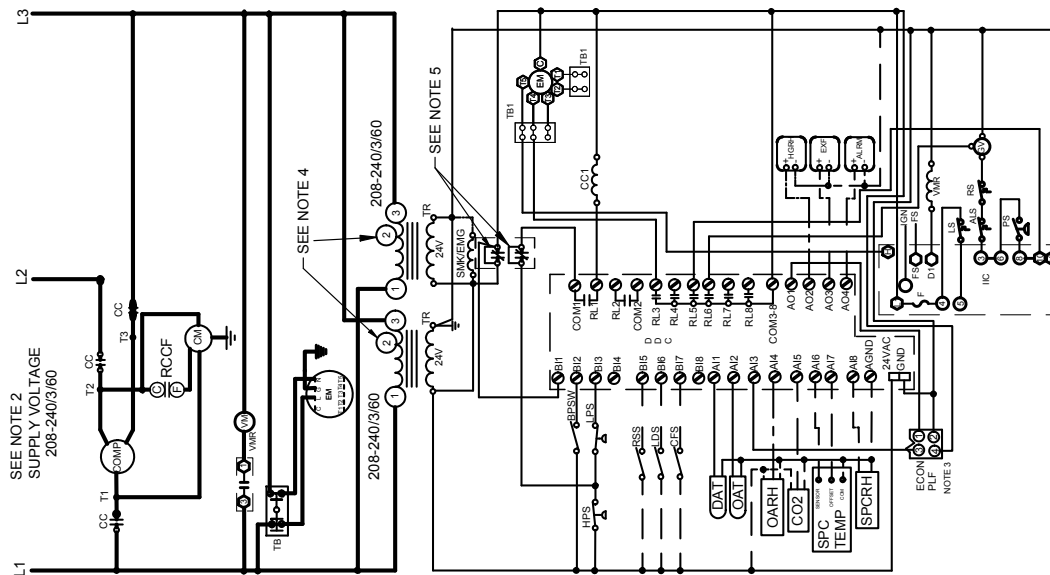


COMPONENT LEGEND	COMPONENT LEGEND
AGND AO AI ALARM BI BLS BPSW CCR CFS CH CHS CM COM COMP CS DFT ECON GV	DC GROUND FOR ANALOG SENSORS ("AG" ON TB2) 4 ANALOG OUTPUTS 8 ANALOG INPUTS 8 BINARY INPUTS BLOWER LOW SPEED BLOWER PROVING SWITCH COMPRESSOR CONTACTOR CLOGGED FILTER SWITCH CRANKCASE HEATER CRANKCASE HEATER SWITCH CONDENSER MOTOR COMMON ("C" ON TB2) COMPRESSOR COM1 AND SMOKE DETECTOR DEFROST THERMOSTAT ECONOMIZER GAS VALVE
EM ES EXF HGRH HPS LDS OAT OARH PLF PS RCFC RL RSS RVC SAT/DAT SMK/EMG SPCTEMP SPCRHP T1-T5 TB1-2 TR1-2 XS	EVAPORATOR MOTOR ECON COM3-8 BIT AND SMOKE DETECTOR EXHAUST FAN HOT GAS REHEAT HIGH PRESSURE SWITCH LOAD SHEDDING LOW PRESSURE SWITCH OUTDOOR AIR TEMPERATURE OUTDOOR AIR RELATIVE HUMIDITY FEMALE PLUG / CONNECTOR HPS, LPS & SMOKE DETECTOR RUN CAPACITOR FOR CONDENSER FAN RELAY REMOTE START STOP REVERSING VALVE COIL SUPPLY / DISCHARGE AIR TEMPERATURE SMOKE OR EMERGENCY SHUTDOWN SPACE TEMPERATURE SPACE RELATIVE HUMIDITY MOTOR SPEED TAPS 1-8 (DIRECT DRIVEN MOTOR ONLY) TERMINAL BLOCK (24V SIGNAL) TRANSFORMER 24 VAC TRANSFORMER & SMOKE DETECTOR

COMPONENT LEGEND	COMPONENT LEGEND
AGND AO AI ALARM BI BLS BPSW CCR CFS CH CHS CM COM COMP CS DFT ECON GV	DC GROUND FOR ANALOG SENSORS ("AG" ON TB2) 4 ANALOG OUTPUTS 8 ANALOG INPUTS 8 BINARY INPUTS BLOWER LOW SPEED BLOWER PROVING SWITCH COMPRESSOR CONTACTOR CLOGGED FILTER SWITCH CRANKCASE HEATER CRANKCASE HEATER SWITCH CONDENSER MOTOR COMMON ("C" ON TB2) COMPRESSOR COM1 AND SMOKE DETECTOR DEFROST THERMOSTAT ECONOMIZER GAS VALVE

⚠ WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

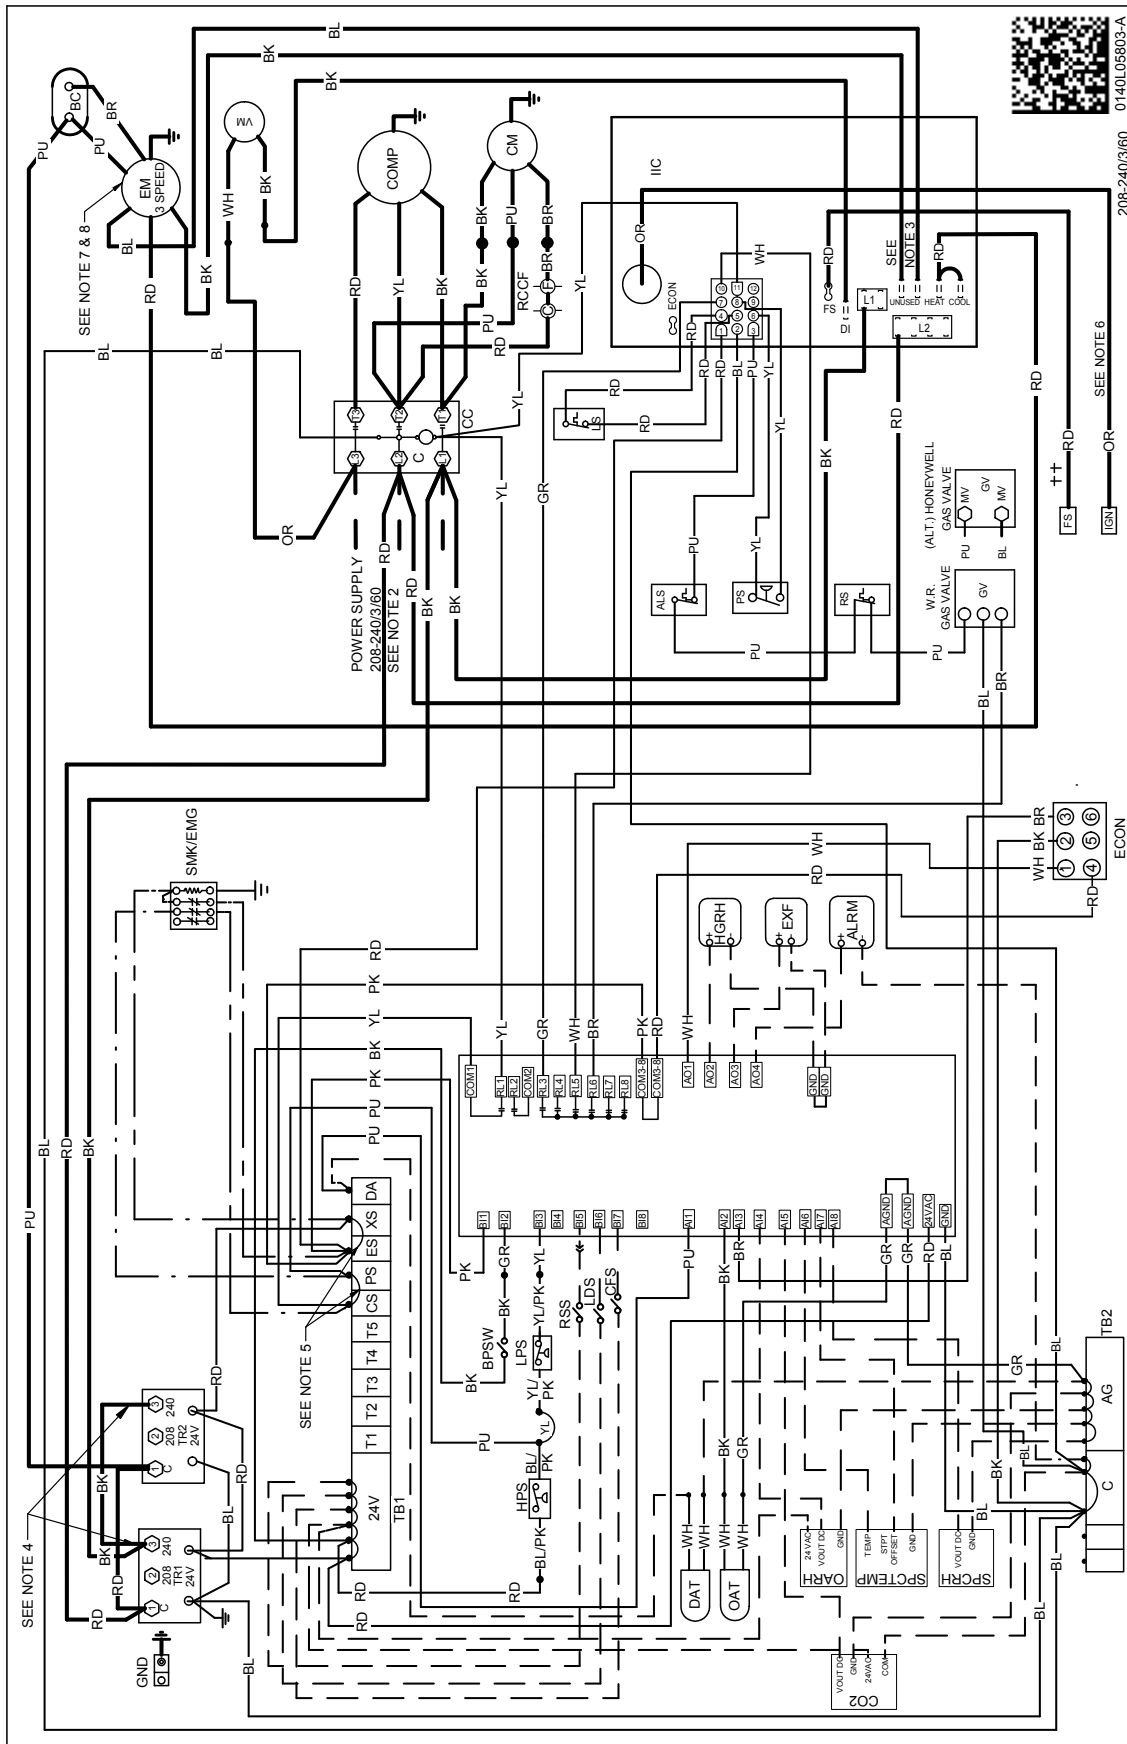


Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.



WARNING


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

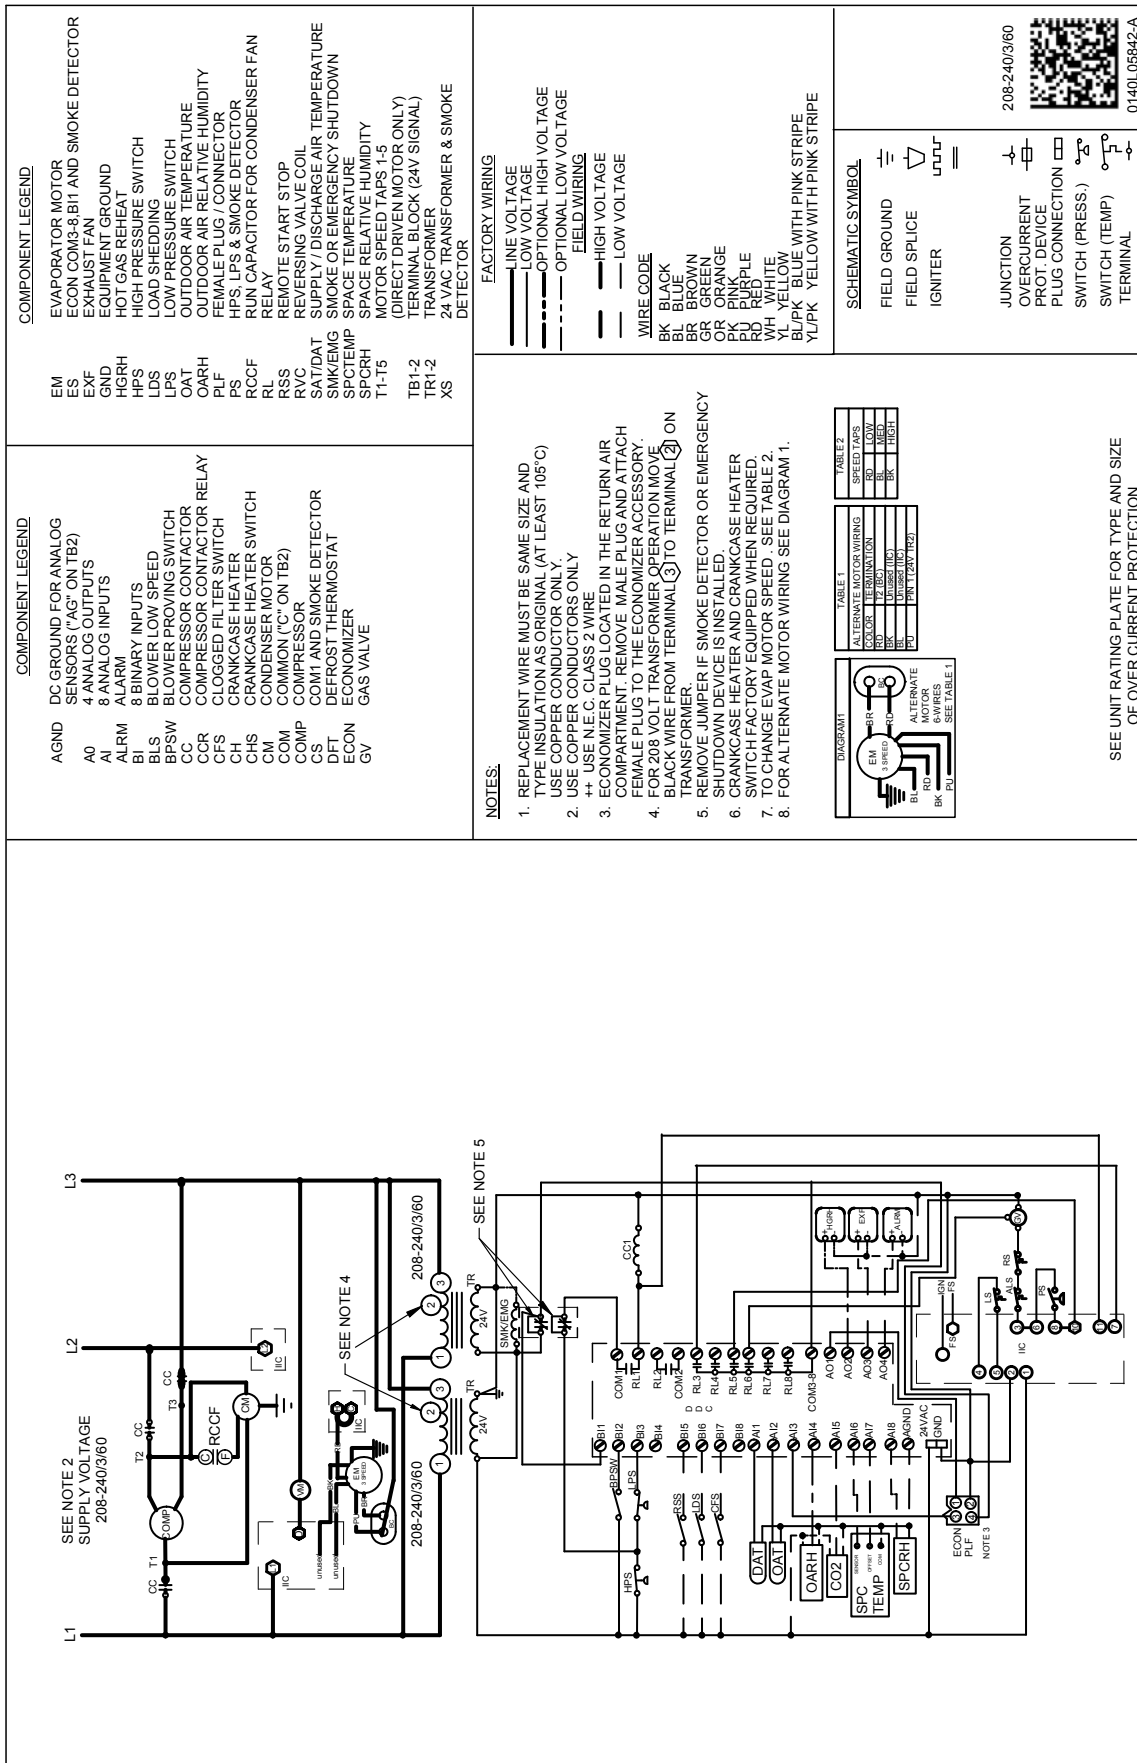

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WARNING


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

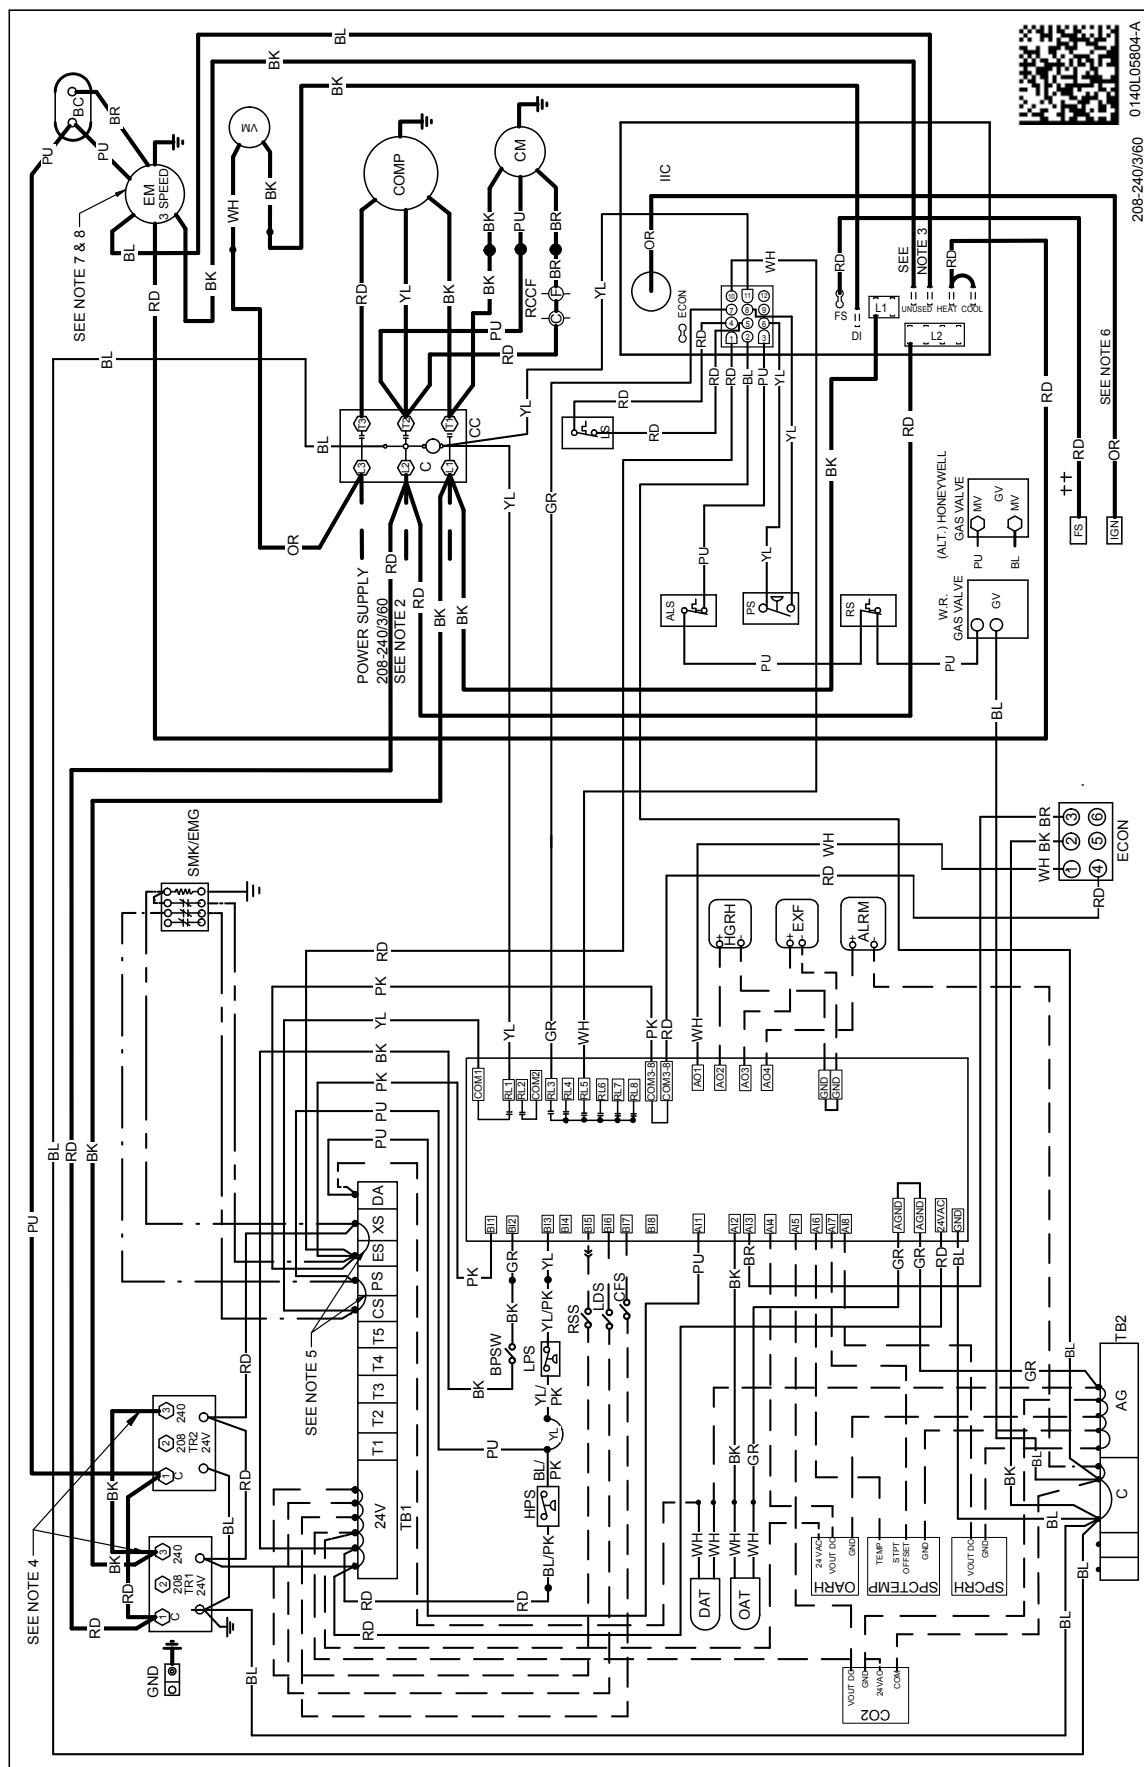

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

⚠ WARNING


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

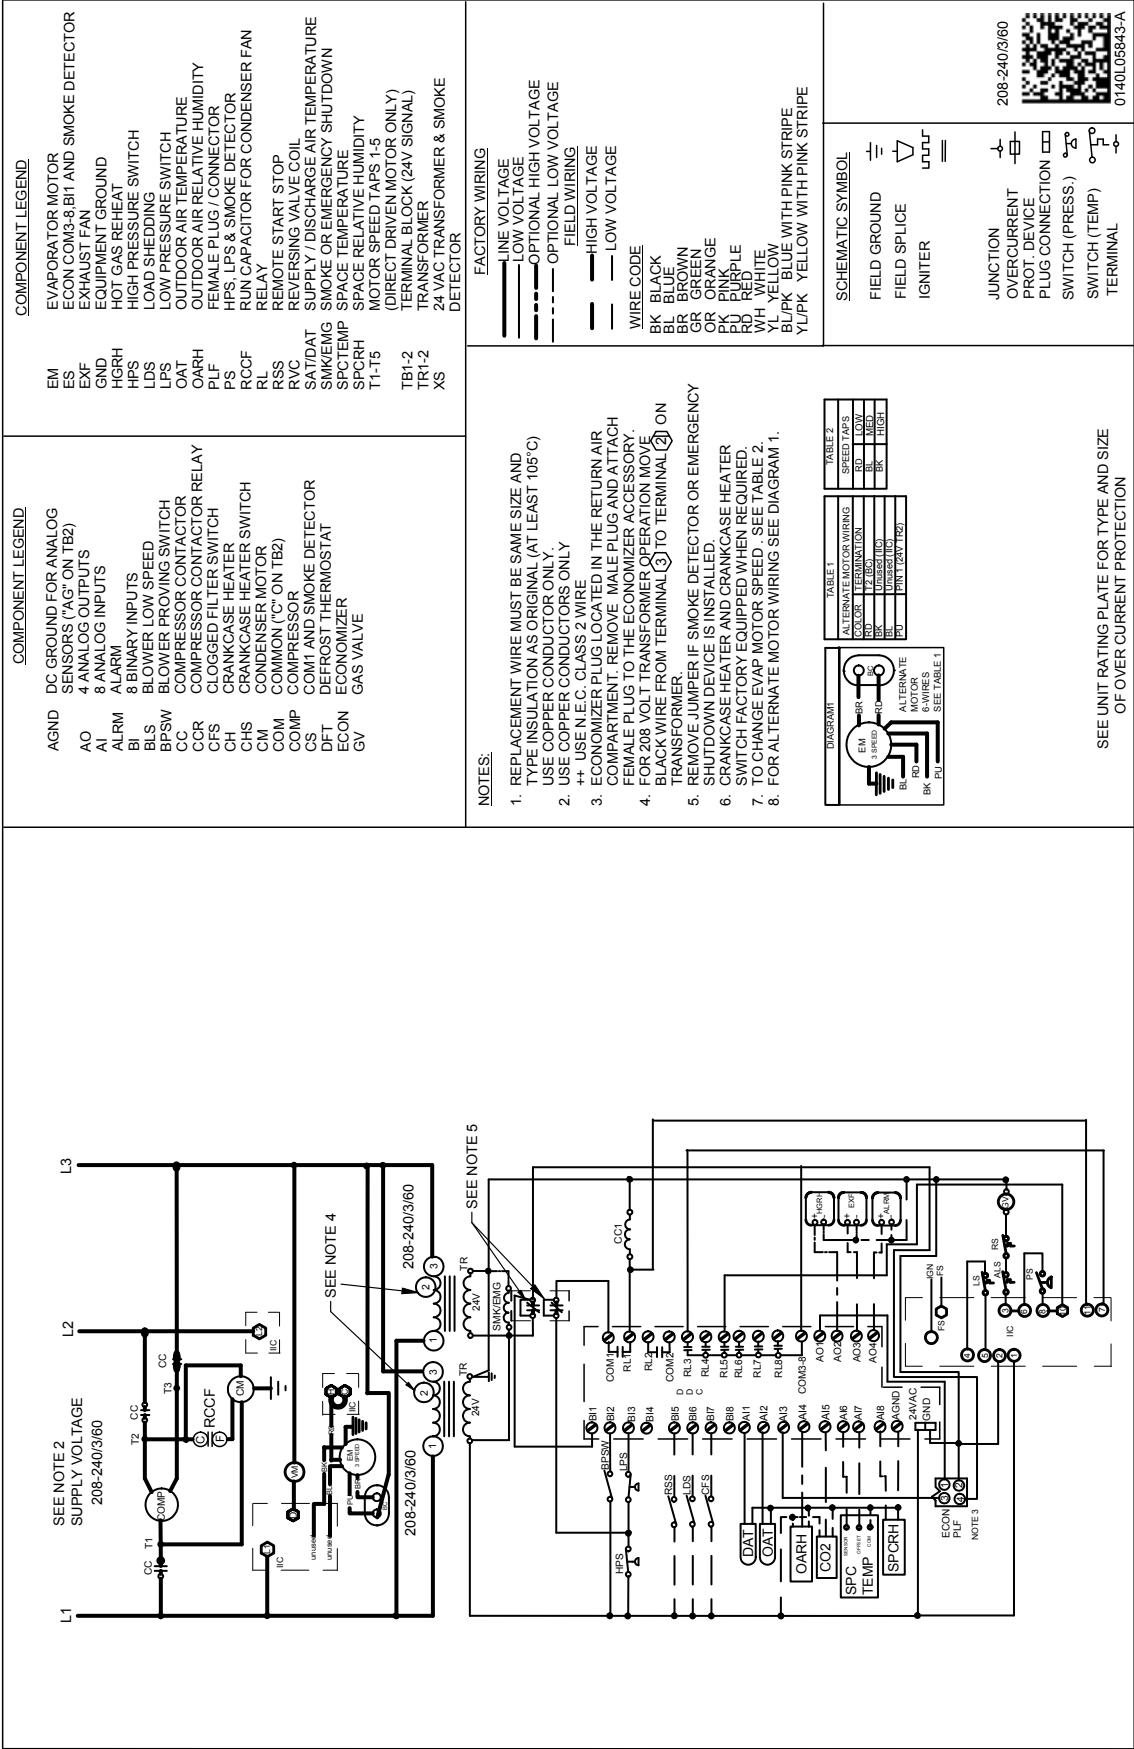

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WARNING


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

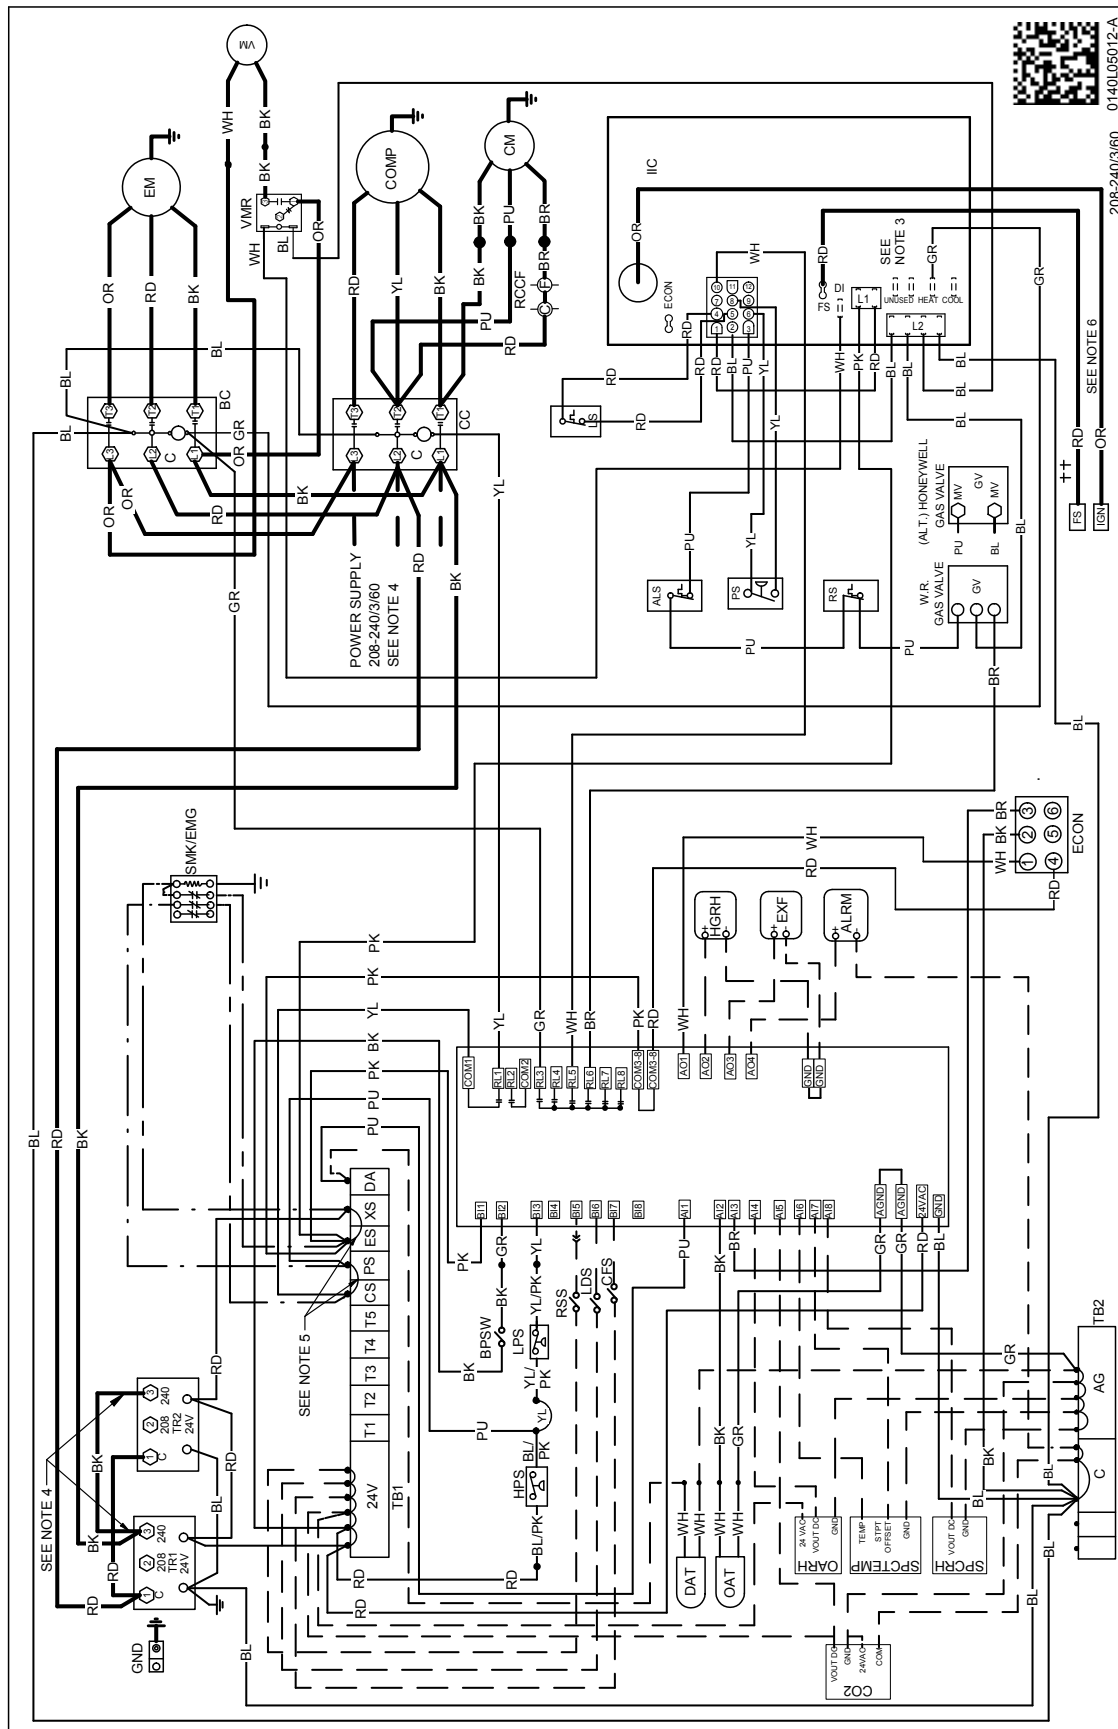

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.




High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

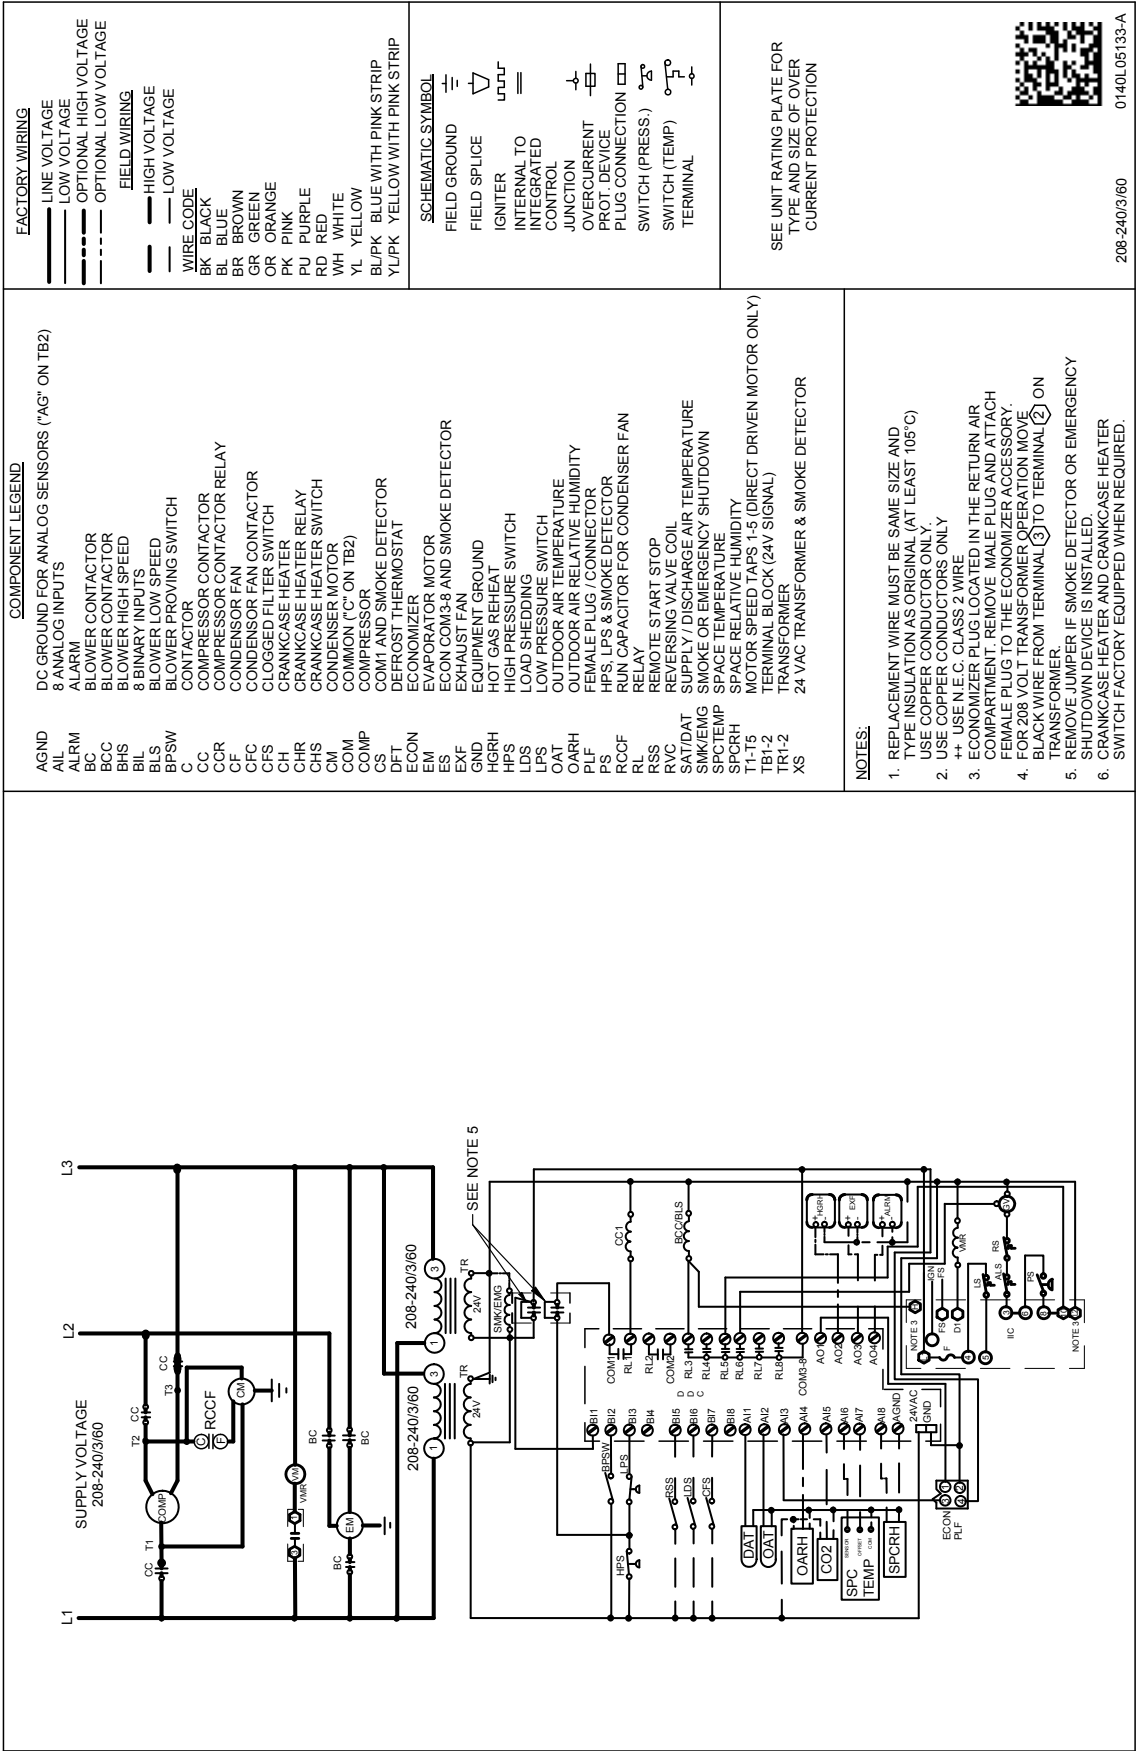

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WARNING


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

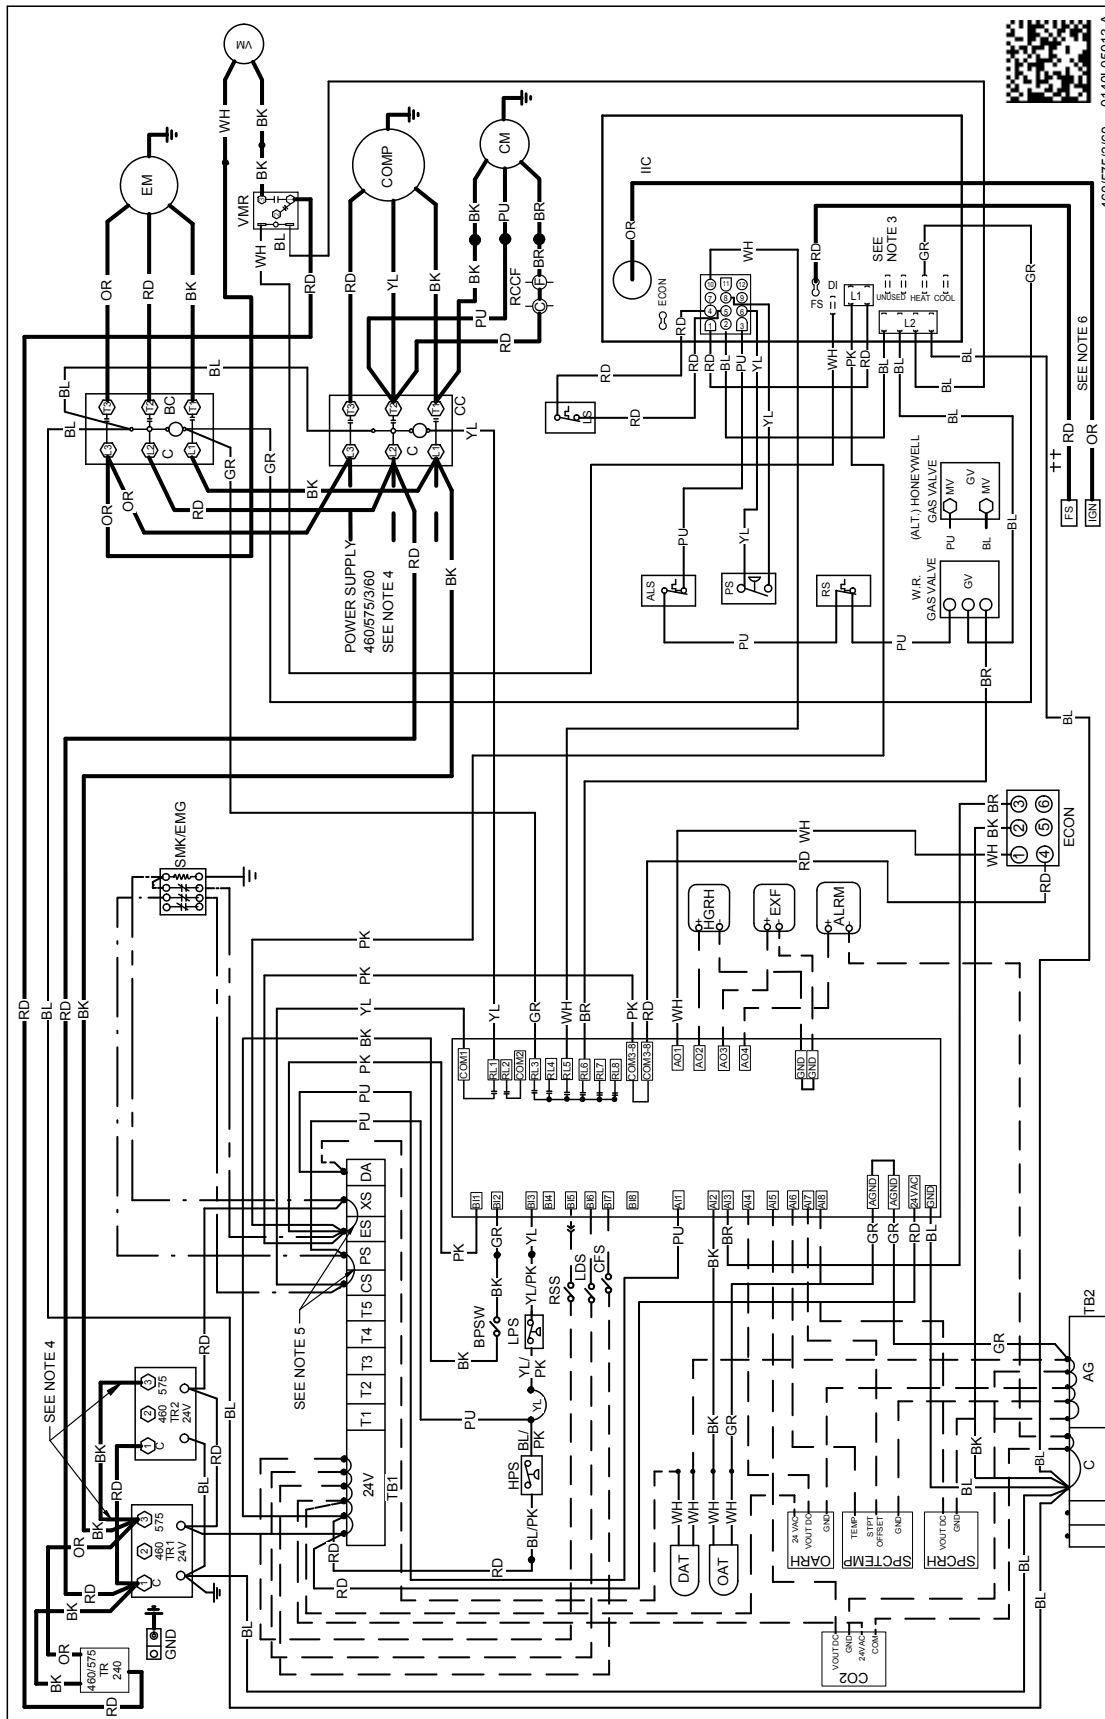

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.




High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

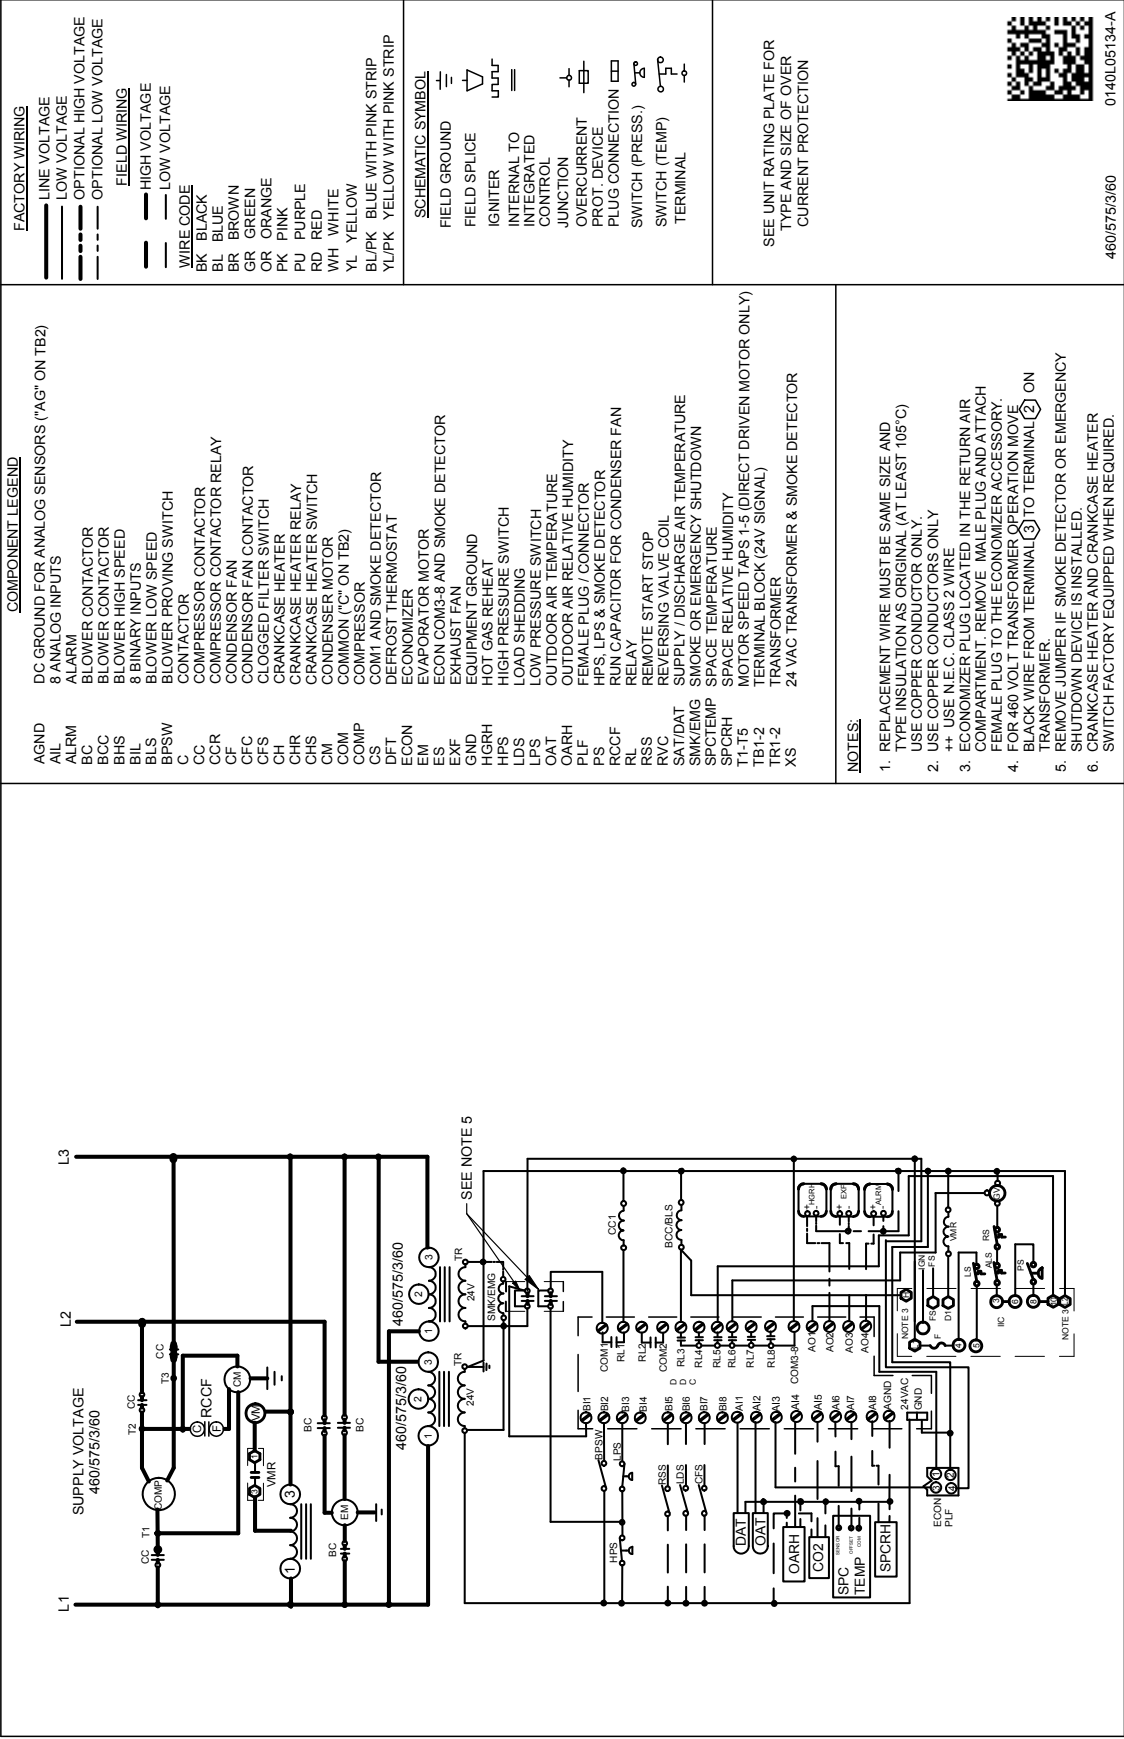

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

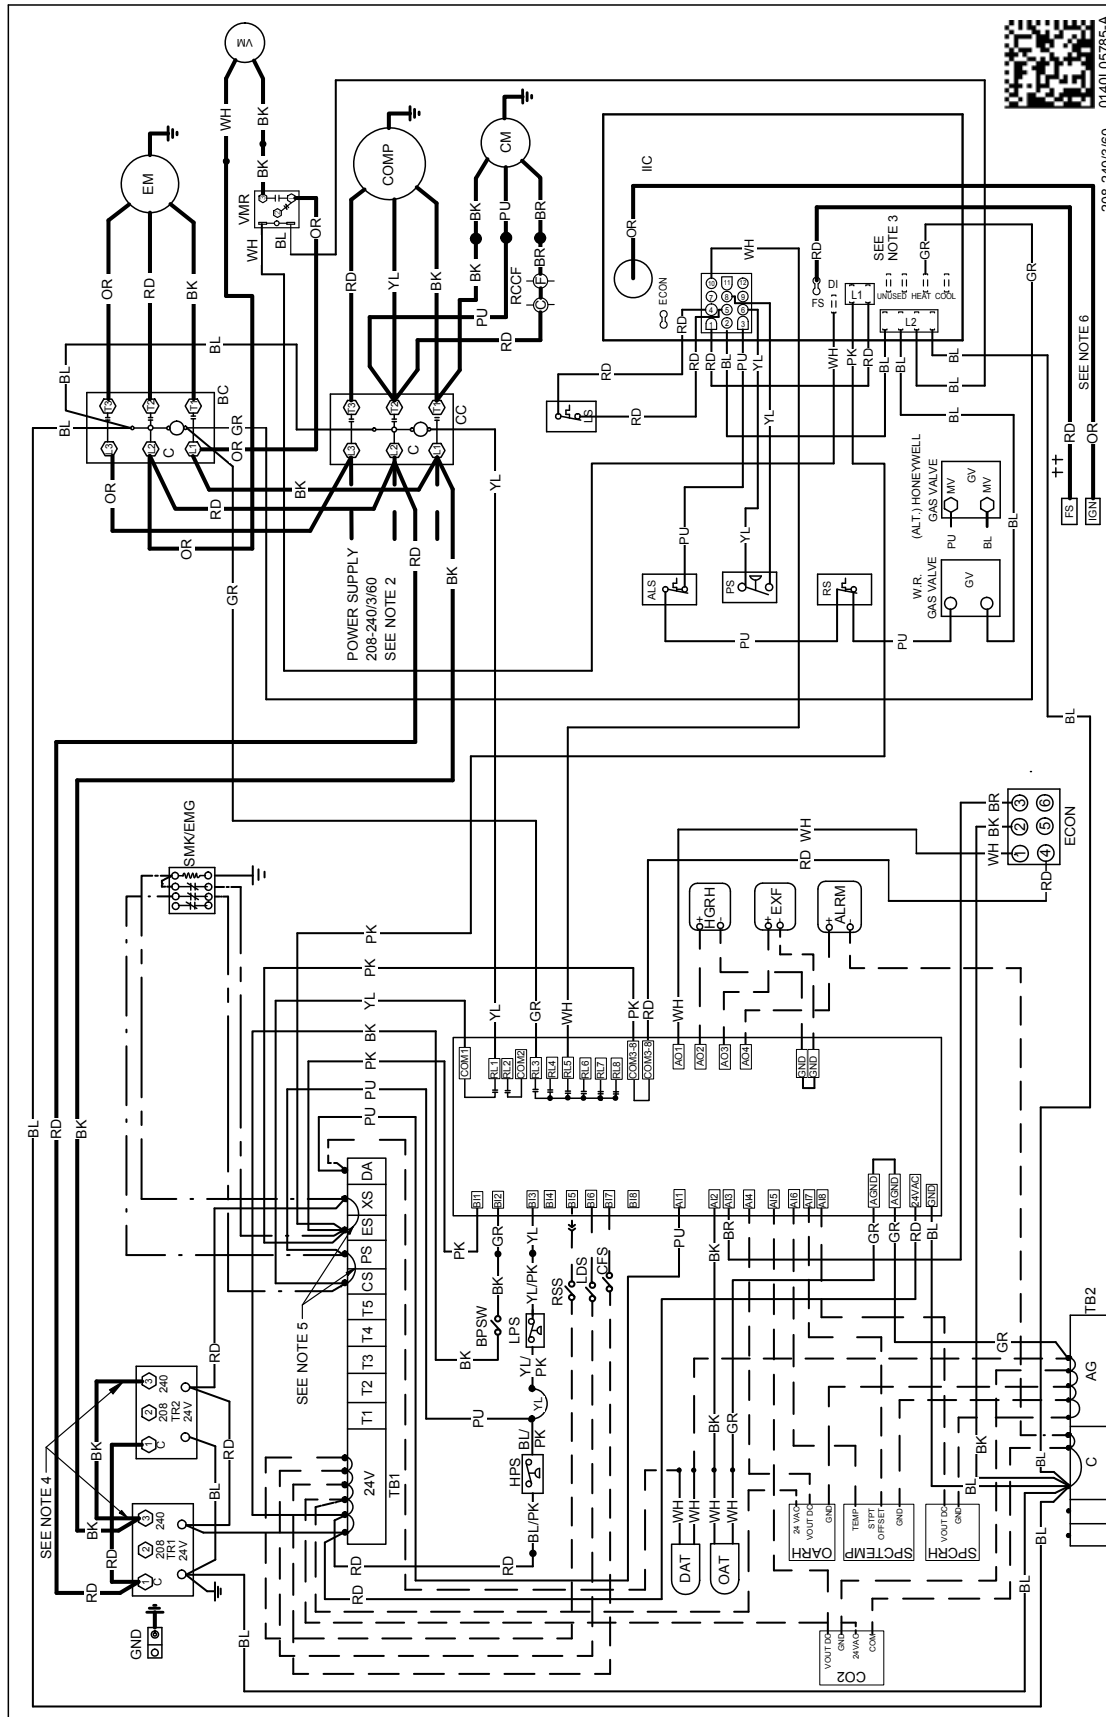

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.




High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



SS-DCG3

SS-DCG3

SS-DCG3

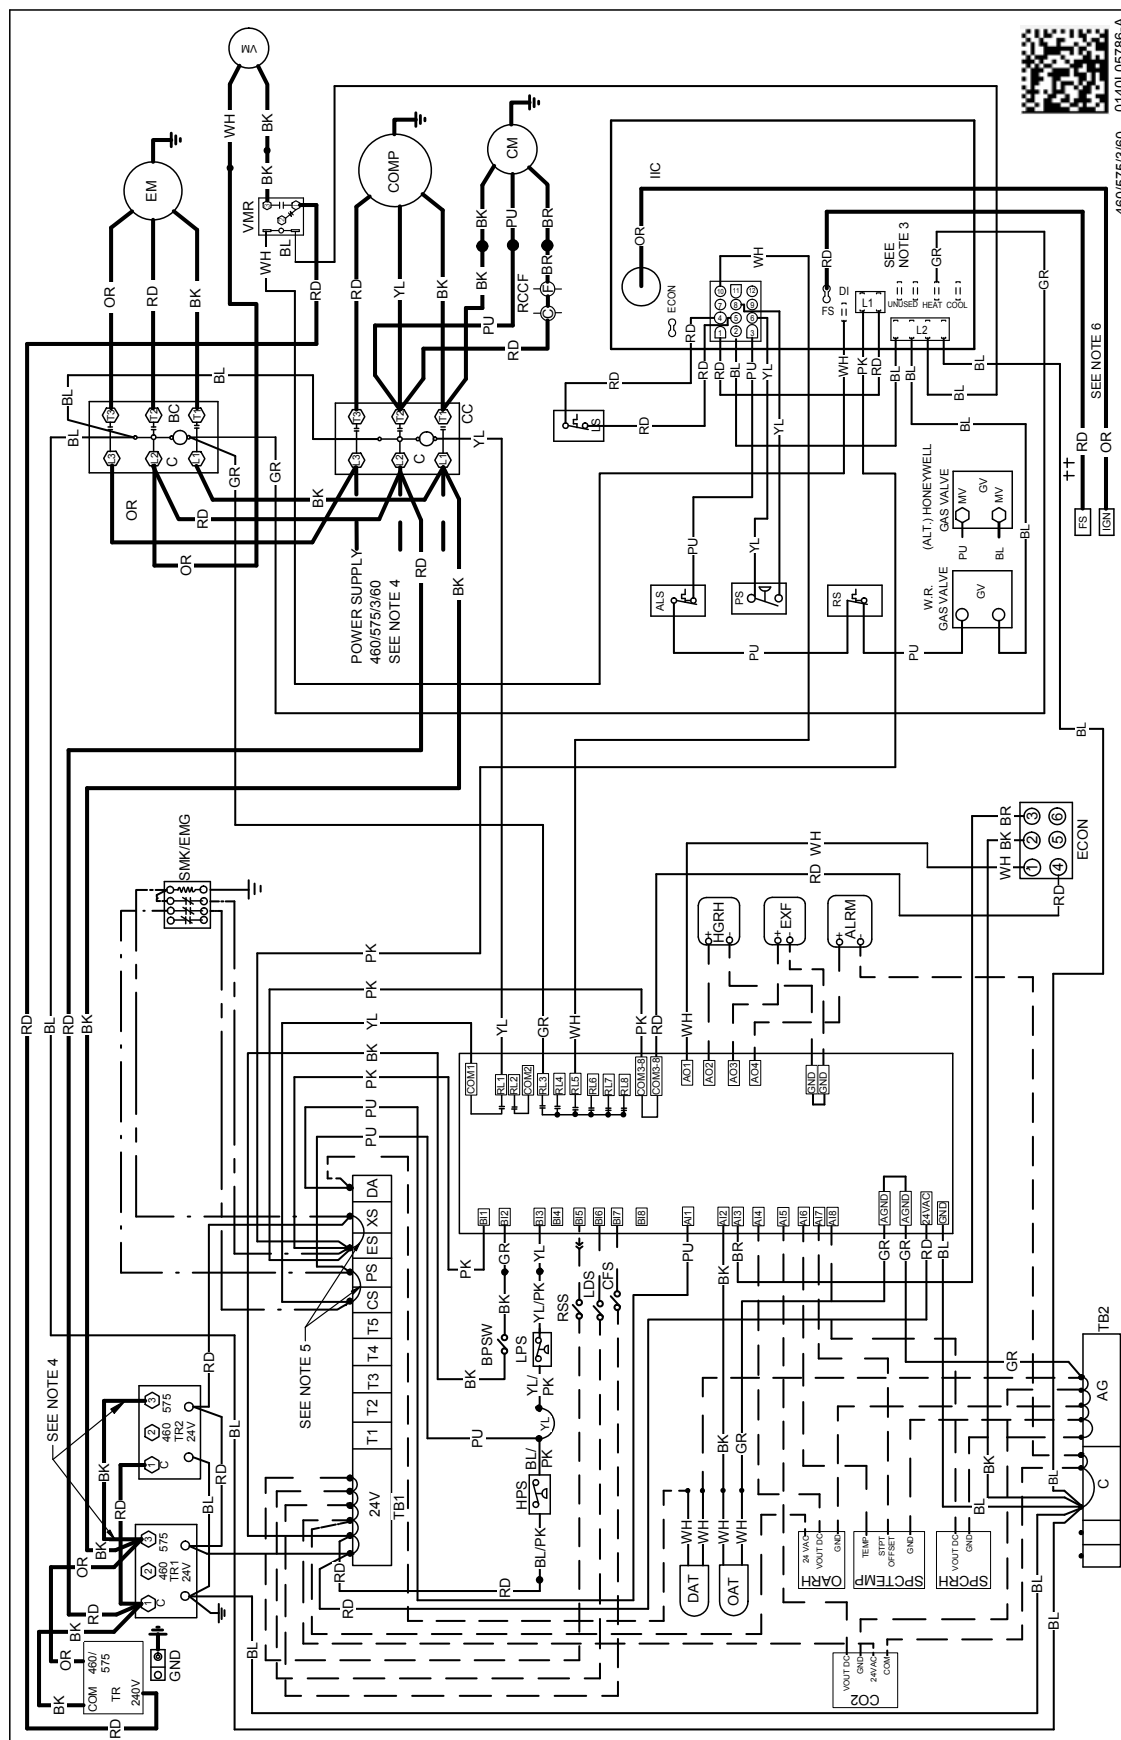

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.



WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



DAIKIN MASTER ITEM #	DESCRIPTION	FITS MODEL SIZES	FIELD- INSTALLED	FACTORY- INSTALLED	OPERATING WEIGHT (LBS)
	Curb				
14CURB3672B	14" Roof Curb	3-6 tons	✓		86
18CURB3672B	18" Roof Curb	3-6 tons	✓		100
24CURB3672B	24" Roof Curb	3-6 tons	✓		128
GHRC-3672	Hurricane Restraint Clips	3-6 tons	✓		2
	Ultra Low-Leak Economizer & Power Exhaust¹				
10-365-09C	Ultra Low-Leak Downflow Economizer w/ Dry Bulb	3-6 tons	✓		71
10-366-09C	Ultra Low-Leak Downflow Economizer w/ Enthalpy	3-6 tons	✓	✓	71
10-395-09	Ultra Low-Leak Horizontal Economizer w/ Dry Bulb	3-6 tons	✓		71
10-396-09	Ultra Low-Leak Horizontal Economizer w/ Enthalpy	3-6 tons	✓		71
10-455-09*-23	Centrifugal Power Exhaust 230v	3-6 tons	✓		55
10-455-09*-33	Centrifugal Power Exhaust 460v	3-6 tons	✓		55
10-455-09*-43	Centrifugal Power Exhaust 575v	3-6 tons	✓		55
10-457-09xA-23	Modulating Power Exhaust 208-230v	3-6 tons	✓		55
10-457-09xA-33	Modulating Power Exhaust 460v	3-6 tons	✓		55
10-465-09-21	Prop Power Exhaust 230v	3-6 tons	✓		55
10-465-09-31	Prop Power Exhaust 460v	3-6 tons	✓		55
10-465-09-41	Prop Power Exhaust 575v	3-6 tons	✓		55
	Low-Leak Economizer & Power Exhaust²				
DDNECNJ3672C	Low-Leak Downflow Economizer	3-6 tons	✓	✓	82
DPE36722	Downflow Power Exhaust (208/230 Volt)	3-6 tons	✓		55
DPE36724	Downflow Power Exhaust (460 Volt)	3-6 tons	✓		55
DPE36727	Downflow Power Exhaust (575v)	3-6 tons	✓		55
DHZEENJ3672	Horizontal Economizer	3-6 tons	✓		70
DHPE36722	Horizontal Power Exhaust (208/230 Volt)	3-6 tons	✓		55
DHPE36724	Horizontal Power Exhaust (460 Volt)	3-6 tons	✓		55
DHPE36727	Horizontal Power Exhaust (575 Volt)	3-6 tons	✓		55
	Downflow Accessories				
D25FD3672	25% Manual Fresh Air Damper	3-6 tons	✓		12
D25MFD3672	25% Motorized Fresh Air Damper	3-6 tons	✓		16
DDNBBS3672	Burglar Bar Sleeves with Supply & Return	3-6 tons	✓		30
DDNECNJ3672NR	Downflow Economizer2 w/o Barometric Relief	3-6 Tons	✓		77
DDNSQRD3616	Downflow Square-to-Round Adapter (16" Round)	3 tons	✓		45
DDNSQRD487218	Downflow Square-to-Round Adapter (18" Round)	4-6 tons	✓		35
	Horizontal Accessories				
DBRD3672	Barometric Relief Damper	3-6 tons	✓		15
	Concentrics				
CDK36	Concentric Duct Kit	3 tons	✓		27
CDK4872	Concentric Duct Kit	4-6 tons	✓		27

DAIKIN MASTER ITEM #	DESCRIPTION	FITS MODEL SIZES	FIELD- INSTALLED	FACTORY- INSTALLED	OPERATING WEIGHT (LBS)
	DDC Accessories³				
	DDC communicating controller (built-in BACnet® MS/TP) includes Standard Room Sensor to be installed in field	3-6 tons		✓	2
10366D09C	DDC Ultra Low-Leak Downflow Economizer	3-6 tons	✓	✓	71
10366D09	DDC Ultra Low-Leak Horizontal Economizer	3-6 tons	✓		71
10465DDC	Power Exhaust kit used with DDC Ultra Low-Leak Economizer	3-6 tons	✓		1
DLAKT01	Low-Ambient	3-6 tons	✓	✓	2
LONKT01	LonWorks® card	3-6 tons	✓		1
3PMK01	Phase Monitor (3-Phase Only)	3-6 tons	✓	✓	2
DFSKT01	Dirty Filter Switch	3-6 tons	✓		1
	High-Static Kits⁴				
HSKT036B	High-Static Kit (230/460v)	3 tons	✓	✓	41
HSKT036B-7	High-Static Kit (575v)	3 tons	✓	✓	5
HSKT048B	High-Static Kit (230/460v)	4 tons	✓	✓	38
HSKT048B-7	High-Static Kit (575v)	4 tons	✓	✓	27
HSKT060B	High-Static Kit (230/460v)	5 tons	✓	✓	38
HSKT060B-7	High-Static Kit (575v)	5 tons	✓	✓	28
HSKT072B	High-Static Kit (230/460v)	6 tons	✓	✓	38
HSKT072B-7	High-Static Kit (575v)	6 tons	✓	✓	15
	Crankcase Heater Kits				
0163R00002S	40W 230V	3 tons	✓		1
0163R00031S	40W 460V	3 tons	✓		1
0163R00032S	40W 575V	3 tons	✓		1
0130L00017S	70W 230V	4 - 6 tons	✓		1
0130L00018S	70W 460V	4 - 6 tons	✓		1
0130L00019S	70W 575V	4 - 6 tons	✓		1
	High Efficiency Filters				
0160L00203	High Efficiency MERV 13 Air Filter Nom. Size: 24x24x2; (Order Qty 1)	3 tons	✓		2
0160L00204	High Efficiency MERV 13 Air Filter Nom. Size: 14x20x2; (Order Qty 4)	4 tons	✓		4
0160L00205	High Efficiency MERV 13 Air Filter Nom. Size: 16x20x2; (Order Qty 4)	5 & 6 tons	✓		4
	Misc Accessories				
HAILGD03D	Condenser Coil Hail Guard	3-5 tons	✓		19
HAILGD04D	Condenser Coil Hail Guard	6 tons	✓		22
	Convenience Outlet: Non Powered	3-6 Tons		✓	2
	Convenience Outlet: Powered	3-6 Tons		✓	42
	Disconnect Switch	3-6 Tons		✓	5

DAIKIN MASTER ITEM #	DESCRIPTION	FITS MODEL SIZES	FIELD- INSTALLED	FACTORY- INSTALLED	OPERATING WEIGHT (LBS)
HA-02	High-Altitude Kit	3-6 tons	√		1
LAKT12	Low Ambient Kit, 208-230V - non-DDC	3-6 tons	√	√	14
LAKT15	Low Ambient Kit, 460V - non-DDC	3-6 tons	√	√	14
LAKT16	Low Ambient Kit, 575V - non-DDC	3-6 tons	√	√	14
LPM-07	LP Conversion Kit (For DCG036045 unit only)	3 Ton	√		1
LPM-08	LP Conversion Kit	3-6 Ton	√		1
3PMNDK01	Phase Monitor - Non DDC	3-6 tons	√	√	2
	Smoke Detector (supply and/or return air)	3-6 tons		√	11
	Hinged Panels	3-6 tons		√	10

¹ Use Economizer & Power Exhaust listed within Ultra Low-Leak section

² Use Economizer & Power Exhaust listed within Low-Leak section

³ For a full list of DDC accessories, please refer to DDC Controller Technical Guide manual (DK-DDC-TGD-01B)

⁴ HSKT High-Static Kits are for use with standard single-speed belt-drive units only.

Note: Where multiple variations are available, the heaviest combination is listed.