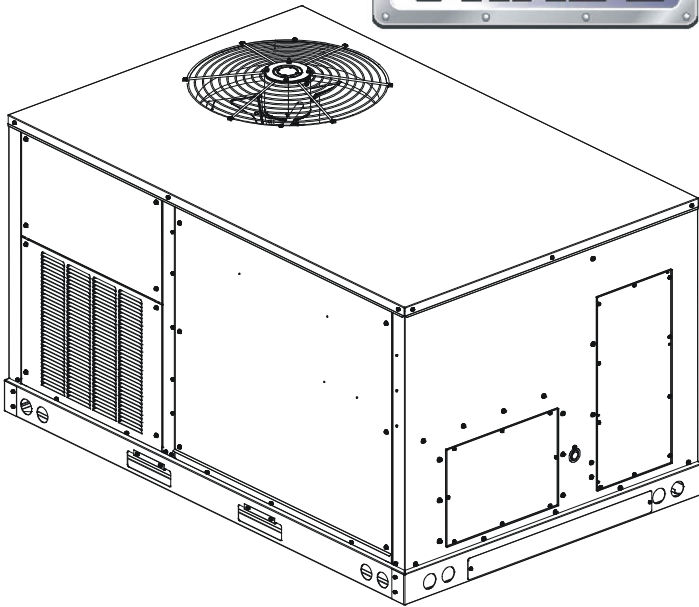


PACKAGED AIR CONDITIONER AND HEAT PUMP UNIT 3-6 TON HIGH EFFICIENCY LIGHT COMMERCIAL DRC/DRH MODELS INSTALLATION INSTRUCTIONS

**WARNING**

ONLY PERSONNEL THAT HAVE BEEN TRAINED TO INSTALL, ADJUST, SERVICE, MAINTENANCE OR REPAIR (HEREINAFTER, "SERVICE") THE EQUIPMENT SPECIFIED IN THIS MANUAL SHOULD SERVICE THE EQUIPMENT.

THIS EQUIPMENT IS NOT INTENDED FOR USE BY PERSONS (INCLUDING CHILDREN) WITH REDUCED PHYSICAL, SENSORY OR MENTAL CAPABILITIES, OR LACK OF EXPERIENCE AND KNOWLEDGE, UNLESS THEY HAVE BEEN GIVEN SUPERVISION OR INSTRUCTION CONCERNING USE OF THE APPLIANCE BY A PERSON RESPONSIBLE FOR THEIR SAFETY.

CHILDREN SHOULD BE SUPERVISED TO ENSURE THAT THEY DO NOT PLAY WITH THE EQUIPMENT.

THE MANUFACTURER WILL NOT BE RESPONSIBLE FOR ANY INJURY OR PROPERTY DAMAGE ARISING FROM IMPROPER SUPERVISION, SERVICE OR SERVICE PROCEDURES. IF YOU SERVICE THIS UNIT, YOU ASSUME RESPONSIBILITY FOR ANY INJURY OR PROPERTY DAMAGE WHICH MAY RESULT. IN ADDITION, IN JURISDICTIONS THAT REQUIRE ONE OR MORE LICENSES TO SERVICE THE EQUIPMENT SPECIFIED IN THIS MANUAL, ONLY LICENSED PERSONNEL SHOULD SERVICE THE EQUIPMENT. IMPROPER SUPERVISION, INSTALLATION, ADJUSTMENT, SERVICING, MAINTENANCE OR REPAIR OF THE EQUIPMENT SPECIFIED IN THIS MANUAL, OR ATTEMPTING TO INSTALL, ADJUST, SERVICE OR REPAIR THE EQUIPMENT SPECIFIED IN THIS MANUAL WITHOUT PROPER SUPERVISION OR TRAINING MAY RESULT IN PRODUCT DAMAGE, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.

**WARNING**

DO NOT BYPASS SAFETY DEVICES.



INDEX

SAFETY INSTRUCTIONS.....	2
REPLACEMENT PARTS.....	2
GENERAL INFORMATION.....	3
UNIT LOCATION.....	4
CLEARANCES.....	5
ROOF CURB POST-INSTALLATION CHECKS.....	5
ROOF TOP DUCT CONNECTIONS.....	5
RIGGING DETAILS.....	6
ELECTRICAL WIRING.....	7
CIRCULATING AIR AND FILTERS.....	9
CONDENSATE DRAIN CONNECTION.....	9
STARTUP, ADJUSTMENTS, AND CHECKS.....	10
AIR FLOW ADJUSTMENTS.....	11
HEAT PUMP OPERATION.....	16
MAINTENANCE.....	17
APPENDIX A BLOWER PERFORMANCE TABLES.....	19
APPENDIX B ELECTRICAL DATA.....	43
APPENDIX C UNIT DIMENSIONS.....	56
APPENDIX D AIR FLOW FOR ELECTRIC HEAT.....	57
WIRING DIAGRAMS.....	58
STARTUP CHECKLIST.....	66

SAFETY INSTRUCTIONS



RECOGNIZE THIS SYMBOL AS A SAFETY PRECAUTION.

These installation instructions cover the **outdoor** installation of single package heating and cooling units. See the Specification Sheet applicable to your model for information regarding accessories.

***NOTE: PLEASE CONTACT YOUR DISTRIBUTOR OR OUR WEBSITE FOR THE APPLICABLE SPECIFICATION SHEET REFERRED TO IN THIS MANUAL.**

TO THE INSTALLER

Before installing this unit, please read this manual to familiarize yourself on the specific items which must be adhered to, including maximum external static pressure to unit, air temperature rise, minimum or maximum CFM and motor speed connections.

Keep this literature in a safe place for future reference.



CAUTION

SHEET METAL PARTS, SCREWS, CLIPS AND SIMILAR ITEMS INHERENTLY HAVE SHARP EDGES, AND IT IS NECESSARY THAT THE INSTALLER AND SERVICE PERSONNEL EXERCISE CAUTION.



WARNING

DO NOT CONNECT TO OR USE ANY DEVICE THAT IS NOT DESIGN CERTIFIED BY DAIKIN FOR USE WITH THIS UNIT. SERIOUS PROPERTY DAMAGE, PERSONAL INJURY, REDUCED UNIT PERFORMANCE AND/OR HAZARDOUS CONDITIONS MAY RESULT FROM THE USE OF SUCH NON-APPROVED DEVICES.



WARNING

TO AVOID PROPERTY DAMAGE, PERSONAL INJURY OR DEATH, DO NOT USE THIS UNIT IF ANY PART HAS BEEN UNDER WATER. IMMEDIATELY CALL A QUALIFIED SERVICE TECHNICIAN TO INSPECT THE FURNACE AND TO REPLACE ANY PART OF THE CONTROL SYSTEM AND ANY GAS CONTROL HAVING BEEN UNDER WATER.



WARNING

THIS UNIT MUST NOT BE USED AS A "CONSTRUCTION HEATER" DURING THE FINISHING PHASES OF CONSTRUCTION ON A NEW STRUCTURE. THIS TYPE OF USE MAY RESULT IN PREMATURE FAILURE OF THE UNIT DUE TO EXTREMELY LOW RETURN AIR TEMPERATURE AND EXPOSURE TO CORROSIVE OR VERY DIRTY ATMOSPHERES.



WARNING

**HIGH VOLTAGE!
DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT. MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.**



WARNING

TO PREVENT THE RISK OF PROPERTY DAMAGE, PERSONAL INJURY, OR DEATH, DO NOT STORE COMBUSTIBLE MATERIALS OR USE GASOLINE OR OTHER FLAMMABLE LIQUIDS OR VAPORS IN THE VICINITY OF THIS APPLIANCE.

REPLACEMENT PARTS

ORDERING PARTS

When reporting shortages or damages, or ordering repair parts, give the complete unit model and serial numbers as stamped on the unit's nameplate.

Replacement parts for this appliance are available through your contractor or local distributor. For the location of your nearest distributor, see website www.daikinac.com or contact:

EQUIPMENT SUPPORT
DAIKIN NORTH AMERICA LLC
19001 KERMIER ROAD
WALLER, TEXAS 77484
855-770-5678

GENERAL INFORMATION



WARNING

TO PREVENT PROPERTY DAMAGE, PERSONAL INJURY OR DEATH, DUE TO FIRE, EXPLOSIONS, SMOKE, SOOT, CONDENSATION, ELECTRIC SHOCK OR CARBON MONOXIDE, THIS UNIT MUST BE PROPERLY INSTALLED, REPAIRED, OPERATED, AND MAINTAINED.

This unit is approved for outdoor installation ONLY. Rated performance is achieved after 20 hours of operation. Rated performance is delivered at the specified airflow. See product specification sheet for light commercial models. Specification sheets can be found at www.daikinac.com for Daikin brand products. Within the website, please select the light commercial products menu and then select the submenu for the type of product to be installed, such as air conditioners or heat pumps, to access a list of product pages that each contain links to that model's specification sheet.

To assure that your unit operates safely and efficiently, it must be installed, operated, and maintained in accordance with these installation and operating instructions, and all local codes. In situations where these conflict, local codes take precedence.

EPA REGULATIONS

IMPORTANT: THE UNITED STATES ENVIRONMENTAL PROTECTION AGENCY (EPA) HAS ISSUED VARIOUS REGULATIONS REGARDING THE INTRODUCTION AND DISPOSAL OF REFRIGERANTS IN THIS UNIT. FAILURE TO FOLLOW THESE REGULATIONS MAY HARM THE ENVIRONMENT AND CAN LEAD TO THE IMPOSITION OF SUBSTANTIAL FINES. BECAUSE REGULATIONS MAY VARY DUE TO PASSAGE OF NEW LAWS, WE SUGGEST A CERTIFIED TECHNICIAN PERFORM ANY WORK DONE ON THIS UNIT. SHOULD YOU HAVE ANY QUESTIONS PLEASE CONTACT THE LOCAL OFFICE OF THE EPA.

NATIONAL CODES

This product is designed and manufactured to permit installation in accordance with National Codes. It is the installer's responsibility to install the product in accordance with National Codes and/or prevailing local codes and regulations.

The heating and cooling capacities of the unit should be greater than or equal to the design heating and cooling loads of the area to be conditioned. The loads should be calculated by an approved method or in accordance with ASHRAE Guide or Manual J - Load Calculations published by the Air Conditioning Contractors of America.

Obtain from:
American National Standards Institute
25 West 43rd Street, 4th Floor
New York, NY 10036

System design and installation should also, where applicable, follow information presented in accepted industry guides such as the ASHRAE Handbooks. The manufacturer assumes no responsibility for equipment installed in violation of any local codes. The mechanical installation of the packaged roof top units consists of making final connections between the unit and building services; supply and return duct connections; and drain connections (if required). The internal systems of the unit are completely factory-installed and tested prior to shipment.

Units are generally installed on a steel roof mounting curb assembly which has been shipped to the job site for installation on the roof structure prior to the arrival of the unit. The model number shown on the unit's identification plate identifies the various components of the unit such as refrigeration tonnage, heating output and voltage.

Carefully inspect the unit for damage including damage to the cabinetry. Any bolts or screws which may have loosened in transit must be re-tightened.

In the event of damage, the receiver should:

1. Make notation on delivery receipt of any visible damage to shipment or container.
2. Notify the carrier promptly and request an inspection.
3. In case of concealed damage, the carrier should be notified as soon as possible-preferably within 5 days.
4. File the claim with the following supporting documents:
 - a. Original Bill of Lading, certified copy, or indemnity bond.
 - b. Original paid freight bill or indemnity in lieu thereof.
 - c. Original invoice or certified copy thereof, showing trade and other discounts or reductions.
 - d. Copy of the inspection report issued by the carrier representative at the time damage is reported to the carrier. The carrier is responsible for making prompt inspection of damage and for a thorough investigation of each claim. The distributor or manufacturer will not accept claims from dealers for transportation damage.

NOTE: WHEN INSPECTING THE UNIT FOR TRANSPORTATION DAMAGE, REMOVE ALL PACKAGING MATERIALS. RECYCLE OR DISPOSE OF THE PACKAGING MATERIAL ACCORDING TO LOCAL CODES.

PRE-INSTALLATION CHECKS

Carefully read all instructions for the installation prior to installing unit. Ensure each step or procedure is understood and any special considerations are taken into account before starting installation. Assemble all tools, hardware and supplies needed to complete the installation. Some items may need to be purchased locally.

NOTE: VERIFY THAT THE VOLTAGE LISTED ON THE UNIT DATA PLATE MATCHES THE VOLTAGE SUPPLIED BY THE BUILDING UTILITIES.

UNIT LOCATION



WARNING

TO PREVENT POSSIBLE EQUIPMENT DAMAGE, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH, THE FOLLOWING BULLET POINTS MUST BE OBSERVED WHEN INSTALLING THE UNIT.

IMPORTANT NOTE: REMOVE WOOD SHIPPING RAILS PRIOR TO INSTALLATION OF THE UNIT.

ALL INSTALLATIONS:

IMPORTANT NOTE: *UNIT SHOULD BE ENERGIZED 24 HOURS PRIOR TO COMPRESSOR START UP TO ENSURE CRANKCASE HEATER HAS SUFFICIENTLY WARMED THE COMPRESSORS. COMPRESSOR DAMAGE MAY OCCUR IF THIS STEP IS NOT FOLLOWED.*

NOTE: APPLIANCE IS SHIPPED FROM FACTORY FOR VERTICAL DUCT APPLICATION.

Proper installation of the unit ensures trouble-free operation. Improper installation can result in problems ranging from noisy operation to property or equipment damages, dangerous conditions that could result in injury or personal property damage and that are not covered by the warranty. Give this booklet to the user and explain it's provisions. The user should retain these instructions for future reference.

- To avoid possible illness or death of the building occupants, do NOT locate outside air intake device (economizer, manual fresh air intake, motorized fresh air intake) too close to an exhaust outlet, gas vent termination, or plumbing vent outlet. For specific distances required, consult local codes.
- Allow minimum clearances from the enclosure for fire protection, proper operation, and service access (see unit clearances). These clearances must be permanently maintained.
- When the unit is heating, the temperature of the return air entering the unit must be a minimum of 55° F.

GROUND LEVEL INSTALLATIONS ONLY:

- When the unit is installed on the ground adjacent to the building, a level concrete (or equal) base is recommended. Prepare a base that is 3" larger than the package unit footprint and a minimum of 3" thick.
- The base should also be located where no runoff of water from higher ground can collect in the unit.

ROOF TOP INSTALLATIONS ONLY:

- To avoid possible property damage or personal injury, the roof must have sufficient structural strength to carry the weight of the unit(s) and snow or water loads as required by local codes. Consult a structural engineer to determine the weight capabilities of the roof.
- The unit may be installed directly on wood floors or on Class A, Class B, or Class C roof covering material.
- To avoid possible personal injury, a safe, flat surface for service personnel should be provided.
- Adequate clearances from the unit to any adjacent public walkways, adjacent buildings, building openings or openable windows must be maintained in accordance with local codes.

UNIT PRECAUTIONS

- Do not stand or walk on the unit.
- Do not drill holes anywhere in panels or in the base frame of the unit except where indicated. Unit access panels provide structural support.
- Do not remove any access panels until unit has been installed on roof curb or field supplied structure.
- Do not roll unit across finished roof without prior approval of owner or architect.
- Do not skid or slide on any surface as this may damage unit base. The unit must be stored on a flat, level surface. Protect the condenser coil because it is easily damaged.

ROOF CURB INSTALLATIONS ONLY:

Curb installations must comply with local codes and should be done in accordance with the established guidelines of the National Roofing Contractors Association.

Proper unit installation requires that the roof curb be firmly and permanently attached to the roof structure. Check for adequate fastening method prior to setting the unit on the curb.

Full perimeter roof curbs are available from the factory and are shipped unassembled. Field assembly, squaring, leveling and mounting on the roof structure are the responsibility of the installing contractor. All required hardware necessary for the assembly of the sheet metal curb is included in the curb accessory.




WARNING

TO PREVENT POSSIBLE EQUIPMENT DAMAGE, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH, THE FOLLOWING BULLET POINTS MUST BE OBSERVED WHEN INSTALLING THE UNIT.


- Sufficient structural support must be determined prior to locating and mounting the curb and package unit.
- Ductwork must be constructed using industry guidelines. The duct work must be placed into the roof curb before mounting the package unit. Our full perimeter curbs include duct connection frames to be assembled with the curb. Cantilevered type curbs are not available from the factory.
- Curb insulation, cant strips, flashing and general roofing material are furnished by the contractor.
- The curbs must be supported on parallel sides by roof members.
- The roof members must not penetrate supply and return duct opening areas as damage to the unit might occur.

there should be a minimum of 48" clearance and provisions made to deflect the warm discharge air out from the overhang. The unit should be installed remote from all building exhausts to inhibit ingestion of exhaust air into the unit fresh air intake.

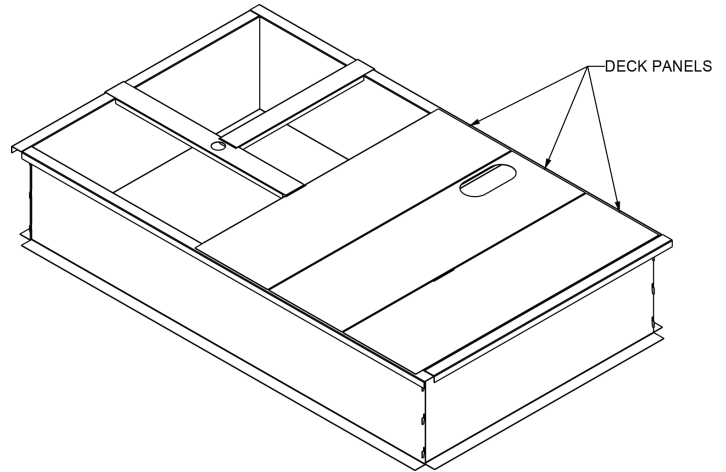


ROOF CURB INSTALLATION

NOTE: THE UNIT AND CURB ACCESSORIES ARE DESIGNED TO ALLOW VERTICAL DUCT INSTALLATION BEFORE UNIT PLACEMENT. DUCT INSTALLATION AFTER UNIT PLACEMENT IS NOT RECOMMENDED.

 CAUTION
<p>ALL CURBS LOOK SIMILAR. TO AVOID INCORRECT CURB POSITIONING, CHECK JOB PLANS CAREFULLY AND VERIFY MARKINGS ON CURB ASSEMBLY. INSTRUCTIONS MAY VARY IN CURB STYLES AND SUPERSEDES INFORMATION SHOWN.</p>

See the manual shipped with the roof curb for assembly and installation instructions.

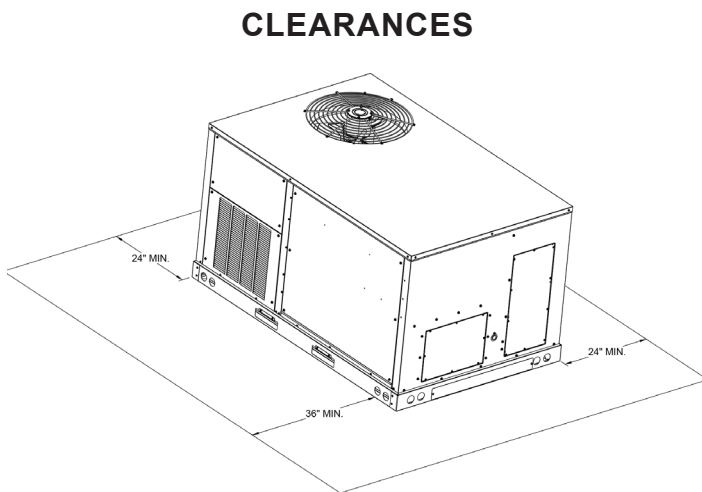

UNIT CLEARANCES

**In situations that have multiple units, a 36" minimum clearance is required between the condenser coils.*

Adequate clearance around the unit should be kept for safety, service, maintenance, and proper unit operation. A clearance of 48" is recommended on all sides of the unit to facilitate possible parts replacement, to allow service access and to insure proper ventilation and condenser airflow. The top of the unit should be completely unobstructed. If units are to be located under an overhang,

ROOF CURB POST-INSTALLATION CHECKS

After installation, check the top of the curb, duct connection frame and duct flanges to make sure gasket has been applied properly. Gasket should be firmly applied to the top of the curb perimeter, duct flanges and any exposed duct connection frame. If gasket is loose, re-apply using strong weather resistant adhesive.

PROTRUSION

Inspect curb to ensure that none of the utility services (electric) routed through the curb protrude above the curb.

NOTE: IF FASTENERS ARE USED TO SECURE THE DUCT WORK TO THE CURB, THESE SHOULD BE INSTALLED HORIZONTALLY INTO THE FLANGES OF THE DUCT OPENING OF THE CURB.

 CAUTION
<p>IF PROTRUSIONS EXIST, DO NOT ATTEMPT TO SET UNIT ON CURB.</p>


ROOF TOP DUCT CONNECTIONS

Install all duct connections on the unit before placing the unit on rooftop.

HORIZONTAL DISCHARGE

Refer to IOD-7082 included in the literature pack for installing horizontal duct covers.

Flexible duct connectors between the unit and ducts are recommended. Insulate and weatherproof all external ductwork and joints as required and in accordance with local codes.

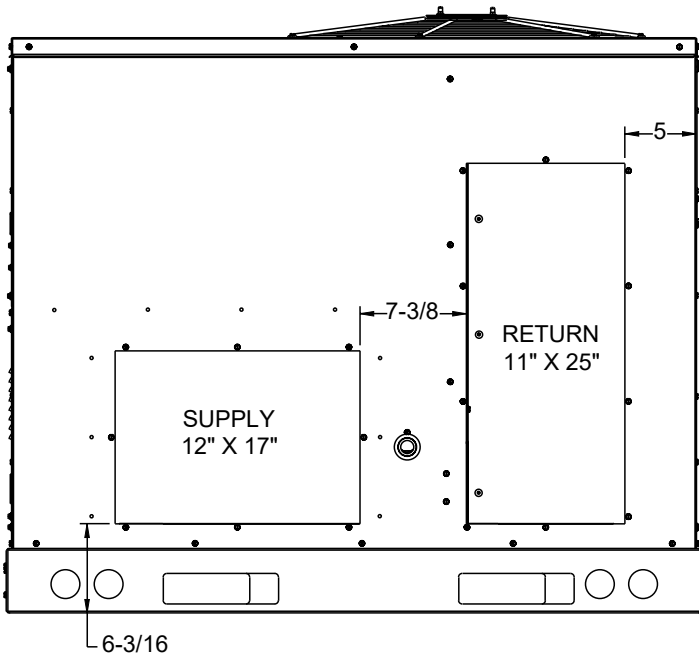

**HORIZONTAL DISCHARGE DUCT CONNECTIONS
RIGGING DETAILS**

WARNING
TO PREVENT PROPERTY DAMAGE, THE UNIT SHOULD REMAIN IN AN UPRIGHT POSITION DURING ALL RIGGING AND MOVING OPERATIONS. TO FACILITATE LIFTING AND MOVING WHEN A CRANE IS USED, PLACE THE UNIT IN AN ADEQUATE CABLE SLING.

CAUTION
IF UNITS ARE LIFTED TWO AT A TIME, THE FORK HOLES ON THE CONDENSER END OF THE UNIT MUST NOT BE USED. MINIMUM FORK LENGTH IS 42" TO PREVENT DAMAGE TO THE UNIT; HOWEVER, 48" IS RECOMMENDED.

PROVISIONS FOR FORKS HAVE BEEN INCLUDED IN THE UNIT BASE FRAME. NO OTHER FORK LOCATIONS ARE APPROVED.


WARNING
TO PREVENT POSSIBLE EQUIPMENT DAMAGE, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH, THE FOLLOWING BULLET POINTS MUST BE OBSERVED WHEN INSTALLING THE UNIT.

- Unit must be lifted by the four lifting holes located at the base frame corners.
- Lifting cables should be attached to the unit with shackles.
- The distance between the crane hook and the top of the unit must not be less than 60".
- Two spreader bars must span over the unit to prevent damage to the cabinet by the lift cables. Spreader bars must be of sufficient length so that cables do not come in contact with the unit during transport. Remove wood struts mounted beneath unit base frame before setting unit on roof curb. These struts are intended to protect unit base frame


from fork lift damage. Removal is accomplished by extracting the sheet metal retainers and pulling the struts through the base of the unit. Refer to rigging label on the unit.

IMPORTANT: IF USING BOTTOM DISCHARGE WITH ROOF CURB, DUCTWORK SHOULD BE ATTACHED TO THE CURB PRIOR TO INSTALLING THE UNIT. DUCTWORK DIMENSIONS ARE SHOWN IN ROOF CURB INSTALLATION INSTRUCTIONS.

Refer to the Roof Curb Installation Instructions for proper curb installation. Curbing must be installed in compliance with the National Roofing Contractors Association Manual.

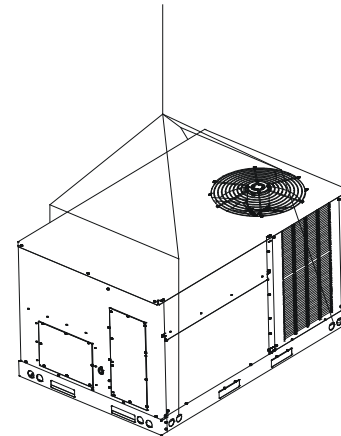

To assist in determining rigging requirements, unit weights and center of gravity are shown as follows:

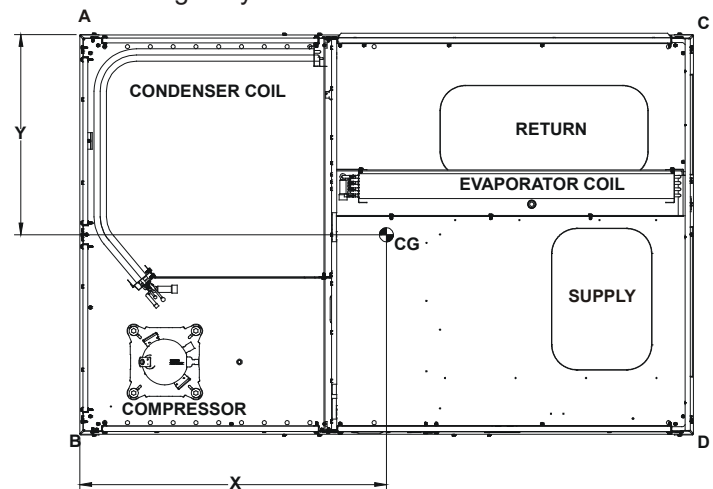

CORNER AND CENTER OF GRAVITY LOCATIONS

NOTE: UNIT SHOULD BE LIFTED AT A POINT ABOVE CENTER OF GRAVITY.

Model	Shipping Weight (lb)	Operating Weight (lb)	Corner Weights (lb)				X (in)	Y (in)
			A	B	C	D		
DRC036	595	537	119	160	123	135	35.5	26.5
DRC048	648	590	150	167	113	160	34.2	26.8
DRC060	664	606	158	166	105	177	34.4	27.4
DRC072	715	657	134	149	217	157	34.4	27.0
DRH036	653	595	92	224	173	106	34.6	26.8
DRH048	679	621	166	176	112	167	33.3	26.7
DRH060	688	630	150	194	165	121	33.5	27.6
DRH072	766	708	227	162	82	237	33.3	27.2

THE NUMBERS MAY SLIGHTLY VARY DEPENDING ON INSTALLED OPTIONS.



CAUTION

TO PREVENT DAMAGE TO THE WIRING, PROTECT WIRING FROM SHARP EDGES. FOLLOW NATIONAL ELECTRICAL CODE AND ALL LOCAL CODES AND ORDINANCES. DO NOT ROUTE WIRES THROUGH REMOVABLE ACCESS PANELS.



CAUTION

TO PREVENT SEVERE DAMAGE TO THE BOTTOM OF THE UNIT, DO NOT FORK LIFT UNIT AFTER WOOD STRUTS HAVE BEEN REMOVED.

Bring condenser end of unit into alignment with the curb first. Lower unit carefully onto roof mounting curb. When a rectangular cantilever curb is used, care should be taken to center the unit. Check for proper alignment and orientation of supply and return openings with duct.

RIGGING REMOVAL



CAUTION

TO PREVENT DAMAGE TO THE UNIT, DO NOT ALLOW CRANE HOOKS AND SPREADER BARS TO REST ON THE ROOF OF THE UNIT.

Remove spreader bars, lifting cables and other rigging equipment.

ELECTRICAL WIRING



WARNING

**HIGH VOLTAGE!
DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT. MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.**



WARNING

**HIGH VOLTAGE!
TO AVOID PERSONAL INJURY OR DEATH DUE TO ELECTRICAL SHOCK, DO NOT TAMPER WITH FACTORY WIRING. THE INTERNAL POWER AND CONTROL WIRING OF THESE UNITS ARE FACTORY-INSTALLED AND HAVE BEEN THOROUGHLY TESTED PRIOR TO SHIPMENT. CONTACT YOUR LOCAL REPRESENTATIVE IF ASSISTANCE IS REQUIRED.**



CAUTION

CONDUIT AND FITTINGS MUST BE WEATHER-TIGHT TO PREVENT WATER ENTRY INTO THE BUILDING.

For unit protection, use a fuse or HACR circuit breaker that is in excess of the circuit ampacity, but less than or equal to the maximum overcurrent protection device. **DO NOT EXCEED THE MAXIMUM OVERCURRENT DEVICE SIZE SHOWN ON UNIT DATA PLATE.**

All line voltage connections must be made through weatherproof fittings. All exterior power supply and ground wiring must be in approved weatherproof conduit.

The main power supply wiring to the unit and low voltage wiring to accessory controls must be done in accordance with these instructions and prevailing local electrical codes. (National Electrical Code, NFPA 70, or the Canadian Electrical Code, CSA C22.1, Part 1).

The unit is factory wired for the voltage shown on the unit's data plate. Refer to model nomenclature in Appendix B for voltage requirement for your unit.

NOTE: IF SUPPLY VOLTAGE IS 208V, LEAD ON PRIMARY OF TRANSFORMER(S) MUST BE MOVED FROM THE 230V TO THE 208V TAP. REFER TO WIRING DIAGRAM ON UNIT FOR DETAILS.

Main power wiring should be sized for the minimum circuit ampacity shown on the unit's dataplate. Size wires in accordance with the ampacity tables in the prevailing local electrical codes (National Electrical Code, NFPA 70, or the Canadian Electrical Code, CSA C22.1, Part 1). If long wires are required, it may be necessary to increase the wire size to prevent excessive voltage drop. Wires should be sized for a maximum of 3% voltage drop.



CAUTION

TO AVOID RISK OF PROPERTY DAMAGE, PERSONAL INJURY OR FIRE, USE ONLY COPPER CONDUCTORS.



CAUTION


LABEL ALL WIRES PRIOR TO DISCONNECTION WHEN SERVICING CONTROLS. WIRING ERRORS CAN CAUSE IMPROPER AND DANGEROUS OPERATION. VERIFY PROPER OPERATION AFTER SERVICING.

NOTE: A WEATHER-TIGHT DISCONNECT SWITCH, PROPERLY SIZED FOR THE UNIT TOTAL LOAD, MUST BE FIELD OR FACTORY INSTALLED. AN EXTERNAL FIELD SUPPLIED DISCONNECT MAY BE MOUNTED ON THE EXTERIOR PANEL.

Ensure the data plate is not covered by the field-supplied disconnect switch.


- Some disconnect switches are not fused. Protect the power leads at the point of distribution in accordance with the unit data plate.
- The unit must be electrically grounded in accordance with prevailing local electrical codes (National Electrical Code, NFPA 70, or the Canadian Electrical Code, CSA C22.1, Part 1). A ground lug is provided for this purpose. Do not use the ground lug for connecting a neutral conductor.
- Connect power wiring to the electrical power block, ground wire to ground lug, and thermostat wiring to terminal block (where applicable) within the main control box.

HP/AC CONTROL BOX

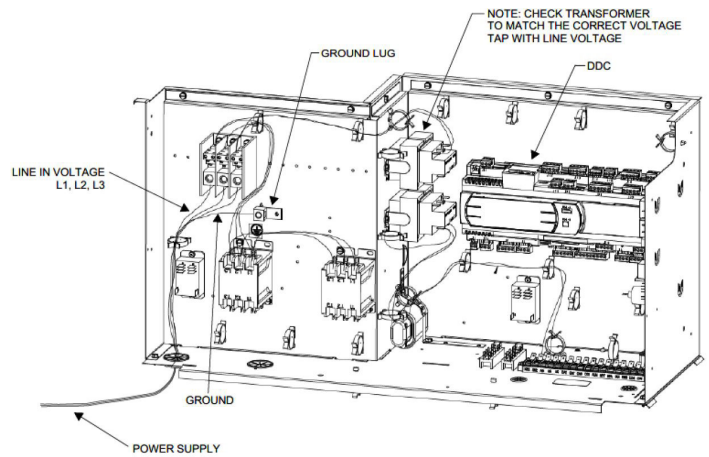


HP/AC DDC CONTROL BOX


NOTE: DEPENDING ON THE OPTIONS INSTALLED, THE LOCATION OF THE COMPONENTS MAY VARY IN SOME MODELS.

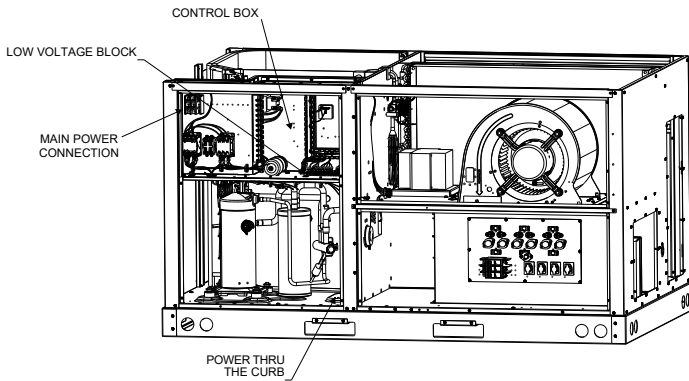

HP/AC UNIT

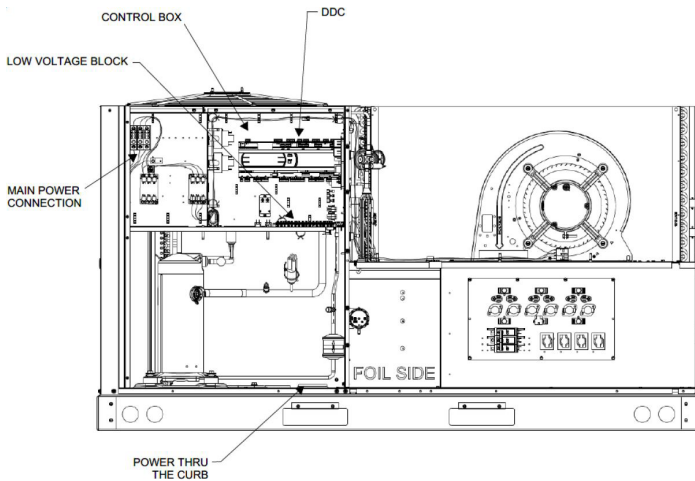

HP/AC DDC UNIT

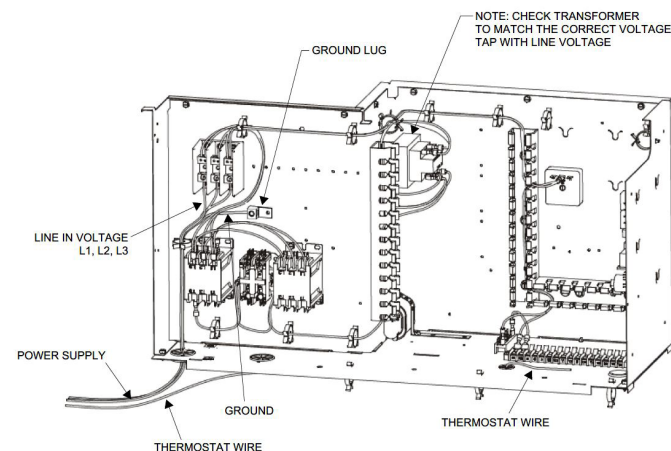

WARNING

FAILURE OF UNIT DUE TO OPERATION ON IMPROPER LINE VOLTAGE OR WITH EXCESSIVE PHASE UNBALANCE CONSTITUTES PRODUCT ABUSE AND IS NOT COVERED BY THE WARRANTY. IT MAY CAUSE SEVERE DAMAGE TO THE UNIT'S ELECTRICAL COMPONENTS.

AREAS WITHOUT CONVENIENCE OUTLET


It is recommended that an independent 115V power source be brought to the vicinity of the roof top unit for portable lights and tools used by the service mechanic.

NOTE: REFER TO LOCAL CODES FOR REQUIREMENTS. THESE OUTLETS CAN ALSO BE FACTORY INSTALLED.

UNITS INSTALLED ON ROOF TOPS

Main power and low voltage wiring may enter the unit through the condenser end of unit or through the roof curb. Install conduit connectors at the designated locations. External connectors must be weatherproof. All holes in the unit base must be sealed (including those around conduit nuts) to prevent water leakage into building. All required conduit and fittings are to be field supplied.

Supply voltage to roof top unit must not vary by more than 10% of the value indicated on the unit data plate. Phase voltage unbalance must not exceed 2%. Contact your local power company for correction of improper voltage or phase unbalance.

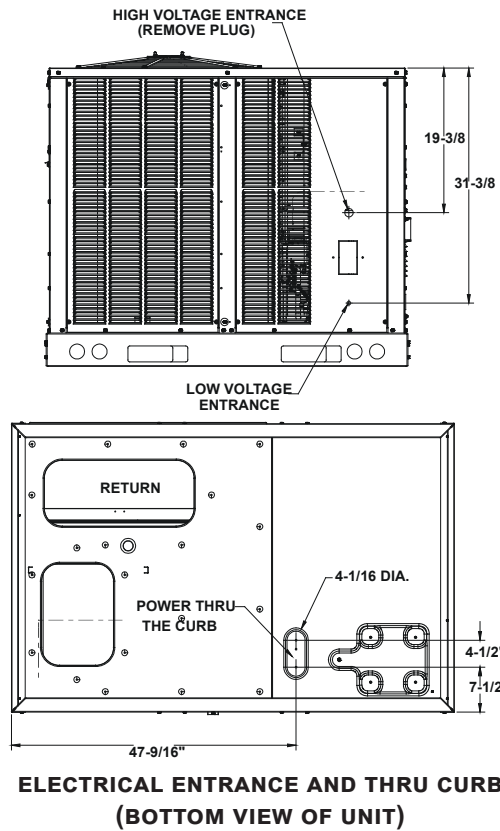

**ELECTRICAL ENTRANCE AND THRU CURB
(BOTTOM VIEW OF UNIT)**

NOTE: REFER TO UNIT WIRING DIAGRAMS FOR THERMOSTAT OR REMOTE SENSOR CONNECTIONS.

CIRCULATING AIR AND FILTERS


DUCTWORK
The supply duct from the unit through a wall may be installed without clearance. However, minimum unit clearances must be maintained (see "Clearances" section). The supply duct should be provided with an access panel large enough to inspect the air chamber downstream of the heat exchanger. A cover should be tightly attached to prevent air leaks.

Ductwork dimensions are shown in the roof curb installation manual.


If desired, supply and return duct connections to the unit may be made with flexible connections to reduce possible unit operating sound transmission.

CONDENSATE DRAIN CONNECTION

CONDENSATE DRAIN CONNECTION
A 3/4" female NPT drain connection is supplied on the end of the unit and bottom of the drain pan for condensate piping. An external trap must be installed for proper condensate drainage. Hand tighten drain fitting to the drain connection.

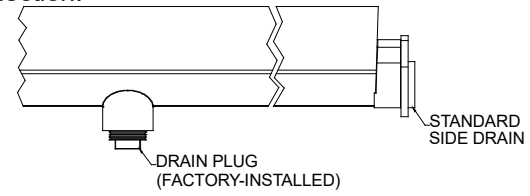

Drain Pan (Side View)

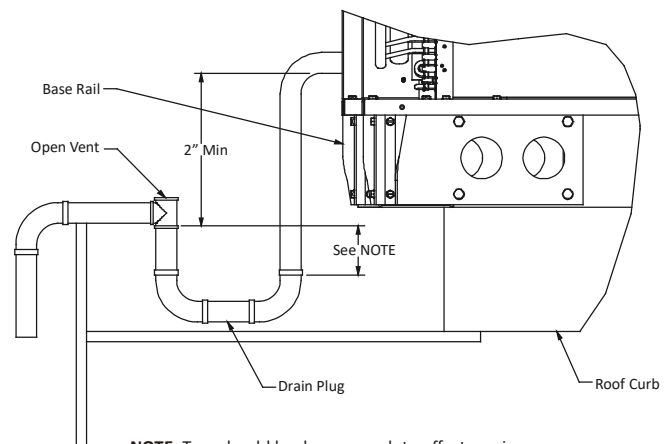

NOTE: Trap should be deep enough to offset maximum unit static difference. A minimum 4" trap is recommended.

DRAIN CONNECTION

Install condensate drain trap as shown. Use 3/4" drain line and fittings or larger. Do not operate without trap.
NOTE: ALL THREADED CONNECTIONS SHOULD BE SEALED WITH THREAD SEALER TO PREVENT LEAKS.

LOW VOLTAGE CONTROL WIRING

1. A 24V thermostat must be installed for unit operation UNLESS THE DDC CONTROLS OPTION HAS BEEN INSTALLED. (REFER TO DDC QUICKSTART GUIDE)
2. Locate thermostat or remote sensor in the conditioned space where it will sense average temperature. Do not locate the device where it may be directly exposed to supply air, sunlight or other sources of heat. Follow installation instructions packaged with the installed device.
3. Use #18 AWG wire for 24V control wiring runs not exceeding 75 feet. Use #16 AWG wire for 24V control wiring runs not exceeding 125 feet. Use #14 AWG wire for 24V control wiring runs not exceeding 200 feet. Low voltage wiring may be National Electrical Code (NEC) Class 2 where permitted by local codes.
4. Route the low voltage control wires from sub-base terminals to the unit. Control wiring should enter through the condenser panel opening or through curb indicated in "Electrical Entrance" figure. Connect thermostat and any accessory wiring to low voltage terminal block TB1 in the main control box.

NOTE: FIELD-SUPPLIED CONDUIT MAY NEED TO BE INSTALLED DEPENDING ON UNIT/CURB CONFIGURATION. USE #18 AWG SOLID CONDUCTOR WIRE WHENEVER CONNECTING THERMOSTAT WIRES TO TERMINALS ON SUB-BASE. DO NOT USE LARGER THAN #18 AWG WIRE. A TRANSITION TO #18 AWG WIRE MAY BE REQUIRED BEFORE ENTERING THERMOSTAT SUB-BASE.

HORIZONTAL DRAIN

Drainage of condensate directly onto the roof may be acceptable; refer to local code. It is recommended that a small drip pad of either stone, mortar, wood or metal be provided to prevent any possible damage to the roof.



VERTICAL DRAIN

To use the bottom drain connection, remove the drain plug from the bottom connection and install it in the horizontal connection.


CLEANING

Due to the fact that drain pans in any air conditioning unit will have some moisture in them, algae and fungus will grow due to airborne bacteria and spores. Periodic cleaning is necessary to prevent this build-up from plugging the drain.

STARTUP, ADJUSTMENTS, AND CHECKS

 WARNING	
HIGH VOLTAGE! TO AVOID PERSONAL INJURY OR DEATH DUE TO ELECTRICAL SHOCK, BOND THE FRAME OF THIS UNIT TO THE BUILDING ELECTRICAL GROUND BY USE OF THE GROUNDING TERMINAL PROVIDED OR OTHER ACCEPTABLE MEANS. DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT.	

 CAUTION
TO PREVENT PROPERTY DAMAGE OR PERSONAL INJURY, DO NOT START THE UNIT UNTIL ALL NECESSARY PRE-CHECKS AND TESTS HAVE BEEN PERFORMED.

 WARNING
MOVING MACHINERY HAZARD! TO PREVENT POSSIBLE PERSONAL INJURY OR DEATH, DISCONNECT POWER TO THE UNIT AND PADLOCK IN THE "OFF" POSITION BEFORE SERVICING FANS.

PRE-STARTUP INSTRUCTIONS

On new installations, or if a major component has been replaced, the operation of the unit must be checked.

Check unit operation as outlined in the following instructions. If any sparking, odors, or unusual sounds are encountered, shut off electrical power and recheck for wiring errors, or obstructions in or near the blower motors. If horizontal duct is installed, duct covers must be removed before operating unit.

The Startup, Adjustments, and Checks procedure provides a step-by-step sequence which, if followed, will assure the

proper startup of the equipment in the minimum amount of time. Air balancing of duct system is not considered part of this procedure. However, it is an important phase of any air conditioning system startup and should be performed upon completion of the Startup, Adjustments, and Checks procedure. The Startup, Adjustments, and Checks procedure at outside ambients below 55°F should be limited to a readiness check of the refrigeration system with the required final check and calibration left to be completed when the outside ambient rises above 55°F.

TEMPORARY HEATING OR COOLING

If the unit is to be used for temporary heating or cooling, a "Startup, Adjustments, and Checks" must first be performed in accordance with this manual. Damage or repairs due to failure to comply with these requirements are not covered under the warranty. **After** the machines are used for temporary heating or cooling, inspect the coils, fans, and motors for unacceptable levels of construction dust and dirt and install new filters.

CONTRACTOR RESPONSIBILITY

The installing contractor must be certain that:

- All supply and return air ductwork is in place, properly sealed, and corresponds with installation instructions.
- All thermostats and sensors are mounted and wired in accordance with installation instructions.
- All electric power, all gas, hot water or steam line connections, and the condensate drain installation have been made to each unit on the job. These main supply lines must be functional and capable of operating all units simultaneously.
- All filters are in place.

ROOF CURB INSTALLATION CHECK

Inspect the roof curb for correct installation. The unit and curb assembly should be level. Inspect the flashing of the roof mounting curb to the roof, especially at the corners, for good workmanship. Also check for leaks around gaskets. Note any deficiencies in a separate report and forward to the contractor.

OBSTRUCTIONS, FAN CLEARANCE AND WIRING

Remove any extraneous construction and shipping materials that may be found during this procedure. Rotate all fans manually to check for proper clearances and that they rotate freely. Check for bolts and screws that may have jarred loose during shipment to the job site. Re-tighten if necessary. Re-tighten all electrical connections.

FIELD DUCT CONNECTIONS

Verify that all duct connections are tight and that there is no air bypass between supply and return.

FILTER SECTION CHECK

Remove filter section access panels and check that filters are properly installed. Note airflow arrows on filter frames.

PRE-STARTUP PRECAUTIONS

It is important to your safety that the unit has been properly grounded during installation. Check ground lug connection in main control box for tightness prior to closing circuit breaker or disconnect switch. Verify that supply voltage on line side of disconnect agrees with voltage on unit identification plate and is within the utilization voltage range as indicated in Appendix B Electrical Data.

System Voltage - That nominal voltage value assigned to a circuit or system for the purpose of designating its voltage class.

Nameplate Voltage - That voltage assigned to a piece of equipment for the purpose of designating its voltage class and for the purpose of defining the minimum and maximum voltage at which the equipment will operate.

Utilization Voltage - The voltage of the line terminals of the equipment at which the equipment must give fully satisfactory performance. Once it is established that supply voltage will be maintained within the utilization range under all system conditions, check and calculate if an unbalanced condition exists between phases. Calculate percent voltage unbalance as follows:

Three Phase Models Only

$$3) \text{ PERCENT VOLTAGE UNBALANCE} = 100 \times \frac{2) \text{ MAXIMUM VOLTAGE DEVIATIONS FROM AVERAGE VOLTAGE}}{1) \text{ AVERAGE VOLTAGE}}$$

HOW TO USE THE FORMULA:

EXAMPLE: With voltage of 220, 216, and 213

1) Average Voltage = $220+216+213=649 / 3 = 216$

2) Maximum Voltage Deviations from Average Voltage = $220 - 216 = 4$

3) Percent Voltage Unbalance = $100 \times \frac{4}{216} = \frac{400}{216} = 1.8\%$

Percent voltage unbalance MUST NOT exceed 2%.

AIR FLOW ADJUSTMENTS

When the final adjustments are complete, the current draw of the motor should be checked and compared to the full load current rating of the motor. The amperage must not exceed the service factor stamped on the motor nameplate.

If an economizer is installed, check the unit operating balance with the economizer at full outside air and at minimum outside air.

High stage airflow setting to be between 300 and 500 CFM per ton, see Table below. For models with electric heat the total airflow must not be less than that required for operation of the electric heaters. See Appendix D for minimum airflow for specific electric heaters.

NOTE: NEVER RUN CFM BELOW 300 CFM PER TON, EVAPORATOR FREEZING OR POOR UNIT PERFORMANCE IS POSSIBLE.

Changing Speed Taps



Adjust the CFM for the unit by changing the position of the low voltage leads on the terminal block TB1. Refer to Appendix A for blower performance at each speed tap. The below tables show the allowable speed taps and the factory locations.

NOTE: X* DENOTES FACTORY SPEED TAP LOCATION. IF MORE THAN ONE LEAD IS ENERGIZED SIMULTANEOUSLY, THE MOTOR WILL RUN AT THE HIGHER TAP. FOR PROPER OPERATION, PU CANNOT SHARE A TAP WITH YL, BR CANNOT SHARE A TAP WITH WH, AND PU/BR SHOULD HAVE HIGHER SPEED SETTINGS THAN YL/WH, RESPECTIVELY.

ALLOWABLE SPEED TAPS 3-6 TON STD STATIC AC					
ID MOTOR TAPS	T1	T2	T3	T4	T5
FAN (BK)	X*	-	-	-	-
COOLING STG 1 (YL)	X*	X	X	X	X
COOLING STG 2 (PU)	-	X	X*	X	X
E-HEAT STG 1 (WH)	-	X*	X	X	X
E-HEAT STG 2 (BR)	-	X	X*	X	X

ALLOWABLE SPEED TAPS 3-6 TON STD STATIC HP					
ID MOTOR TAPS	T1	T2	T3	T4	T5
FAN (GR)	X*	-	-	-	-
COOLING/HEATING STG 1 (YL)	X*	X	X	X	X
COOLING/HEATING STG 2 (PU)	-	X	X*	X	X
E-HEAT STG 1 (WH)	-	X*	X	X	X
E-HEAT STG 2 (BR)	-	X	X*	X	X

NOTE: FOR MOTORS WITH 10 SPEED TAPS, DH = 0VAC USES SPEED TAPS T1-T5 (FOR COOLING) AND DH = 24VAC USES T1'-T5' (FOR E-HEAT). IN E-HEAT MODE, W1 AUTOMATICALLY ENERGIZES DH.

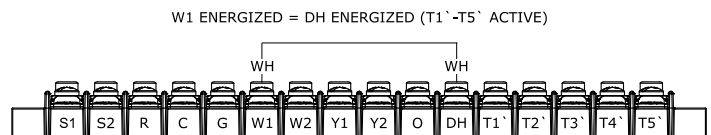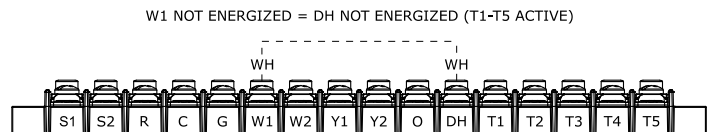

ALLOWABLE SPEED TAPS 3-6 TON HIGH STATIC AC										
ID MOTOR TAPS	T1	T2	T3	T4	T5	T1'	T2'	T3'	T4'	T5'
FAN (BK)	X*	-	-	-	-	X	-	-	-	-
COOLING STG 1 (YL)	X*	X	X	X	X	-	-	-	-	-
COOLING STG 2 (PU)	-	X	X*	X	X	-	-	-	-	-
E-HEAT STG 1 (WH)	-	-	-	-	-	X*	X	X	X	X
E-HEAT STG 2 (BR)	-	-	-	-	-	-	X	X*	X	X

ALLOWABLE SPEED TAPS 3-6 TON HIGH STATIC HP										
ID MOTOR TAPS	T1	T2	T3	T4	T5	T1'	T2'	T3'	T4'	T5'
FAN (GR)	X*	-	-	-	-	X	-	-	-	-
COOLING/HEATING STG 1 (YL)	X*	X	X	X	X	-	-	-	-	-
COOLING/HEATING STG 2 (PU)	-	X	X*	X	X	-	X	X	X	X
E-HEAT STG 1 (WH)	-	-	-	-	-	X*	X	X	X	X
E-HEAT STG 2 (BR)	-	-	-	-	-	-	X	X*	X	X

NOTE: ON UNITS WITH DDC CONTROLS INSTALLED, REFER TO THE DDC USER MANUAL FOR DETAILS ON MAKING AIRFLOW ADJUSTMENTS. INDIVIDUAL SETTINGS ARE AVAILABLE FOR FAN ONLY, LOW STAGE COOLING, HIGH STAGE COOLING, LOW STAGE HEATING, AND HIGH STAGE HEATING WHICH CAN BE ADJUSTED AS NEEDED TO MEET AIRFLOW REQUIREMENTS.

CHECKING SUBCOOLING

**SUBCOOLING = SAT LIQUID LINE TEMP
- LIQUID LINE TEMP**

EXAMPLE:

- a. Liquid Line Pressure = 417 PSI
- b. Corresponding Temp. = 120°F
- c. Thermometer on Liquid line = 109°F.

To obtain the amount of subcooling, subtract 109°F from 120°F. The difference is 11° subcooling. The appropriate range for each model is available in the Unit Subcooling and Superheat table.

NOTE: UNITS WITH A TXV SHOULD BE CHARGED TO SUBCOOLING ONLY. MAKE SURE THE AIR FLOW IS CORRECT BEFORE MAKING ANY ADJUSTMENTS.

CHECKING SUPERHEAT

**SUPERHEAT = SUCTION LINE TEMP
- SAT SUCTION LINE TEMP**

EXAMPLE:

- a. Suction Pressure = 143 PSI
- b. Corresponding Temp. = 50°F
- c. Thermometer on Suction Line = 59°F

To obtain the amount of superheat, subtract 50.0 from 59.0°F. The difference is 9° Superheat. The appropriate range for each model is available in the Unit Subcooling and Superheat table.

TXV Superheat Adjustment

NOTE: SUPERHEAT ADJUSTMENTS SHOULD NOT BE MADE UNTIL IN-DOOR AMBIENT CONDITIONS HAVE STABILIZED. THIS COULD TAKE UP TO 24 HOURS DEPENDING ON INDOOR TEMPERATURE AND HUMIDITY. BEFORE CHECKING SUPERHEAT, RUN THE UNIT IN COOLING FOR 15-20 MINUTES OR UNTIL REFRIGERANT PRESSURES STABILIZE.

Unscrew the cover from the expansion valve, locate the adjustment screw, and turn it clockwise (in) to increase superheat or counterclockwise (out) to decrease superheat. It is recommended to make small adjustments at a time, 1/8-1/4 turn increments. Replace adjustment cap. Wait a minimum of 15 minutes between adjustments to allow time for the TXV and pressures to stabilize.

Refrigerant Charge Check

NOTE: FOR OPTIMAL PERFORMANCE, FOLLOW CHARGING INSTRUCTIONS BELOW.

(Units with Fixed Orifice Devices)

All package units with fixed orifice devices are charged using the superheat method at the compressor suction line. To increase superheat, remove charge, and to decrease superheat, add charge. After superheat is adjusted, it is recommended to check unit subcooling at the condenser coil liquid line. The appropriate range for each model is available in the Unit Subcooling and Superheat table.

Units with TXV

Single Stage Cooling Application: Refer to the Unit Sub-Cooling and Superheat table.

Two-Stage Cooling Application: Run unit on Low Stage cooling and refer to Unit SubCooling and Superheat table.

1. Purge gauge lines. Connect service gauge manifold to access fittings. Run system at least 10 minutes to allow pressure to stabilize.
2. Temporarily install thermometer on liquid (small) line near liquid line access fitting with adequate contact and insulate for best possible reading.
3. Check subcooling and superheat. System should have a subcooling and superheat within the range listed on the Design Superheat and Subcooling table.
 - a. If subcooling and superheat are low, adjust TXV superheat, then check subcooling. **NOTE:** To adjust superheat, turn the valve stem clockwise to increase and counterclockwise to decrease.
 - b. If subcooling is low and superheat is high, add charge to raise subcooling then check superheat.
 - c. If subcooling and superheat are high, adjust TXV valve superheat, then check subcooling.
 - d. If subcooling is high and superheat is low, adjust TXV valve superheat and remove charge to lower the subcooling. **NOTE:** Do NOT adjust the charge based on suction pressure unless there is a gross undercharge. If an under charge is suspected recover the charge, re-evacuate the system and recharge per data plate. No adjustments should be made if suspecting a charge issue
4. Disconnect manifold set, installation is complete.

Design Superheat & Subcooling					
Model	Superheat (°F)	Subcooling (°F)	Expansion Device	Cooling Stage	Outdoor Ambient (°F)
DRC036	14 - 16	11 - 13	TXV	Low	82
DRC048	12 - 14	9 - 11	TXV	Low	82
DRC060	11 - 13	11 - 13	TXV	Low	82
DRC072	15 - 17	9 - 11	TXV	Low	82
DRH036	13 - 15	5 - 7	TXV	Low	82
DRH048	11 - 13	6 - 8	TXV	Low	82
DRH060	12 - 14	9 - 11	TXV	Low	82
DRH072	17 - 19	9 - 11	TXV	Low	82

REFRIGERATION SYSTEM CHECKS

This unit is equipped with thermal expansion valves. Ensure the hold-down bolts on the compressor are secure and have not vibrated loose during shipment. Check that the vibration grommets have been installed and visually check all piping for damage and leaks and repair if necessary. The entire system has been factory charged and tested, making it unnecessary to field charge. Factory refrigerant charge is shown on the unit's nameplate. To confirm charge levels or, if a leak occurs and charge needs to be added to the system, it is recommended to evacuate the system and recharge refrigerant to the unit's nameplate specifications. This unit has been rated in the cooling mode at the AHRI rated conditions of: indoor (80°F db/67°F wb) and outdoor (95°F db). While operating at this condition, the superheat should range from 9°F to 11°F for each refrigeration circuit measured at the suction service port located near the compressor.

START-UP PROCEDURE AND CHECKLIST

Begin with power turned off at all disconnects.



AIR CONDITIONING START-UP PROCEDURE

1. Ensure the thermostat is set to OFF and Fan is set to Auto. On units with DDC controls installed, use Test/Balance Menu to force the unit to Vent Mode. This test bypasses internal delays.
2. Inspect all registers and set them to the normal open position.
3. Turn on the electrical supply at the disconnect.
4. Turn the fan switch to the "ON" position. The blower should operate at the selected speed. On units with DDC controls installed, use Test/Balance Menu to force the unit to Vent Mode. This test bypasses internal delays.
5. Turn the fan switch to "Auto" position. The blower should stop after a 60 second delay. On units with DDC controls installed, use Test/Balance Menu to force the unit to Off Mode. This test bypasses internal delays.
6. Set the thermostat to Cool mode and slowly lower the cooling temperature until the unit starts. The compressor, blower and fan should now be operating. Allow the unit to run 10 minutes, make sure cool air is being supplied by the unit. On units with DDC controls installed, use Test/Balance Menu to force the unit to Low Cool Mode or High Cool Mode. This test bypasses internal delays.
7. Check that the compressor is operating correctly. The scroll compressors in these units MUST operate in the proper rotation. To ensure the compressors are operating in the correct direction, check the compressor discharge line pressure or temperature after the compressor is started. The discharge pressure and discharge line temperature should increase. If this does not occur and the compressor is producing an exceptional amount of noise, this indicates that there is a phasing issue.

Perform the following to correct:

- 7.1 Turn power to the unit OFF.
 - 7.2 Switch any two leads of power supply at unit Single Point Power Block.
 - 7.3 Turn power to the unit ON.
 - 7.4 Perform step 7 again.
8. Turn the temperature setting to the highest position, stopping the unit. The indoor blower will continue to run for 60 seconds.
 9. Turn the thermostat system switch to "OFF" and disconnect all power when servicing the unit. On units with DDC controls installed, use Test/Balance Menu to force the unit to Vent Mode. This test bypasses internal delays. Use Test/Balance Menu to disable Force Mode operation and allow the unit to return to normal operation.

NOTE: THE COMPRESSOR HAS A 180 SECOND RE-START DELAY ON TIMER TO AVOID SHORT CYCLING.

	WARNING
HIGH VOLTAGE! DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT. MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.	
	

HEAT PUMP START-UP PROCEDURE

10. Check the cooling mode for the heat pump in the same manner as above. The reversing valve is energized when the thermostat is placed in the cooling position. A clicking sound should be noticeable from the reversing valve. By lowering the temperature setting to call for cooling, the solenoid valve is energized. The compressor, blower and fan should then be running. After the cooling mode is checked out, turn the thermostat system switch to "OFF". On units with DDC controls installed, use Test/Balance Menu to force the unit to Off Mode. This test bypasses internal delays.
11. Turn the thermostat system switch to "HEAT" and fan switch to "AUTO". On units with DDC controls installed, use Test/Balance Menu to force the unit to Low Heat or High Heat Mode. This test bypasses internal delays.
12. Slowly raise the heating temperature setting. When the heating first stage makes contact, stop raising the temperature setting. The compressor, blower and fan should now be running with the reversing valve in the deenergized (heating) position. After giving the unit time to settle out, make sure the unit is supplying heated air.
Note: If the outdoor ambient is above 80°F, the unit may trip on its high pressure cut out when on heating. The compressor should stop. The heating cycle must be thoroughly checked, so postpone

the test to another day when conditions are more suitable but-DO NOT FAIL TO TEST. If the outdoor ambient is low and the unit operates properly on the heating cycle, you may check the pressure cutout operation by blocking off the indoor return air until the unit trips.

13. Once the heating has been confirmed, raise the temperature setting until the second stage heating makes contact. Supplemental resistance heat, if installed should now come on. Make sure it operates properly.
14. For thermostats with emergency heat switch, set thermostat to Emergency Heat mode. The heat pump will stop, the blower will continue to run, all heaters will come on and the thermostat emergency heat light will come on. Confirm heaters operate normally. On units with DDC controls installed, use Test/Balance Menu to disable Force Mode operation and allow the unit to return to normal operation.

FINAL SYSTEM CHECKS

15. Check to see if all supply and return air grilles are adjusted and the air distribution system is balanced for the best compromise between heating and cooling.
16. Check for air leaks in the ductwork. See Sections on Air Flow Adjustments.
17. Make sure the unit is free of “rattles”, and the tubing in the unit is free from excessive vibration. Also make sure tubes or lines and wires are not rubbing against each other or sheet metal surfaces or edges. If so, correct the trouble.
18. Set the thermostat at the appropriate setting for cooling and heating or automatic changeover for normal use.
19. Be sure the Owner is instructed on the unit operation, filter, servicing, correct thermostat operation, etc.

REFRIGERATION PERFORMANCE CHECK

Check that compressor RLA corresponds to values shown in Appendix B. RLA draw can be much lower than values listed at low load conditions and low ambient condensing temperatures. Values in Appendix B may be slightly exceeded at high load conditions and high ambient condensing temperatures.

HEAT PUMP OPERATION

COOLING CYCLE


When the heat pump is in the cooling cycle, it operates exactly as a Summer Air Conditioner unit. In this mode, all the charts and data for service that apply to summer air conditioning apply to the heat pump. Most apply on the heating cycle except the “condenser” becomes the “evaporator”, “evaporator” becomes “condenser”, “cooling” becomes “heating”.

HEATING CYCLE


The heat pump switches from cooling cycle by redirecting refrigerant flow through the refrigerant circuit external to the compressor. This is accomplished by the reversing valve. Hot discharge vapor from the compressor is directed to the indoor coil (evaporator on the cooling cycle) where the heat is removed, and the vapor condenses to liquid.

It then goes through the expansion device to the outdoor coil (condenser on the cooling cycle) where the liquid is evaporated, and the vapor goes to the compressor.

The following figures show a schematic of a heat pump on the cooling cycle and the heating cycle. The heat pump is equipped with thermal expansion valves for the indoor and outdoor coils. It is also provided with a defrost control system.

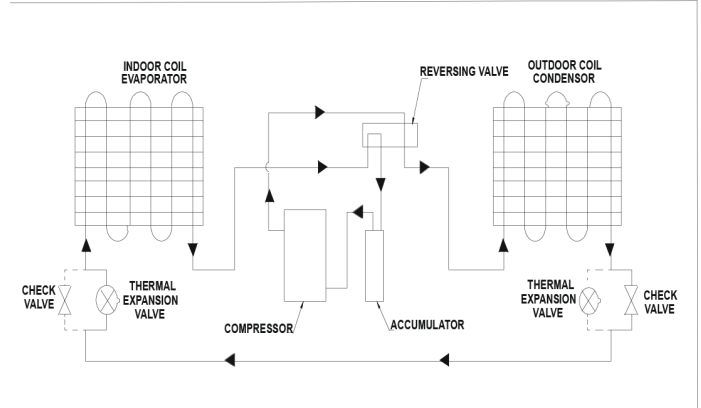

COOLING

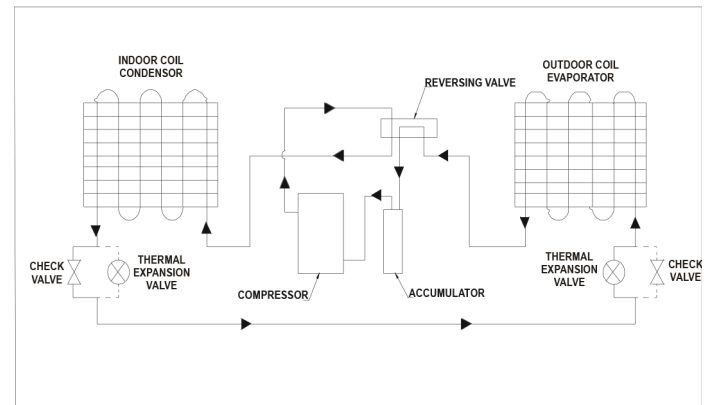

HEATING

HEATING

When the heat pump is on the heating cycle, the outdoor coil is functioning as an evaporator. The temperature of the refrigerant in the outdoor coil must be below the temperature of the outdoor air in order to extract heat from the air. Thus, the greater the difference in the outdoor temperature and the outdoor coil temperature, the greater the heating capacity of the heat pump. This phenomenon is a characteristic of a heat pump. It is a good practice to provide supplementary heat for all heat pump installations in areas where the temperature drops below 45° F. It is also a good practice to provide sufficient supplementary heat to handle the entire heating requirement should there be a component failure of the heat pump, such as a compressor, or refrigerant leak, etc.



Since the temperature of the refrigerant in the outdoor coil on the heating cycle is generally below freezing point, frost forms on the surfaces of the outdoor coil under certain weather conditions of temperature and relative humidity. Therefore, it is necessary to reverse the flow of the refrigerant to provide hot gas in the outdoor coil to melt the frost accumulation. This is accomplished by reversing


the heat pump to the cooling cycle. At the same time, the outdoor fan stops to hasten the temperature rise of the outdoor coil and lessen the time required for defrosting. The indoor blower continues to run and the supplementary heaters are energized.


DEFROST CONTROL

During operation the Defrost signal to the circuit board is controlled by a temperature sensor, which is clamped to a feeder tube entering the outdoor coil. Defrost timing periods of 30,60 and 90 minutes may be selected by connecting the circuit board jumper to 30, 60 and 90 respectively. Accumulation of time for the timing period selected starts when the sensor contact closes (approximately 31°F), and when the wall thermostat calls for heat. At the end of the timing period, the unit's defrost cycle will be initiated provided the sensor contact remains closed. When the sensor contact opens (approximately 75°F), the defrost cycle is terminated and the timing period is reset. If the defrost cycle is not terminated due to the sensor temperature, a ten minute override interrupts the unit's defrost period.

MAINTENANCE


	WARNING
<p>HIGH VOLTAGE! DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT. MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.</p>	
	

	WARNING
<p>TO PREVENT PERSONAL INJURY OR DEATH DUE TO IMPROPER INSTALLATION, ADJUSTMENT, ALTERATION, SERVICE OR MAINTENANCE, REFER TO THIS MANUAL. FOR ADDITIONAL ASSISTANCE OR INFORMATION, CONSULT A QUALIFIED INSTALLER, SERVICER AGENCY OR THE GAS SUPPLIER.</p>	

	CAUTION
<p>SHEET METAL PARTS, SCREWS, CLIPS AND SIMILAR ITEMS INHERENTLY HAVE SHARP EDGES, AND IT IS NECESSARY THAT THE INSTALLER AND SERVICE PERSONNEL EXERCISE CAUTION.</p>	

The Self Contained Packaged Air Conditioner and Heat Pump should operate for many years without excessive service calls if the unit is installed properly. However it is recommended that the owner inspect the unit before a seasonal start up. The coils should be free of debris so adequate airflow is achieved. The return and supply registers should be free of any obstructions. The filters should be cleaned or replaced. These few steps will help to keep the product up time to a maximum. The Service section that follows should help in identifying problems if the unit does not operate properly.

FILTERS

	CAUTION
<p>TO PREVENT PROPERTY DAMAGE DUE TO FIRE AND LOSS OF EQUIPMENT EFFICIENCY OR EQUIPMENT DAMAGE DUE TO DUST AND LINT BUILD UP ON INTERNAL PARTS, NEVER OPERATE UNIT WITHOUT AN AIR FILTER INSTALLED IN THE RETURN AIR SYSTEM.</p>	

Every application may require a different frequency of replacement of dirty filters. Filters must be replaced at least every three (3) months during operating seasons.

Dirty filters are the most common cause of inadequate heating or cooling performance. Filter inspection should be made at least every two months; more often if necessary because of local conditions and usage.

Dirty throwaway filters should be discarded and replaced with a new, clean filter.

Disposable return air filters are supplied with this unit. See the unit Specification Sheet or Technical Manual for the correct size and part number. To remove the filters, remove the filter access panel on return side of the unit.

CLEAN OUTSIDE COIL (QUALIFIED SERVICER ONLY)

The coil with the outside air flowing over it should be inspected annually and cleaned as frequently as necessary to keep the finned areas free of lint, hair and debris. Any air blowing or water rinsing should be performed from inside out (opposite operating airflow direction) to prevent damage to the tube and fin coil.

LUBRICATION

The supply fan motors, the condenser fan motors and compressors are permanently lubricated.

FUNCTIONAL PARTS

Refer to the unit Parts Catalog for a list of functional parts. Parts are available from your distributor.

CABINET FINISH MAINTENANCE

Use a fine grade automotive wax on the cabinet finish to maintain the finish's original high luster. This is especially important in installations with extended periods of direct sunlight.

APPENDIX A BLOWER PERFORMANCE TABLES - AC

3 Ton

Standard Static Drive

Models: DRC0361D and DRC0363D

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1080	570	0.15
	0.4	1080	620	0.16
	0.6	990	695	0.18
	0.8	890	760	0.20
	1.0	740	835	0.21
T2	0.2	1315	605	0.22
	0.4	1220	660	0.24
	0.6	1125	730	0.26
	0.8	1010	800	0.29
	1.0	945	845	0.30
T3	0.2	1315	605	0.22
	0.4	1220	660	0.24
	0.6	1125	730	0.26
	0.8	1010	800	0.29
	1.0	945	845	0.30
T4	0.2	1315	605	0.22
	0.4	1220	660	0.24
	0.6	1125	730	0.26
	0.8	1010	800	0.29
	1.0	945	845	0.30
T5	0.2	1640	740	0.38
	0.4	1540	810	0.41
	0.6	1445	860	0.44
	0.8	1340	925	0.46
	1.0	1300	985	0.50

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1100	560	0.14
	0.4	1100	610	0.16
	0.6	1010	680	0.17
	0.8	910	745	0.19
	1.0	755	820	0.21
T2	0.2	1340	595	0.21
	0.4	1245	645	0.23
	0.6	1150	715	0.26
	0.8	1030	785	0.28
	1.0	965	830	0.30
T3	0.2	1340	595	0.21
	0.4	1245	645	0.23
	0.6	1150	715	0.26
	0.8	1030	785	0.28
	1.0	965	830	0.30
T4	0.2	1340	595	0.21
	0.4	1245	645	0.23
	0.6	1150	715	0.26
	0.8	1030	785	0.28
	1.0	965	830	0.30
T5	0.2	1675	725	0.37
	0.4	1575	790	0.40
	0.6	1475	845	0.44
	0.8	1365	910	0.47
	1.0	1325	965	0.49

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

3 Ton

Standard Static Drive

Models: DRC0364D and DRC0367D

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1105	580	0.15
	0.4	935	680	0.17
	0.6	770	765	0.20
	0.8	615	820	0.21
	1.0	-	-	-
	-	-	-	-
T2	0.2	1490	685	0.28
	0.4	1370	755	0.31
	0.6	1230	840	0.34
	0.8	1075	915	0.37
	1.0	950	965	0.39
	-	-	-	-
T3	0.2	1370	650	0.23
	0.4	1250	735	0.26
	0.6	1100	820	0.29
	0.8	945	890	0.32
	1.0	815	935	0.33
	-	-	-	-
T4	0.2	1490	685	0.28
	0.4	1370	755	0.31
	0.6	1230	840	0.34
	0.8	1075	915	0.37
	1.0	950	965	0.39
	-	-	-	-
T5	0.2	1765	775	0.40
	0.4	1605	820	0.43
	0.6	1500	900	0.47
	0.8	1345	985	0.51
	1.0	1250	1050	0.54
	-	-	-	-

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1115	575	0.15
	0.4	945	675	0.17
	0.6	780	755	0.19
	0.8	620	810	0.21
	1.0	-	-	-
	-	-	-	-
T2	0.2	1505	680	0.28
	0.4	1385	745	0.30
	0.6	1240	830	0.34
	0.8	1085	905	0.37
	1.0	960	955	0.39
	-	-	-	-
T3	0.2	1385	645	0.23
	0.4	1265	730	0.26
	0.6	1110	810	0.29
	0.8	955	880	0.31
	1.0	825	925	0.33
	-	-	-	-
T4	0.2	1505	680	0.28
	0.4	1385	745	0.30
	0.6	1240	830	0.34
	0.8	1085	905	0.37
	1.0	960	955	0.39
	-	-	-	-
T5	0.2	1775	770	0.39
	0.4	1620	805	0.42
	0.6	1525	890	0.47
	0.8	1355	975	0.51
	1.0	1260	1040	0.53
	-	-	-	-

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

APPENDIX A BLOWER PERFORMANCE DATA - AC

4 Ton
Standard Static Drive
Models: DRC0481D and DRC0483D

4 Ton
Standard Static Drive
Models: DRC0484D and DRC0487D

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1190	550	0.14
	0.4	1090	600	0.15
	0.6	970	690	0.18
	0.8	855	750	0.19
	1.0	-	-	-
T2	0.2	1675	765	0.39
	0.4	1615	790	0.40
	0.6	1555	835	0.42
	0.8	1490	885	0.45
	1.0	1425	940	0.47
T3	0.2	1645	750	0.36
	0.4	1580	775	0.38
	0.6	1515	825	0.40
	0.8	1450	875	0.42
	1.0	1380	935	0.45
T4	0.2	1745	795	0.44
	0.4	1695	820	0.45
	0.6	1640	850	0.47
	0.8	1585	905	0.50
	1.0	1530	945	0.52
T5	0.2	1770	805	0.46
	0.4	1725	835	0.48
	0.6	1670	860	0.49
	0.8	1620	910	0.52
	1.0	1565	945	0.54

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1215	540	0.14
	0.4	1110	590	0.15
	0.6	990	675	0.17
	0.8	870	735	0.19
	1.0	-	-	-
T2	0.2	1710	750	0.38
	0.4	1645	775	0.39
	0.6	1585	820	0.41
	0.8	1520	865	0.44
	1.0	1455	920	0.46
T3	0.2	1680	735	0.36
	0.4	1610	760	0.37
	0.6	1545	810	0.39
	0.8	1480	860	0.42
	1.0	1410	915	0.44
T4	0.2	1780	780	0.43
	0.4	1730	805	0.44
	0.6	1675	835	0.46
	0.8	1615	885	0.49
	1.0	1560	925	0.51
T5	0.2	1805	790	0.45
	0.4	1760	820	0.47
	0.6	1705	845	0.48
	0.8	1650	890	0.51
	1.0	1595	925	0.53

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1070	585	0.15
	0.4	905	685	0.18
	0.6	755	760	0.20
	0.8	575	850	0.22
	1.0	-	-	-
T2	0.2	1755	795	0.44
	0.4	1635	850	0.47
	0.6	1525	910	0.50
	0.8	1420	975	0.53
	1.0	1310	1035	0.57
T3	0.2	1625	755	0.37
	0.4	1500	810	0.39
	0.6	1385	880	0.43
	0.8	1270	945	0.46
	1.0	1155	1010	0.49
T4	0.2	1755	795	0.44
	0.4	1635	850	0.47
	0.6	1525	910	0.50
	0.8	1420	975	0.53
	1.0	1310	1035	0.57
T5	0.2	1945	870	0.55
	0.4	1835	910	0.57
	0.6	1730	965	0.62
	0.8	1625	1020	0.65
	1.0	1535	1075	0.69

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1080	580	0.15
	0.4	915	680	0.17
	0.6	765	750	0.19
	0.8	580	840	0.22
	1.0	-	-	-
T2	0.2	1775	785	0.43
	0.4	1650	840	0.46
	0.6	1540	900	0.49
	0.8	1435	965	0.53
	1.0	1325	1025	0.56
T3	0.2	1640	745	0.36
	0.4	1515	800	0.39
	0.6	1400	870	0.42
	0.8	1285	935	0.45
	1.0	1165	1000	0.48
T4	0.2	1775	785	0.43
	0.4	1650	840	0.46
	0.6	1540	900	0.49
	0.8	1435	965	0.53
	1.0	1325	1025	0.56
T5	0.2	1970	860	0.54
	0.4	1855	930	0.57
	0.6	1745	955	0.61
	0.8	1640	1010	0.64
	1.0	1545	1065	0.68

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
 That is not recommended for High Stage cooling or heating

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
 That is not recommended for High Stage cooling or heating

APPENDIX A BLOWER PERFORMANCE TABLES - AC

5 Ton

Standard Static Drive

Models: DRC0601D and DRC0603D

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1275	635	0.21
	0.4	1160	715	0.24
	0.6	1025	790	0.26
	0.8	925	855	0.28
	1.0	-	-	-
T2	0.2	2110	910	0.74
	0.4	2030	955	0.77
	0.6	1960	1000	0.81
	0.8	1885	1050	0.85
	1.0	1845	1100	0.89
T3	0.2	1980	870	0.62
	0.4	1900	920	0.66
	0.6	1825	965	0.69
	0.8	1750	1015	0.73
	1.0	1700	1075	0.77
T4	0.2	2175	925	0.79
	0.4	2095	975	0.84
	0.6	2020	1020	0.87
	0.8	1950	1065	0.91
	1.0	1910	1115	0.96
T5	0.2	2285	955	0.91
	0.4	2200	1005	0.96
	0.6	2120	1050	1.00
	0.8	2050	1090	1.04
	1.0	2020	1135	1.08

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1300	620	0.20
	0.4	1185	700	0.23
	0.6	1045	775	0.26
	0.8	945	840	0.28
	1.0	-	-	-
T2	0.2	2150	890	0.72
	0.4	2070	935	0.76
	0.6	2000	980	0.79
	0.8	1925	1030	0.83
	1.0	1880	1080	0.87
T3	0.2	2020	855	0.61
	0.4	1940	900	0.64
	0.6	1860	945	0.68
	0.8	1785	995	0.71
	1.0	1735	1055	0.75
T4	0.2	2220	905	0.78
	0.4	2135	955	0.82
	0.6	2060	1000	0.86
	0.8	1990	1045	0.90
	1.0	1950	1095	0.94
T5	0.2	2330	935	0.89
	0.4	2245	985	0.94
	0.6	2160	1030	0.98
	0.8	2090	1070	1.02
	1.0	2060	1110	1.06

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

5 Ton

Standard Static Drive

Models: DRC0604D and DRC0607D

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1305	655	0.22
	0.4	1180	735	0.24
	0.6	1050	815	0.27
	0.8	910	895	0.30
	1.0	-	-	-
T2	0.2	1950	860	0.55
	0.4	1860	910	0.58
	0.6	1780	960	0.62
	0.8	1695	1015	0.65
	1.0	1580	1080	0.69
T3	0.2	2070	900	0.64
	0.4	1985	945	0.68
	0.6	1910	995	0.71
	0.8	1835	1040	0.74
	1.0	1730	1100	0.79
T4	0.2	2030	890	0.61
	0.4	1945	935	0.65
	0.6	1870	980	0.68
	0.8	1790	1030	0.71
	1.0	1680	1095	0.76
T5	0.2	2155	940	0.70
	0.4	2105	980	0.74
	0.6	2005	1020	0.78
	0.8	1935	1065	0.81
	1.0	1845	1120	0.86

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1320	650	0.21
	0.4	1190	730	0.24
	0.6	1060	805	0.27
	0.8	920	885	0.29
	1.0	-	-	-
T2	0.2	1970	850	0.55
	0.4	1880	900	0.58
	0.6	1800	950	0.61
	0.8	1710	1005	0.65
	1.0	1595	1070	0.69
T3	0.2	2090	890	0.64
	0.4	2005	935	0.67
	0.6	1930	985	0.70
	0.8	1855	1030	0.74
	1.0	1745	1090	0.78
T4	0.2	2050	880	0.61
	0.4	1965	925	0.64
	0.6	1890	970	0.67
	0.8	1810	1020	0.70
	1.0	1695	1085	0.75
T5	0.2	2175	930	0.70
	0.4	2100	965	0.73
	0.6	2025	1010	0.76
	0.8	1960	1055	0.80
	1.0	1865	1110	0.85

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

APPENDIX A BLOWER PERFORMANCE TABLES - AC

6 Ton Cooler

Standard Static Drive

Models: DRC0723D, DRC0724D and DRC0727D

Down Flow					
SPEED TAP	TORQUE OZ-FT	EXTERNAL STATIC PRESSURE (ESP), IN WC	SCFM	RPM	BHP
T1	28	0.2	1394	635	0.21
		0.4	1265	711	0.24
		0.6	1127	805	0.27
		0.8	983	885	0.29
		1.0	855	952	0.32
T2	78	0.2	2301	832	0.77
		0.4	2229	882	0.82
		0.6	2156	929	0.86
		0.8	2083	979	0.91
		1.0	2011	1033	0.96
T3	65	0.2	2226	892	0.69
		0.4	2143	931	0.72
		0.6	2052	973	0.75
		0.8	1950	1027	0.79
		1.0	1861	1080	0.84
T4	78	0.2	2301	903	0.84
		0.4	2229	935	0.87
		0.6	2156	987	0.92
		0.8	2083	1034	0.96
		1.0	2011	1080	1.00
T5	80	0.2	2435	972	0.93
		0.4	2362	1007	0.96
		0.6	2293	1043	0.99
		0.8	2209	1086	1.03
		1.0	2124	1134	1.08

Horizontal Flow					
SPEED TAP	TORQUE OZ-FT	EXTERNAL STATIC PRESSURE (ESP), IN WC	SCFM	RPM	BHP
T1	28	0.2	1382	642	0.21
		0.4	1259	724	0.24
		0.6	1160	799	0.27
		0.8	1016	879	0.29
		1.0	899	948	0.32
T2	78	0.2	2348.22	926	0.86
		0.4	2274.11	973	0.90
		0.6	2200	1020	0.95
		0.8	2125.89	1066	0.99
		1.0	2051.78	1113	1.03
T3	65	0.2	2211	885	0.68
		0.4	2128	938	0.73
		0.6	2034	988	0.76
		0.8	1950	1042	0.81
		1.0	1859	1098	0.85
T4	78	0.2	2348.22	926	0.86
		0.4	2274.11	973	0.90
		0.6	2200	1020	0.95
		0.8	2125.89	1066	0.99
		1.0	2051.78	1113	1.03
T5	80	0.2	2404	961	0.91
		0.4	2347	995	0.95
		0.6	2273	1050	1.00
		0.8	2193	1100	1.05
		1.0	2111	1149	1.09

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating
MIN CFM 1800 / MAX BHP 1.2

APPENDIX A BLOWER PERFORMANCE TABLES - AC

**3 Ton Cooler
High Static Drive**

Models: DRC0363W, DRC0364W, DRC0367W

DOWNFLOW									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	751	654	0.13	0.4	-	-	-		
0.6	589	740	0.15	0.6	-	-	-		
0.8	404	813	0.16	0.8	1398	959	0.50		
1.0	-	-	-	1.0	1246	1037	0.54		
1.2	-	-	-	1.2	1140	1090	0.57		
1.4	-	-	-	1.4	1040	1136	0.59		
1.6	-	-	-	1.6	918	1196	0.63		
1.8	-	-	-	1.8	799	1252	0.66		
2.0	-	-	-	2.0	-	-	-		
T2 C	0.2	1237	614	0.18	T2' H	0.2	-	-	-
	0.4	1095	704	0.21		0.4	-	-	-
	0.6	924	794	0.24		0.6	-	-	-
	0.8	792	863	0.26		0.8	-	-	-
	1.0	640	937	0.28		1.0	-	-	-
	1.2	485	990	0.29		1.2	1259	1109	0.63
	1.4	-	-	-		1.4	1155	1160	0.66
	1.6	-	-	-		1.6	1060	1205	0.69
	1.8	-	-	-		1.8	947	1260	0.72
	2.0	-	-	-		2.0	830	1312	0.75
T3 C	0.2	-	-	-	T3' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	1259	1109	0.63		1.2	1524	1059	0.67
	1.4	1155	1160	0.66		1.4	1273	1179	0.74
	1.6	1060	1205	0.69		1.6	1179	1227	0.77
	1.8	947	1260	0.72		1.8	1081	1273	0.80
	2.0	830	1312	0.75		2.0	964	1327	0.84
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	1524	1059	0.67		1.2	-	-	-
	1.4	1273	1179	0.74		1.4	-	-	-
	1.6	1179	1227	0.77		1.6	1284	1249	0.86
	1.8	1081	1273	0.80		1.8	1197	1294	0.89
	2.0	964	1327	0.84		2.0	1095	1337	0.92
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	-	-	-		1.2	1750	1195	0.97
	1.4	-	-	-		1.4	1650	1240	1.00
	1.6	1393	1269	0.94		1.6	1550	1300	1.06
	1.8	1307	1312	0.97		1.8	1485	1335	1.09
	2.0	1218	1354	1.00		2.0	1405	1370	1.12

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

**3 Ton Cooler
High Static Drive**

Models: DRC0363W, DRC0364W, DRC0367W

Horizontal									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	729	642	0.13	0.4	-	-	-		
0.6	562	735	0.15	0.6	-	-	-		
0.8	-	-	-	0.8	1362	958	0.50		
1.0	-	-	-	1.0	1238	1016	0.53		
1.2	-	-	-	1.2	1115	1072	0.56		
1.4	-	-	-	1.4	1014	1128	0.59		
1.6	-	-	-	1.6	925	1184	0.62		
1.8	-	-	-	1.8	791	1229	0.64		
2.0	-	-	-	2.0	-	-	-		
T2 C	0.2	1216	609	0.18	T2' H	0.2	-	-	-
	0.4	1065	708	0.21		0.4	-	-	-
	0.6	906	784	0.23		0.6	-	-	-
	0.8	766	854	0.25		0.8	1482	973	0.56
	1.0	629	923	0.27		1.0	1351	1039	0.59
	1.2	460	977	0.29		1.2	1239	1089	0.62
	1.4	-	-	-		1.4	1136	1139	0.65
	1.6	-	-	-		1.6	1041	1193	0.68
	1.8	-	-	-		1.8	949	1249	0.71
	2.0	-	-	-		2.0	843	1289	0.74
T3 C	0.2	-	-	-	T3' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	1482	973	0.56		0.8	-	-	-
	1.0	1351	1039	0.59		1.0	1463	1060	0.67
	1.2	1239	1089	0.62		1.2	1349	1109	0.70
	1.4	1136	1139	0.65		1.4	1251	1160	0.73
	1.6	1041	1193	0.68		1.6	1145	1209	0.76
	1.8	949	1249	0.71		1.8	1062	1259	0.79
	2.0	843	1289	0.74		2.0	970	1310	0.83
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	1463	1060	0.67		1.0	-	-	-
	1.2	1349	1109	0.70		1.2	1461	1133	0.78
	1.4	1251	1160	0.73		1.4	1359	1180	0.81
	1.6	1145	1209	0.76		1.6	1259	1228	0.85
	1.8	1062	1259	0.79		1.8	1162	1278	0.88
	2.0	970	1310	0.83		2.0	1082	1325	0.91
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	-	-	-		1.2	1670	1180	0.96
	1.4	1453	1195	0.88		1.4	1610	1225	0.99
	1.6	1358	1241	0.92		1.6	1510	1265	1.04
	1.8	1262	1286	0.95		1.8	1410	1305	1.07
	2.0	1193	1339	0.99		2.0	1360	1365	1.11

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

For motors with 10 speed taps, DH=0 VAC uses speed taps T1C-T5C (for cooling) and DH=24VAC uses T1'H-T5'H (for E-HEAT)

APPENDIX A BLOWER PERFORMANCE TABLES - AC

4 Ton Cooler

High Static Drive

Models: DRC0483W, DRC0484W, DRC0487W

DOWNFLOW									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	773	658	0.14	0.4	1878	923	0.63		
0.6	609	738	0.16	0.6	1777	974	0.66		
0.8	414	822	0.18	0.8	1675	1029	0.70		
1.0	-	-	-	1.0	1580	1083	0.73		
1.2	-	-	-	1.2	1484	1136	0.77		
1.4	-	-	-	1.4	1365	1194	0.81		
1.6	-	-	-	1.6	1258	1243	0.84		
1.8	-	-	-	1.8	1161	1288	0.87		
2.0	-	-	-	2.0	1045	1341	0.91		
T2 C	0.2	1512	715	0.31	T2' H	0.2	-	-	-
	0.4	1380	783	0.34		0.4	1988	955	0.72
	0.6	1260	855	0.37		0.6	1891	1003	0.75
	0.8	1139	923	0.40		0.8	1791	1054	0.79
	1.0	1009	988	0.42		1.0	1691	1110	0.83
	1.2	893	1045	0.45		1.2	1606	1159	0.87
	1.4	753	1113	0.48		1.4	1513	1211	0.91
	1.6	511	1207	0.52		1.6	1389	1269	0.95
	1.8	629	1159	0.50		1.8	1283	1314	0.98
	2.0	-	-	-		2.0	1191	1357	1.02
T3 C	0.2	-	-	-	T3' H	0.2	-	-	-
	0.4	1988	955	0.72		0.4	-	-	-
	0.6	1891	1003	0.75		0.6	1999	1036	0.85
	0.8	1791	1054	0.79		0.8	1900	1085	0.89
	1.0	1691	1110	0.83		1.0	1802	1140	0.94
	1.2	1606	1159	0.87		1.2	1714	1191	0.98
	1.4	1513	1211	0.91		1.4	1623	1237	1.02
	1.6	1389	1269	0.95		1.6	1519	1292	1.06
	1.8	1283	1314	0.98		1.8	1407	1340	1.10
	2.0	1191	1357	1.02		2.0	1313	1385	1.14
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	1914	1162	1.02		1.0	1914	1162	1.02
	1.2	1827	1211	1.07		1.2	1827	1211	1.07
	1.4	1747	1254	1.10		1.4	1747	1254	1.10
	1.6	1655	1304	1.15		1.6	1655	1304	1.15
	1.8	1542	1356	1.19		1.8	1542	1356	1.19
	2.0	1444	1398	1.23		2.0	1444	1398	1.23
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	1992	1233	1.17		1.2	1992	1233	1.17
	1.4	1909	1276	1.22		1.4	1909	1276	1.22
	1.6	1830	1321	1.26		1.6	1830	1321	1.26
	1.8	1732	1373	1.31		1.8	1732	1373	1.31
	2.0	1601	1418	1.35		2.0	1601	1418	1.35

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

4 Ton Cooler

High Static Drive

Models: DRC0483W, DRC0484W, DRC0487W

Horizontal									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	806	646	0.14	0.4	1928	895	0.61		
0.6	652	737	0.16	0.6	1853	938	0.64		
0.8	473	826	0.18	0.8	1758	989	0.67		
1.0	-	-	-	1.0	1676	1038	0.70		
1.2	-	-	-	1.2	1576	1100	0.75		
1.4	-	-	-	1.4	1452	1165	0.79		
1.6	-	-	-	1.6	1337	1220	0.83		
1.8	-	-	-	1.8	1250	1268	0.86		
2.0	-	-	-	2.0	1165	1314	0.89		
T2 C	0.2	1547	698	0.30	T2' H	0.2	-	-	-
	0.4	1451	754	0.32		0.4	-	-	-
	0.6	1343	817	0.35		0.6	1965	970	0.73
	0.8	1203	903	0.39		0.8	1885	1014	0.76
	1.0	1076	972	0.42		1.0	1797	1063	0.80
	1.2	964	1032	0.44		1.2	1707	1114	0.84
	1.4	808	1115	0.48		1.4	1600	1180	0.88
	1.6	696	1164	0.50		1.6	1483	1239	0.93
	1.8	907	1206	0.52		1.8	1383	1291	0.97
	2.0	460	1247	0.53		2.0	1293	1330	1.00
T3 C	0.2	-	-	-	T3' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	1965	970	0.73		0.6	-	-	-
	0.8	1885	1014	0.76		0.8	1999	1041	0.86
	1.0	1797	1063	0.80		1.0	1912	1090	0.90
	1.2	1707	1114	0.84		1.2	1834	1133	0.93
	1.4	1600	1180	0.88		1.4	1736	1190	0.98
	1.6	1483	1239	0.93		1.6	1634	1251	1.03
	1.8	1383	1291	0.97		1.8	1516	1304	1.07
	2.0	1293	1330	1.00		2.0	1419	1350	1.11
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	1944	1154	1.02		1.2	1944	1154	1.02
	1.4	1863	1205	1.06		1.4	1863	1205	1.06
	1.6	1765	1265	1.11		1.6	1765	1265	1.11
	1.8	1656	1318	1.16		1.8	1656	1318	1.16
	2.0	1544	1366	1.20		2.0	1544	1366	1.20
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	-	-	-		1.2	-	-	-
	1.4	1970	1223	1.16		1.4	1970	1223	1.16
	1.6	1888	1273	1.21		1.6	1888	1273	1.21
	1.8	1789	1328	1.26		1.8	1789	1328	1.26
	2.0	1676	1382	1.32		2.0	1676	1382	1.32

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

For motors with 10 speed taps, DH=0 VAC uses speed taps T1C-T5C (for cooling) and DH=24VAC uses T1'H-T5'H (for E-HEAT)

APPENDIX A BLOWER PERFORMANCE TABLES - AC

5 Ton Cooler

High Static Drive

Models: DRC0603W, DRC0604W, DRC0607W

DOWNFLOW									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	853	673	0.14	0.4	2196	1038	0.89		
0.6	677	764	0.16	0.6	2095	1090	0.93		
0.8	537	845	0.18	0.8	2011	1142	0.98		
1.0	-	-	-	1.0	1926	1192	1.02		
1.2	-	-	-	1.2	1847	1237	1.06		
1.4	-	-	-	1.4	1774	1281	1.10		
1.6	-	-	-	1.6	1698	1324	1.13		
1.8	-	-	-	1.8	1602	1371	1.17		
2.0	-	-	-	2.0	1517	1417	1.21		
T2 C	0.2	1815	829	0.46	T2' H	0.2	2360	1024	0.94
	0.4	1706	891	0.50		0.4	2275	1067	0.98
	0.6	1611	956	0.53		0.6	2189	1118	1.02
	0.8	1510	1013	0.57		0.8	2114	1169	1.07
	1.0	1422	1066	0.60		1.0	2031	1217	1.12
	1.2	1325	1121	0.63		1.2	1955	1261	1.16
	1.4	1217	1175	0.66		1.4	1878	1303	1.19
	1.6	1113	1231	0.69		1.6	1808	1344	1.23
	1.8	1008	1286	0.72		1.8	1722	1385	1.27
	2.0	924	1332	0.75		2.0	1645	1429	1.31
T3 C	0.2	2360	1024	0.94	T3' H	0.2	2452	1053	1.04
	0.4	2275	1067	0.98		0.4	2366	1103	1.09
	0.6	2189	1118	1.02		0.6	2282	1144	1.13
	0.8	2114	1169	1.07		0.8	2205	1193	1.18
	1.0	2031	1217	1.12		1.0	2123	1241	1.23
	1.2	1955	1261	1.16		1.2	2050	1286	1.27
	1.4	1878	1303	1.19		1.4	1981	1328	1.31
	1.6	1808	1344	1.23		1.6	1909	1367	1.35
	1.8	1722	1385	1.27		1.8	1829	1406	1.39
	2.0	1645	1429	1.31		2.0	1753	1448	1.43
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	2459	1132	1.20		0.4	2459	1132	1.20
	0.6	2369	1170	1.24		0.6	2369	1170	1.24
	0.8	2286	1217	1.29		0.8	2286	1217	1.29
	1.0	2225	1263	1.34		1.0	2225	1263	1.34
	1.2	2151	1307	1.38		1.2	2151	1307	1.38
	1.4	2075	1349	1.43		1.4	2075	1349	1.43
	1.6	2002	1386	1.47		1.6	2002	1386	1.47
	1.8	1939	1426	1.51		1.8	1939	1426	1.51
	2.0	1855	1463	1.55		2.0	1855	1463	1.55
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	2453	1197	1.35		0.6	2453	1197	1.35
	0.8	2363	1243	1.41		0.8	2363	1243	1.41
	1.0	2285	1291	1.46		1.0	2285	1291	1.46
	1.2	2226	1331	1.50		1.2	2226	1331	1.50
	1.4	2159	1372	1.55		1.4	2159	1372	1.55
	1.6	2090	1409	1.59		1.6	2090	1409	1.59
	1.8	2029	1445	1.63		1.8	2029	1445	1.63
	2.0	1954	1483	1.68		2.0	1954	1483	1.68

Shaded are indicates air flow below 1500 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

5 Ton Cooler

High Static Drive

Models: DRC0603W, DRC0604W, DRC0607W

Horizontal									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	1068	581	0.12	0.4	2239	1004	0.86		
0.6	904	683	0.15	0.6	2160	1053	0.90		
0.8	752	769	0.16	0.8	2075	1100	0.94		
1.0	597	846	0.18	1.0	2001	1155	0.99		
1.2	401	888	0.19	1.2	1939	1205	1.03		
1.4	-	-	-	1.4	1833	1268	1.09		
1.6	-	-	-	1.6	1750	1318	1.13		
1.8	-	-	-	1.8	1660	1365	1.17		
2.0	-	-	-	2.0	1575	1410	1.21		
T2 C	0.2	1842	806	0.45	T2' H	0.2	2396	992	0.91
	0.4	1742	866	0.48		0.4	2324	1031	0.94
	0.6	1658	927	0.52		0.6	2260	1079	0.99
	0.8	1569	993	0.56		0.8	2179	1124	1.03
	1.0	1458	1058	0.59		1.0	2110	1179	1.08
	1.2	1355	1118	0.63		1.2	2051	1220	1.12
	1.4	1260	1174	0.66		1.4	1945	1285	1.18
	1.6	1158	1228	0.69		1.6	1867	1336	1.22
	1.8	1069	1279	0.72		1.8	1783	1380	1.26
	2.0	985	1324	0.74		2.0	1698	1427	1.31
T3 C	0.2	2396	992	0.91	T3' H	0.2	2477	1024	1.01
	0.4	2324	1031	0.94		0.4	2407	1058	1.05
	0.6	2260	1079	0.99		0.6	2335	1103	1.09
	0.8	2179	1124	1.03		0.8	2277	1151	1.14
	1.0	2110	1179	1.08		1.0	2202	1197	1.18
	1.2	2051	1220	1.12		1.2	2151	1245	1.23
	1.4	1945	1285	1.18		1.4	2056	1304	1.29
	1.6	1867	1336	1.22		1.6	1970	1358	1.34
	1.8	1783	1380	1.26		1.8	1891	1403	1.39
	2.0	1698	1427	1.31		2.0	1803	1443	1.43
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	2491	1085	1.15		0.4	2491	1085	1.15
	0.6	2422	1125	1.19		0.6	2422	1125	1.19
	0.8	2349	1168	1.24		0.8	2349	1168	1.24
	1.0	2289	1212	1.28		1.0	2289	1212	1.28
	1.2	2209	1268	1.34		1.2	2209	1268	1.34
	1.4	2166	1309	1.39		1.4	2166	1309	1.39
	1.6	2069	1366	1.45		1.6	2069	1366	1.45
	1.8	1994	1411	1.49		1.8	1994	1411	1.49
	2.0	1915	1456	1.54		2.0	1915	1456	1.54
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	2434	1194	1.35		0.8	2434	1194	1.35
	1.0	2372	1238	1.40		1.0	2372	1238	1.40
	1.2	2304	1298	1.47		1.2	2304	1298	1.47
	1.4	2244	1334	1.51		1.4	2244	1334	1.51
	1.6	2169	1381	1.56		1.6	2169	1381	1.56
	1.8	2085	1434	1.62		1.8	2085	1434	1.62
	2.0	2006	1477	1.67		2.0	2006	1477	1.67

Shaded are indicates air flow below 1500 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

For motors with 10 speed taps, DH=0 VAC uses speed taps T1C-T5C (for cooling) and DH=24VAC uses T1'H-T5'H (for E-HEAT)

APPENDIX A BLOWER PERFORMANCE TABLES - AC

**6 Ton Cooler
High Static Drive**

Models: DRC0723W, DRC0724W, DRC0727W

DOWNFLOW									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	1262	751	0.25	0.4	2538	1108	1.23		
0.6	1145	821	0.27	0.6	2448	1148	1.27		
0.8	1017	899	0.30	0.8	2372	1195	1.32		
1.0	884	968	0.32	1.0	2299	1246	1.38		
1.2	756	1030	0.34	1.2	2224	1282	1.42		
1.4	564	1069	0.36	1.4	2160	1326	1.47		
1.6	442	1118	0.37	1.6	2092	1364	1.51		
1.8	-	-	-	1.8	2021	1405	1.55		
2.0	-	-	-	2.0	1946	1448	1.60		
T2 C	0.2	2010	864	0.57	T2' H	0.2	2731	1111	1.34
	0.4	1918	920	0.60		0.4	2655	1146	1.38
	0.6	1808	985	0.64		0.6	2570	1188	1.43
	0.8	1733	1033	0.68		0.8	2483	1234	1.48
	1.0	1637	1085	0.71		1.0	2410	1280	1.54
	1.2	1549	1139	0.75		1.2	2337	1322	1.59
	1.4	1452	1196	0.78		1.4	2290	1356	1.63
	1.6	1348	1249	0.82		1.6	2219	1392	1.67
	1.8	1245	1298	0.85		1.8	2156	1435	1.72
	2.0	1152	1348	0.88		2.0	2085	1473	1.77
T3 C	0.2	2731	1111	1.34	T3' H	0.2	2815	1142	1.45
	0.4	2655	1146	1.38		0.4	2741	1177	1.50
	0.6	2570	1188	1.43		0.6	2668	1211	1.54
	0.8	2483	1234	1.48		0.8	2585	1255	1.60
	1.0	2410	1280	1.54		1.0	2507	1302	1.66
	1.2	2337	1322	1.59		1.2	2436	1350	1.72
	1.4	2290	1356	1.63		1.4	2369	1383	1.76
	1.6	2219	1392	1.67		1.6	2320	1416	1.80
	1.8	2156	1435	1.72		1.8	2255	1454	1.85
	2.0	2085	1473	1.77		2.0	2188	1492	1.90
T4 C	0.2	2815	1142	1.45	T4' H	0.2	2903	1176	1.61
	0.4	2741	1177	1.50		0.4	2829	1204	1.65
	0.6	2668	1211	1.54		0.6	2769	1242	1.70
	0.8	2585	1255	1.60		0.8	2681	1284	1.76
	1.0	2507	1302	1.66		1.0	2601	1323	1.81
	1.2	2436	1350	1.72		1.2	2530	1372	1.88
	1.4	2369	1383	1.76		1.4	2466	1406	1.92
	1.6	2320	1416	1.80		1.6	2424	1440	1.97
	1.8	2255	1454	1.85		1.8	2356	1476	2.02
	2.0	2188	1492	1.90		2.0	-	-	-
T5 C	0.2	2970	1200	1.74	T5' H	0.2	2970	1200	1.74
	0.4	2905	1236	1.79		0.4	2905	1236	1.79
	0.6	2841	1268	1.84		0.6	2841	1268	1.84
	0.8	2759	1308	1.90		0.8	2759	1308	1.90
	1.0	2681	1348	1.96		1.0	2681	1348	1.96
	1.2	2606	1398	2.03		1.2	2606	1398	2.03
	1.4	2550	1436	2.09		1.4	2550	1436	2.09
	1.6	2485	1470	2.13		1.6	2485	1470	2.13
	1.8	-	-	-		1.8	-	-	-
	2.0	-	-	-		2.0	-	-	-

Shaded are indicates air flow below 1800 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

**6 Ton Cooler
High Static Drive**

Models: DRC0723W, DRC0724W, DRC0727W

Horizontal									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	1261	737	0.25	0.4	2545	1095	1.21		
0.6	1130	818	0.27	0.6	2475	1130	1.25		
0.8	1012	894	0.30	0.8	2400	1171	1.30		
1.0	884	966	0.32	1.0	2333	1220	1.35		
1.2	765	1026	0.34	1.2	2261	1271	1.41		
1.4	638	1092	0.36	1.4	2216	1317	1.46		
1.6	487	1113	0.37	1.6	2137	1372	1.52		
1.8	-	-	-	1.8	2053	1421	1.57		
2.0	-	-	-	2.0	1976	1461	1.62		
T2 C	0.2	2021	852	0.56	T2' H	0.2	2690	1108	1.33
	0.4	1942	897	0.59		0.4	2634	1140	1.37
	0.6	1854	951	0.62		0.6	2576	1165	1.40
	0.8	1762	1025	0.67		0.8	2509	1206	1.45
	1.0	1670	1086	0.71		1.0	2440	1251	1.50
	1.2	1586	1140	0.75		1.2	2370	1297	1.56
	1.4	1485	1197	0.78		1.4	2307	1348	1.62
	1.6	1384	1252	0.82		1.6	2244	1390	1.67
	1.8	1287	1306	0.85		1.8	2177	1441	1.73
	2.0	1198	1352	0.89		2.0	2092	1484	1.78
T3 C	0.2	2690	1108	1.33	T3' H	0.2	2797	1137	1.45
	0.4	2634	1140	1.37		0.4	2745	1163	1.48
	0.6	2576	1165	1.40		0.6	2680	1194	1.52
	0.8	2509	1206	1.45		0.8	2612	1231	1.57
	1.0	2440	1251	1.50		1.0	2537	1272	1.62
	1.2	2370	1297	1.56		1.2	2463	1316	1.68
	1.4	2307	1348	1.62		1.4	2420	1357	1.73
	1.6	2244	1390	1.67		1.6	2356	1397	1.78
	1.8	2177	1441	1.73		1.8	2292	1444	1.84
	2.0	2092	1484	1.78		2.0	2216	1491	1.90
T4 C	0.2	2797	1137	1.45	T4' H	0.2	2878	1159	1.59
	0.4	2745	1163	1.48		0.4	2819	1189	1.63
	0.6	2680	1194	1.52		0.6	2763	1218	1.67
	0.8	2612	1231	1.57		0.8	2712	1250	1.71
	1.0	2537	1272	1.62		1.0	2640	1288	1.76
	1.2	2463	1316	1.68		1.2	2572	1330	1.82
	1.4	2420	1357	1.73		1.4	2507	1375	1.88
	1.6	2356	1397	1.78		1.6	2440	1426	1.95
	1.8	2292	1444	1.84		1.8	2402	1460	2.00
	2.0	2216	1491	1.90		2.0	-	-	-
T5 C	0.2	2961	1195	1.74	T5' H	0.2	2961	1195	1.74
	0.4	2904	1226	1.78		0.4	2904	1226	1.78
	0.6	2848	1253	1.82		0.6	2848	1253	1.82
	0.8	2794	1276	1.85		0.8	2794	1276	1.85
	1.0	2733	1315	1.91		1.0	2733	1315	1.91
	1.2	2669	1358	1.97		1.2	2669	1358	1.97
	1.4	2608	1394	2.02		1.4	2608	1394	2.02
	1.6	2546	1441	2.09		1.6	2546	1441	2.09
	1.8	2497	1483	2.15		1.8	2497	1483	2.15
	2.0	-	-	-		2.0	-	-	-

Shaded are indicates air flow below 1800 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

For motors with 10 speed taps, DH=0 VAC uses speed taps T1C-T5C (for cooling) and DH=24VAC uses T1'H-T5'H (for E-HEAT)

APPENDIX A BLOWER PERFORMANCE TABLES - HEAT PUMP

3 Ton Heat Pump
Standard Static Drive
Models: DRH0361D and DRH0363D

DOWNFLOW					HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1095	595	0.15	T1	0.2	1140	585	0.14
	0.4	975	680	0.17		0.4	1015	665	0.16
	0.6	815	770	0.19		0.6	850	755	0.18
	0.8	695	845	0.21		0.8	725	830	0.20
	1.0	-	-	-		1.0	-	-	-
T2	0.2	1610	760	0.36	T2	0.2	1675	745	0.35
	0.4	1525	820	0.39		0.4	1585	805	0.38
	0.6	1440	885	0.42		0.6	1500	865	0.41
	0.8	1335	950	0.45		0.8	1390	930	0.44
	1.0	-	-	-		1.0	-	-	-
T3	0.2	1320	670	0.23	T3	0.2	1375	655	0.22
	0.4	1220	740	0.25		0.4	1270	725	0.25
	0.6	1100	815	0.28		0.6	1145	800	0.27
	0.8	985	890	0.30		0.8	1025	870	0.30
	1.0	-	-	-		1.0	-	-	-
T4	0.2	1415	700	0.27	T4	0.2	1470	685	0.26
	0.4	1315	765	0.29		0.4	1370	750	0.29
	0.6	1215	840	0.32		0.6	1265	825	0.31
	0.8	1100	910	0.35		0.8	1145	890	0.34
	1.0	-	-	-		1.0	-	-	-
T5	0.2	1725	795	0.43	T5	0.2	1795	780	0.42
	0.4	1640	850	0.46		0.4	1705	835	0.45
	0.6	1565	910	0.49		0.6	1630	890	0.48
	0.8	1465	975	0.52		0.8	1525	955	0.51
	1.0	-	-	-		1.0	-	-	-

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

3 Ton Heat Pump
Standard Static Drive
Models: DRH0364D and DRH0367D

DOWNFLOW					HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1125	585	0.14	T1	0.2	1150	575	0.14
	0.4	1005	670	0.16		0.4	1025	655	0.16
	0.6	840	765	0.19		0.6	855	750	0.18
	0.8	715	850	0.21		0.8	730	835	0.20
	1.0	-	-	-		1.0	-	-	-
T2	0.2	1415	660	0.24	T2	0.2	1445	645	0.23
	0.4	1310	740	0.26		0.4	1335	725	0.26
	0.6	1200	815	0.29		0.6	1225	800	0.29
	0.8	1085	890	0.32		0.8	1105	870	0.31
	1.0	-	-	-		1.0	-	-	-
T3	0.2	1370	650	0.22	T3	0.2	1395	635	0.22
	0.4	1265	730	0.25		0.4	1290	715	0.24
	0.6	1145	805	0.27		0.6	1170	790	0.27
	0.8	1030	885	0.30		0.8	1050	865	0.29
	1.0	-	-	-		1.0	-	-	-
T4	0.2	1415	660	0.24	T4	0.2	1445	645	0.23
	0.4	1310	740	0.26		0.4	1335	725	0.26
	0.6	1200	815	0.29		0.6	1225	800	0.29
	0.8	1085	890	0.32		0.8	1105	870	0.31
	1.0	-	-	-		1.0	-	-	-
T5	0.2	1650	730	0.33	T5	0.2	1685	715	0.33
	0.4	1565	800	0.36		0.4	1595	785	0.35
	0.6	1485	860	0.39		0.6	1510	845	0.39
	0.8	1390	930	0.43		0.8	1420	910	0.42
	1.0	-	-	-		1.0	-	-	-

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

APPENDIX A BLOWER PERFORMANCE TABLES - HEAT PUMP

4 Ton Heat Pump
Standard Static Drive
Models: DRH0481D and DRH0483D

4 Ton Heat Pump
Standard Static Drive
Models: DRH0484D and DRH0487D

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1070	605	0.14
	0.4	940	695	0.17
	0.6	795	775	0.18
	0.8	660	845	0.20
	1.0	-	-	-
T2	0.2	1930	870	0.58
	0.4	1840	925	0.62
	0.6	1760	980	0.65
	0.8	1675	1040	0.69
	1.0	-	-	-
T3	0.2	1670	785	0.41
	0.4	1570	850	0.44
	0.6	1475	915	0.47
	0.8	1380	980	0.51
	1.0	-	-	-
T4	0.2	1930	870	0.58
	0.4	1840	925	0.62
	0.6	1760	980	0.65
	0.8	1675	1040	0.69
	1.0	-	-	-
T5	0.2	2075	915	0.70
	0.4	1990	965	0.73
	0.6	1915	1020	0.78
	0.8	1835	1075	0.82
	1.0	-	-	-

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1080	600	0.14
	0.4	950	690	0.16
	0.6	805	765	0.18
	0.8	665	835	0.20
	1.0	-	-	-
T2	0.2	1950	860	0.57
	0.4	1860	915	0.61
	0.6	1780	970	0.65
	0.8	1690	1030	0.69
	1.0	-	-	-
T3	0.2	1685	775	0.40
	0.4	1585	840	0.43
	0.6	1490	905	0.47
	0.8	1395	970	0.50
	1.0	-	-	-
T4	0.2	1950	860	0.57
	0.4	1860	915	0.61
	0.6	1780	970	0.65
	0.8	1690	1030	0.69
	1.0	-	-	-
T5	0.2	2095	905	0.69
	0.4	2010	955	0.73
	0.6	1935	1010	0.77
	0.8	1855	1065	0.81
	1.0	-	-	-

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1090	580	0.14
	0.4	960	675	0.16
	0.6	795	770	0.18
	0.8	675	845	0.20
	1.0	-	-	-
T2	0.2	1790	790	0.43
	0.4	1705	850	0.47
	0.6	1615	910	0.50
	0.8	1525	970	0.53
	1.0	-	-	-
T3	0.2	1730	775	0.40
	0.4	1645	835	0.43
	0.6	1550	895	0.46
	0.8	1455	960	0.50
	1.0	-	-	-
T4	0.2	1790	790	0.43
	0.4	1705	850	0.47
	0.6	1615	910	0.50
	0.8	1525	970	0.53
	1.0	-	-	-
T5	0.2	1900	830	0.50
	0.4	1825	880	0.53
	0.6	1740	935	0.57
	0.8	1655	995	0.60
	1.0	-	-	-

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1125	565	0.13
	0.4	990	655	0.16
	0.6	820	745	0.18
	0.8	695	820	0.20
	1.0	-	-	-
T2	0.2	1845	765	0.42
	0.4	1755	825	0.45
	0.6	1665	885	0.48
	0.8	1570	940	0.51
	1.0	-	-	-
T3	0.2	1780	750	0.39
	0.4	1695	810	0.42
	0.6	1595	870	0.45
	0.8	1500	930	0.48
	1.0	-	-	-
T4	0.2	1845	765	0.42
	0.4	1755	825	0.45
	0.6	1665	885	0.48
	0.8	1570	940	0.51
	1.0	-	-	-
T5	0.2	1955	805	0.49
	0.4	1880	855	0.52
	0.6	1790	905	0.55
	0.8	1705	965	0.59
	1.0	-	-	-

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
 That is not recommended for High Stage cooling or heating

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
 That is not recommended for High Stage cooling or heating

APPENDIX A BLOWER PERFORMANCE TABLES - HEAT PUMP

5 Ton Heat Pump
Standard Static Drive
Models: DRH0601D and DRH0603D

5 Ton Heat Pump
Standard Static Drive
Models: DRH0604D and DRH0607D

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1335	650	0.22
	0.4	1220	730	0.24
	0.6	1090	820	0.27
	0.8	975	890	0.30
	1.0	-	-	-
T2	0.2	2045	885	0.64
	0.4	1970	930	0.67
	0.6	1890	980	0.71
	0.8	1800	1040	0.75
	1.0	-	-	-
T3	0.2	2035	880	0.63
	0.4	1955	925	0.66
	0.6	1875	975	0.70
	0.8	1785	1040	0.74
	1.0	-	-	-
T4	0.2	2280	965	0.86
	0.4	2205	1010	0.90
	0.6	2130	1055	0.94
	0.8	2050	1105	0.99
	1.0	-	-	-
T5	0.2	2345	990	0.94
	0.4	2270	1035	0.99
	0.6	2195	1080	1.03
	0.8	2120	1125	1.07
	1.0	-	-	-

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1350	655	0.22
	0.4	1230	735	0.24
	0.6	1100	830	0.28
	0.8	985	900	0.30
	1.0	-	-	-
T2	0.2	2065	895	0.65
	0.4	1990	940	0.68
	0.6	1910	990	0.72
	0.8	1820	1050	0.76
	1.0	-	-	-
T3	0.2	2055	890	0.64
	0.4	1975	935	0.67
	0.6	1895	985	0.70
	0.8	1805	1050	0.75
	1.0	-	-	-
T4	0.2	2305	975	0.87
	0.4	2225	1020	0.91
	0.6	2150	1065	0.95
	0.8	2070	1115	1.00
	1.0	-	-	-
T5	0.2	2370	1000	0.95
	0.4	2295	1045	0.99
	0.6	2215	1090	1.04
	0.8	2140	1135	1.08
	1.0	-	-	-

DOWNFLOW				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1340	640	0.21
	0.4	1230	720	0.24
	0.6	1115	800	0.27
	0.8	985	880	0.29
	1.0	-	-	-
T2	0.2	1970	825	0.53
	0.4	1880	880	0.57
	0.6	1790	940	0.60
	0.8	1715	995	0.64
	1.0	-	-	-
T3	0.2	2100	865	0.62
	0.4	2010	915	0.65
	0.6	1925	970	0.69
	0.8	1855	1025	0.73
	1.0	-	-	-
T4	0.2	2055	850	0.59
	0.4	1965	905	0.62
	0.6	1880	960	0.66
	0.8	1810	1015	0.70
	1.0	-	-	-
T5	0.2	2175	890	0.67
	0.4	2085	940	0.70
	0.6	2005	990	0.74
	0.8	1940	1040	0.78
	1.0	-	-	-

HORIZONTAL				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
T1	0.2	1365	620	0.21
	0.4	1255	700	0.23
	0.6	1135	775	0.26
	0.8	1005	855	0.28
	1.0	-	-	-
T2	0.2	2010	800	0.51
	0.4	1920	855	0.55
	0.6	1825	910	0.58
	0.8	1750	965	0.62
	1.0	-	-	-
T3	0.2	2140	840	0.60
	0.4	2050	890	0.64
	0.6	1965	940	0.67
	0.8	1890	995	0.71
	1.0	-	-	-
T4	0.2	2095	825	0.57
	0.4	2005	880	0.61
	0.6	1920	930	0.64
	0.8	1845	985	0.68
	1.0	-	-	-
T5	0.2	2220	865	0.65
	0.4	2125	910	0.69
	0.6	2050	960	0.72
	0.8	1975	1010	0.76
	1.0	-	-	-

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
 That is not recommended for High Stage cooling or heating

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
 That is not recommended for High Stage cooling or heating

APPENDIX A BLOWER PERFORMANCE TABLES - HEAT PUMP

6 Ton Heat Pump

Standard Static Drive

Models: DRH0723D, DRH0724D and DRH0727D

Down Flow					Horizontal Flow				
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN WC	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN WC	SCFM	RPM	BHP
T1	0.2	1394	635	0.21	T1	0.2	1382	642	0.21
	0.4	1265	711	0.24		0.4	1259	724	0.24
	0.6	1127	805	0.27		0.6	1160	799	0.27
	0.8	983	885	0.29		0.8	1016	879	0.29
	1.0	855	952	0.32		1.0	899	948	0.32
T2	0.2	2301	832	0.77	T2	0.2	2348	926	0.86
	0.4	2229	882	0.82		0.4	2274	973	0.90
	0.6	2156	929	0.86		0.6	2200	1020	0.95
	0.8	2083	979	0.91		0.8	2126	1066	0.99
	1.0	2011	1033	0.96		1.0	2052	1113	1.03
T3	0.2	2226	892	0.69	T3	0.2	2211	885	0.68
	0.4	2143	931	0.72		0.4	2128	938	0.73
	0.6	2052	973	0.75		0.6	2034	988	0.76
	0.8	1950	1027	0.79		0.8	1950	1042	0.81
	1.0	1861	1080	0.84		1.0	1859	1098	0.85
T4	0.2	2301	903	0.84	T4	0.2	2348	926	0.86
	0.4	2229	935	0.87		0.4	2274	973	0.90
	0.6	2156	987	0.92		0.6	2200	1020	0.95
	0.8	2083	1034	0.96		0.8	2126	1066	0.99
	1.0	2011	1080	1.00		1.0	2052	1113	1.03
T5	0.2	2435	972	0.93	T5	0.2	2404	961	0.91
	0.4	2362	1007	0.96		0.4	2347	995	0.95
	0.6	2293	1043	0.99		0.6	2273	1050	1.00
	0.8	2209	1086	1.03		0.8	2193	1100	1.05
	1.0	2124	1134	1.08		1.0	2111	1149	1.09

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating

APPENDIX A BLOWER PERFORMANCE TABLES - HEAT PUMP

**3 Ton Heat Pump
High Static Drive**

Models: DRH0363W, DRH0364W, DRH0367W

DOWNFLOW									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	713	603	0.12	0.4	-	-	-		
0.6	569	679	0.14	0.6	1489	825	0.43		
0.8	396	743	0.15	0.8	1397	886	0.46		
1.0	218	780	0.16	1.0	1275	956	0.50		
1.2	-	-	-	1.2	1173	1009	0.53		
1.4	-	-	-	1.4	1087	1054	0.55		
1.6	-	-	-	1.6	991	1104	0.58		
1.8	-	-	-	1.8	914	1148	0.60		
2.0	-	-	-	2.0	831	1187	0.62		
T2 C	0.2	1170	597	0.18	T2' H	0.2	-	-	-
	0.4	1083	662	0.20		0.4	-	-	-
	0.6	928	742	0.22		0.6	-	-	-
	0.8	808	805	0.24		0.8	-	-	-
	1.0	712	865	0.26		1.0	1399	969	0.55
	1.2	574	923	0.27		1.2	1287	1023	0.58
	1.4	428	969	0.29		1.4	1191	1072	0.61
	1.6	272	995	0.30		1.6	1111	1117	0.64
	1.8	-	-	-		1.8	1020	1164	0.67
	2.0	-	-	-		2.0	948	1207	0.69
T3 C	0.2	-	-	-	T3' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	1489	825	0.43		0.6	-	-	-
	0.8	1397	886	0.46		0.8	-	-	-
	1.0	1275	956	0.50		1.0	1476	977	0.62
	1.2	1173	1009	0.53		1.2	1365	1039	0.66
	1.4	1087	1054	0.55		1.4	1274	1084	0.68
	1.6	991	1104	0.58		1.6	1186	1129	0.71
	1.8	914	1148	0.60		1.8	1103	1175	0.74
	2.0	831	1187	0.62		2.0	1019	1219	0.77
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	1476	977	0.62		1.0	-	-	-
	1.2	1365	1039	0.66		1.2	1438	1048	0.72
	1.4	1274	1084	0.68		1.4	1348	1099	0.76
	1.6	1186	1129	0.71		1.6	1260	1143	0.79
	1.8	1103	1175	0.74		1.8	1188	1184	0.82
	2.0	1019	1219	0.77		2.0	1100	1228	0.85
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	-	-	-		1.2	1705	1090	0.91
	1.4	1439	1112	0.82		1.4	1620	1145	0.97
	1.6	1358	1157	0.85		1.6	1545	1185	1.00
	1.8	1279	1195	0.88		1.8	1470	1220	1.03
	2.0	1174	1233	0.91		2.0	1360	1260	1.07

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

**3 Ton Heat Pump
High Static Drive**

Models: DRH0363W, DRH0364W, DRH0367W

Horizontal									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	728	641	0.13	0.4	-	-	-		
0.6	581	722	0.15	0.6	-	-	-		
0.8	404	790	0.16	0.8	1426	941	0.49		
1.0	222	830	0.17	1.0	1301	1016	0.53		
1.2	-	-	-	1.2	1197	1072	0.56		
1.4	-	-	-	1.4	1109	1120	0.59		
1.6	-	-	-	1.6	1011	1173	0.61		
1.8	-	-	-	1.8	933	1220	0.64		
2.0	-	-	-	2.0	848	1261	0.66		
T2 C	0.2	1194	634	0.19	T2' H	0.2	-	-	-
	0.4	1105	703	0.21		0.4	-	-	-
	0.6	947	788	0.23		0.6	-	-	-
	0.8	824	855	0.25		0.8	-	-	-
	1.0	727	920	0.27		1.0	1428	1030	0.59
	1.2	586	982	0.29		1.2	1313	1087	0.62
	1.4	437	1031	0.31		1.4	1215	1139	0.65
	1.6	278	1059	0.32		1.6	1134	1187	0.68
	1.8	-	-	-		1.8	1041	1237	0.71
	2.0	-	-	-		2.0	967	1282	0.73
T3 C	0.2	-	-	-	T3' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	1426	941	0.49		0.8	-	-	-
	1.0	1301	1016	0.53		1.0	-	-	-
	1.2	1197	1072	0.56		1.2	1393	1104	0.70
	1.4	1109	1120	0.59		1.4	1300	1152	0.73
	1.6	1011	1173	0.61		1.6	1210	1200	0.76
	1.8	933	1220	0.64		1.8	1126	1248	0.79
	2.0	848	1261	0.66		2.0	1040	1295	0.82
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	1393	1104	0.70		1.2	1467	1114	0.77
	1.4	1300	1152	0.73		1.4	1375	1168	0.81
	1.6	1210	1200	0.76		1.6	1286	1214	0.84
	1.8	1126	1248	0.79		1.8	1212	1258	0.87
	2.0	1040	1295	0.82		2.0	1122	1305	0.90
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	-	-	-		1.2	1740	1160	0.98
	1.4	1468	1181	0.87		1.4	1655	1215	1.03
	1.6	1386	1229	0.91		1.6	1565	1260	1.07
	1.8	1305	1270	0.94		1.8	1500	1295	1.10
	2.0	1198	1310	0.97		2.0	1380	1340	1.14

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

For motors with 10 speed taps, DH=0 VAC uses speed taps T1C-T5C (for cooling) and DH=24VAC uses T1'H-T5'H (for E-HEAT)

APPENDIX A BLOWER PERFORMANCE TABLES - HEAT PUMP

4 Ton Heat Pump
High Static Drive

Models: DRH0483W, DRH0484W, DRH0487W

DOWNFLOW									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	887	617	0.13	0.4	1860	842	0.57		
0.6	732	700	0.15	0.6	1798	885	0.60		
0.8	602	773	0.17	0.8	1730	929	0.63		
1.0	456	837	0.18	1.0	1653	976	0.66		
1.2	350	885	0.19	1.2	1575	1028	0.70		
1.4	-	-	-	1.4	1445	1095	0.74		
1.6	-	-	-	1.6	1343	1148	0.78		
1.8	-	-	-	1.8	1255	1191	0.81		
2.0	-	-	-	2.0	1181	1233	0.84		
T2 C	0.2	1587	685	0.29	T2 H	0.2	2012	850	0.64
	0.4	1507	739	0.32		0.4	1944	886	0.66
	0.6	1425	795	0.34		0.6	1880	918	0.69
	0.8	1337	851	0.36		0.8	1819	951	0.71
	1.0	1189	932	0.40		1.0	1743	993	0.74
	1.2	1069	991	0.42		1.2	1670	1038	0.78
	1.4	989	1042	0.45		1.4	1568	1092	0.82
	1.6	1056	827	0.35		1.6	1448	1154	0.87
	1.8	-	-	-		1.8	1354	1201	0.90
	2.0	-	-	-		2.0	1293	1228	0.92
T3 C	0.2	1930	814	0.55	T3 H	0.2	-	-	-
	0.4	1860	842	0.57		0.4	2016	894	0.73
	0.6	1798	885	0.60		0.6	1948	936	0.77
	0.8	1730	929	0.63		0.8	1894	968	0.79
	1.0	1653	976	0.66		1.0	1823	1009	0.83
	1.2	1575	1028	0.70		1.2	1749	1056	0.87
	1.4	1445	1095	0.74		1.4	1661	1102	0.90
	1.6	1343	1148	0.78		1.6	1537	1167	0.96
	1.8	1255	1191	0.81		1.8	1435	1218	1.00
	2.0	1181	1233	0.84		2.0	1348	1261	1.04
T4 C	0.2	-	-	-	T4 H	0.2	-	-	-
	0.4	2016	894	0.73		0.4	-	-	-
	0.6	1948	936	0.77		0.6	-	-	-
	0.8	1894	968	0.79		0.8	1964	988	0.87
	1.0	1823	1009	0.83		1.0	1896	1024	0.90
	1.2	1749	1056	0.87		1.2	1823	1068	0.94
	1.4	1661	1102	0.90		1.4	1744	1115	0.98
	1.6	1537	1167	0.96		1.6	1645	1172	1.03
	1.8	1435	1218	1.00		1.8	1523	1233	1.09
	2.0	1348	1261	1.04		2.0	1434	1274	1.12
T5 C	0.2	-	-	-	T5 H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	2043	1052	1.00		1.0	2043	1052	1.00
	1.2	1971	1092	1.04		1.2	1971	1092	1.04
	1.4	1901	1137	1.08		1.4	1901	1137	1.08
	1.6	1821	1180	1.12		1.6	1821	1180	1.12
	1.8	1706	1243	1.18		1.8	1706	1243	1.18
	2.0	1602	1289	1.23		2.0	1602	1289	1.23

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

4 Ton Heat Pump
High Static Drive

Models: DRH0483W, DRH0484W, DRH0487W

Horizontal									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	905	656	0.14	0.4	1898	895	0.61		
0.6	747	745	0.16	0.6	1835	940	0.64		
0.8	614	822	0.18	0.8	1765	987	0.67		
1.0	465	890	0.19	1.0	1687	1037	0.70		
1.2	357	941	0.20	1.2	1607	1092	0.74		
1.4	-	-	-	1.4	1475	1163	0.79		
1.6	-	-	-	1.6	1371	1220	0.83		
1.8	-	-	-	1.8	1281	1265	0.86		
2.0	-	-	-	2.0	1206	1310	0.89		
T2 C	0.2	1619	728	0.31	T2 H	0.2	-	-	-
	0.4	1538	785	0.34		0.4	1983	941	0.71
	0.6	1455	845	0.36		0.6	1918	975	0.73
	0.8	1364	904	0.39		0.8	1856	1010	0.76
	1.0	1213	990	0.42		1.0	1779	1055	0.79
	1.2	1091	1053	0.45		1.2	1704	1103	0.83
	1.4	1010	1107	0.47		1.4	1600	1160	0.87
	1.6	1161	880	0.38		1.6	1477	1226	0.92
	1.8	-	-	-		1.8	1382	1276	0.96
	2.0	-	-	-		2.0	1320	1305	0.98
T3 C	0.2	1969	865	0.59	T3 H	0.2	-	-	-
	0.4	1898	895	0.61		0.4	-	-	-
	0.6	1835	940	0.64		0.6	1988	995	0.82
	0.8	1765	987	0.67		0.8	1933	1028	0.84
	1.0	1687	1037	0.70		1.0	1860	1072	0.88
	1.2	1607	1092	0.74		1.2	1785	1122	0.92
	1.4	1475	1163	0.79		1.4	1695	1171	0.96
	1.6	1371	1220	0.83		1.6	1569	1240	1.02
	1.8	1281	1265	0.86		1.8	1464	1294	1.06
	2.0	1206	1310	0.89		2.0	1376	1340	1.10
T4 C	0.2	-	-	-	T4 H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	1988	995	0.82		0.6	-	-	-
	0.8	1933	1028	0.84		0.8	-	-	-
	1.0	1860	1072	0.88		1.0	1935	1088	0.96
	1.2	1785	1122	0.92		1.2	1860	1135	1.00
	1.4	1695	1171	0.96		1.4	1780	1185	1.04
	1.6	1569	1240	1.02		1.6	1679	1245	1.10
	1.8	1464	1294	1.06		1.8	1554	1310	1.15
	2.0	1376	1340	1.10		2.0	1463	1354	1.19
T5 C	0.2	-	-	-	T5 H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	-	-	-		0.8	-	-	-
	1.0	-	-	-		1.0	-	-	-
	1.2	2010	1160	1.10		1.2	2010	1160	1.10
	1.4	1939	1208	1.15		1.4	1939	1208	1.15
	1.6	1857	1254	1.19		1.6	1857	1254	1.19
	1.8	1739	1321	1.26		1.8	1739	1321	1.26
	2.0	1634	1370	1.30		2.0	1634	1370	1.30

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

For motors with 10 speed taps, DH=0 VAC uses speed taps T1C-T5C (for cooling) and DH=24VAC uses T1'H-T5'H (for E-HEAT)

APPENDIX A BLOWER PERFORMANCE TABLES - HEAT PUMP

5 Ton Heat Pump
High Static Drive

Models: DRH0603W, DRH0604W, DRH0607W

DOWNFLOW									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	1046	550	0.13	0.4	2194	945	0.81		
0.6	886	646	0.15	0.6	2117	991	0.85		
0.8	737	726	0.17	0.8	2034	1035	0.89		
1.0	585	802	0.19	1.0	1961	1087	0.93		
1.2	393	834	0.20	1.2	1900	1134	0.97		
1.4	-	-	-	1.4	1797	1193	1.02		
1.6	-	-	-	1.6	1715	1240	1.06		
1.8	-	-	-	1.8	1627	1285	1.10		
2.0	-	-	-	2.0	1544	1327	1.14		
T2 C	0.2	1805	758	0.45	T2' H	0.2	2348	933	0.86
	0.4	1707	815	0.48		0.4	2277	970	0.89
	0.6	1625	872	0.52		0.6	2215	1015	0.93
	0.8	1538	935	0.56		0.8	2135	1058	0.97
	1.0	1429	996	0.59		1.0	2067	1110	1.02
	1.2	1328	1052	0.63		1.2	2010	1148	1.05
	1.4	1235	1105	0.66		1.4	1906	1209	1.11
	1.6	1135	1154	0.69		1.6	1829	1257	1.15
	1.8	1048	1202	0.72		1.8	1747	1299	1.19
	2.0	965	1245	0.74		2.0	1664	1343	1.23
T3 C	0.2	2348	933	0.86	T3' H	0.2	2427	963	0.95
	0.4	2277	970	0.89		0.4	2359	996	0.98
	0.6	2215	1015	0.93		0.6	2288	1038	1.03
	0.8	2135	1058	0.97		0.8	2232	1083	1.07
	1.0	2067	1110	1.02		1.0	2158	1127	1.11
	1.2	2010	1148	1.05		1.2	2108	1171	1.16
	1.4	1906	1209	1.11		1.4	2015	1227	1.21
	1.6	1829	1257	1.15		1.6	1931	1278	1.26
	1.8	1747	1299	1.19		1.8	1853	1320	1.30
	2.0	1664	1343	1.23		2.0	1767	1358	1.34
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	2442	1021	1.08		0.4	2442	1021	1.08
	0.6	2374	1059	1.12		0.6	2374	1059	1.12
	0.8	2302	1099	1.16		0.8	2302	1099	1.16
	1.0	2243	1141	1.21		1.0	2243	1141	1.21
	1.2	2164	1194	1.26		1.2	2164	1194	1.26
	1.4	2123	1232	1.30		1.4	2123	1232	1.30
	1.6	2028	1286	1.36		1.6	2028	1286	1.36
	1.8	1922	1328	1.41		1.8	1922	1328	1.41
	2.0	1877	1370	1.45		2.0	1877	1370	1.45
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	2454	1085	1.23		0.6	2454	1085	1.23
	0.8	2385	1124	1.27		0.8	2385	1124	1.27
	1.0	2324	1165	1.32		1.0	2324	1165	1.32
	1.2	2258	1222	1.38		1.2	2258	1222	1.38
	1.4	2199	1256	1.42		1.4	2199	1256	1.42
	1.6	2126	1300	1.47		1.6	2126	1300	1.47
	1.8	2043	1350	1.53		1.8	2043	1350	1.53
	2.0	1901	1390	1.57		2.0	1901	1390	1.57

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

5 Ton Heat Pump
High Static Drive

Models: DRH0603W, DRH0604W, DRH0607W

Horizontal									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	1068	585	0.14	0.4	2239	1004	0.86		
0.6	904	687	0.16	0.6	2160	1053	0.90		
0.8	752	772	0.18	0.8	2075	1100	0.94		
1.0	597	853	0.20	1.0	2001	1155	0.99		
1.2	401	888	0.21	1.2	1939	1205	1.03		
1.4	-	-	-	1.4	1833	1268	1.09		
1.6	-	-	-	1.6	1750	1318	1.13		
1.8	-	-	-	1.8	1660	1365	1.17		
2.0	-	-	-	2.0	1575	1410	1.21		
T2 C	0.2	1842	806	0.48	T2' H	0.2	2396	992	0.91
	0.4	1742	866	0.51		0.4	2324	1031	0.94
	0.6	1658	927	0.55		0.6	2260	1079	0.99
	0.8	1569	993	0.59		0.8	2179	1124	1.03
	1.0	1458	1058	0.63		1.0	2110	1179	1.08
	1.2	1355	1118	0.66		1.2	2051	1220	1.12
	1.4	1260	1174	0.70		1.4	1945	1285	1.18
	1.6	1158	1228	0.73		1.6	1867	1336	1.22
	1.8	1069	1279	0.76		1.8	1783	1380	1.26
	2.0	985	1324	0.79		2.0	1698	1427	1.31
T3 C	0.2	2396	992	0.91	T3' H	0.2	2477	1024	1.01
	0.4	2324	1031	0.94		0.4	2407	1058	1.05
	0.6	2260	1079	0.99		0.6	2335	1103	1.09
	0.8	2179	1124	1.03		0.8	2277	1151	1.14
	1.0	2110	1179	1.08		1.0	2202	1197	1.18
	1.2	2051	1220	1.12		1.2	2151	1245	1.23
	1.4	1945	1285	1.18		1.4	2056	1304	1.29
	1.6	1867	1336	1.22		1.6	1970	1358	1.34
	1.8	1783	1380	1.26		1.8	1891	1403	1.39
	2.0	1698	1427	1.31		2.0	1803	1443	1.43
T4 C	0.2	-	-	-	T4' H	0.2	-	-	-
	0.4	2491	1085	1.15		0.4	2491	1085	1.15
	0.6	2422	1125	1.19		0.6	2422	1125	1.19
	0.8	2349	1168	1.24		0.8	2349	1168	1.24
	1.0	2289	1212	1.28		1.0	2289	1212	1.28
	1.2	2209	1268	1.34		1.2	2209	1268	1.34
	1.4	2166	1309	1.39		1.4	2166	1309	1.39
	1.6	2069	1366	1.45		1.6	2069	1366	1.45
	1.8	1961	1411	1.49		1.8	1961	1411	1.49
	2.0	1915	1456	1.54		2.0	1915	1456	1.54
T5 C	0.2	-	-	-	T5' H	0.2	-	-	-
	0.4	-	-	-		0.4	-	-	-
	0.6	-	-	-		0.6	-	-	-
	0.8	2434	1194	1.35		0.8	2434	1194	1.35
	1.0	2372	1238	1.40		1.0	2372	1238	1.40
	1.2	2304	1298	1.47		1.2	2304	1298	1.47
	1.4	2244	1334	1.51		1.4	2244	1334	1.51
	1.6	2169	1381	1.56		1.6	2169	1381	1.56
	1.8	2085	1434	1.62		1.8	2085	1434	1.62
	2.0	1940	1477	1.67		2.0	1940	1477	1.67

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

For motors with 10 speed taps, DH=0 VAC uses speed taps T1C-T5C (for cooling) and DH=24VAC uses T1'H-T5'H (for E-HEAT)

APPENDIX A BLOWER PERFORMANCE TABLES - HEAT PUMP

6 Ton Heat Pump
High Static Drive

Models: DRH0723W, DRH0724W, DRH0727W

DOWNFLOW									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	1262	751	0.25	0.4	2538	1108	1.23		
0.6	1145	821	0.27	0.6	2448	1148	1.27		
0.8	1017	899	0.30	0.8	2372	1195	1.32		
1.0	884	968	0.32	1.0	2299	1246	1.38		
1.2	756	1030	0.34	1.2	2224	1282	1.42		
1.4	564	1069	0.36	1.4	2160	1326	1.47		
1.6	442	1118	0.37	1.6	2092	1364	1.51		
1.8	-	-	-	1.8	2021	1405	1.55		
2.0	-	-	-	2.0	1946	1448	1.60		
T2 C	0.2	2209	928	0.72	T2' H	0.2	2731	1111	1.34
	0.4	2122	975	0.75		0.4	2655	1146	1.38
	0.6	2013	1037	0.80		0.6	2570	1188	1.43
	0.8	1925	1088	0.84		0.8	2483	1234	1.48
	1.0	1848	1131	0.88		1.0	2410	1280	1.54
	1.2	1762	1182	0.91		1.2	2337	1322	1.59
	1.4	1675	1230	0.95		1.4	2290	1356	1.63
	1.6	1584	1282	0.99		1.6	2219	1392	1.67
	1.8	1486	1332	1.03		1.8	2156	1435	1.72
	2.0	1399	1379	1.07		2.0	2085	1473	1.77
T3 C	0.2	2731	1111	1.34	T3' H	0.2	2815	1142	1.45
	0.4	2655	1146	1.38		0.4	2741	1177	1.50
	0.6	2570	1188	1.43		0.6	2668	1211	1.54
	0.8	2483	1234	1.48		0.8	2585	1255	1.60
	1.0	2410	1280	1.54		1.0	2507	1302	1.66
	1.2	2337	1322	1.59		1.2	2436	1350	1.72
	1.4	2290	1356	1.63		1.4	2369	1383	1.76
	1.6	2219	1392	1.67		1.6	2320	1416	1.80
	1.8	2156	1435	1.72		1.8	2255	1454	1.85
	2.0	2085	1473	1.77		2.0	2188	1492	1.90
T4 C	0.2	2815	1142	1.45	T4' H	0.2	2903	1176	1.61
	0.4	2741	1177	1.50		0.4	2829	1204	1.65
	0.6	2668	1211	1.54		0.6	2769	1242	1.70
	0.8	2585	1255	1.60		0.8	2681	1284	1.76
	1.0	2507	1302	1.66		1.0	2601	1323	1.81
	1.2	2436	1350	1.72		1.2	2530	1372	1.88
	1.4	2369	1383	1.76		1.4	2466	1406	1.92
	1.6	2320	1416	1.80		1.6	2424	1440	1.97
	1.8	2255	1454	1.85		1.8	2356	1476	2.02
	2.0	2188	1492	1.90		2.0	-	-	-
T5 C	0.2	2970	1200	1.74	T5' H	0.2	2970	1200	1.74
	0.4	2905	1236	1.79		0.4	2905	1236	1.79
	0.6	2841	1268	1.84		0.6	2841	1268	1.84
	0.8	2759	1308	1.90		0.8	2759	1308	1.90
	1.0	2681	1348	1.96		1.0	2681	1348	1.96
	1.2	2606	1398	2.03		1.2	2606	1398	2.03
	1.4	2550	1436	2.09		1.4	2550	1436	2.09
	1.6	2485	1470	2.13		1.6	2485	1470	2.13
	1.8	-	-	-		1.8	-	-	-
	2.0	-	-	-		2.0	-	-	-

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

6 Ton Heat Pump
High Static Drive

Models: DRH0723W, DRH0724W, DRH0727W

Horizontal									
SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP	SPEED TAP	EXTERNAL STATIC PRESSURE (ESP), IN W.C.	SCFM	RPM	BHP
0.4	1261	737	0.25	0.4	2545	1095	1.21		
0.6	1130	818	0.27	0.6	2475	1130	1.25		
0.8	1012	894	0.30	0.8	2400	1171	1.30		
1.0	884	966	0.32	1.0	2333	1220	1.35		
1.2	765	1026	0.34	1.2	2261	1271	1.41		
1.4	638	1092	0.36	1.4	2216	1317	1.46		
1.6	487	1113	0.37	1.6	2137	1372	1.52		
1.8	-	-	-	1.8	2053	1421	1.57		
2.0	-	-	-	2.0	1976	1461	1.62		
T2 C	0.2	2205	917	0.71	T2' H	0.2	2690	1108	1.33
	0.4	2137	957	0.74		0.4	2634	1140	1.37
	0.6	2060	1007	0.78		0.6	2576	1165	1.40
	0.8	1966	1062	0.82		0.8	2509	1206	1.45
	1.0	1891	1128	0.87		1.0	2440	1251	1.50
	1.2	1803	1184	0.92		1.2	2370	1297	1.56
	1.4	1716	1234	0.95		1.4	2307	1348	1.62
	1.6	1627	1283	0.99		1.6	2244	1390	1.67
	1.8	1532	1336	1.03		1.8	2177	1441	1.73
	2.0	1442	1386	1.07		2.0	2092	1484	1.78
T3 C	0.2	2690	1108	1.33	T3' H	0.2	2797	1137	1.45
	0.4	2634	1140	1.37		0.4	2745	1163	1.48
	0.6	2576	1165	1.40		0.6	2680	1194	1.52
	0.8	2509	1206	1.45		0.8	2612	1231	1.57
	1.0	2440	1251	1.50		1.0	2537	1272	1.62
	1.2	2370	1297	1.56		1.2	2463	1316	1.68
	1.4	2307	1348	1.62		1.4	2420	1357	1.73
	1.6	2244	1390	1.67		1.6	2356	1397	1.78
	1.8	2177	1441	1.73		1.8	2292	1444	1.84
	2.0	2092	1484	1.78		2.0	2216	1491	1.90
T4 C	0.2	2797	1137	1.45	T4' H	0.2	2878	1159	1.59
	0.4	2745	1163	1.48		0.4	2819	1189	1.63
	0.6	2680	1194	1.52		0.6	2763	1218	1.67
	0.8	2612	1231	1.57		0.8	2712	1250	1.71
	1.0	2537	1272	1.62		1.0	2640	1288	1.76
	1.2	2463	1316	1.68		1.2	2572	1330	1.82
	1.4	2420	1357	1.73		1.4	2507	1375	1.88
	1.6	2356	1397	1.78		1.6	2440	1426	1.95
	1.8	2292	1444	1.84		1.8	2402	1460	2.00
	2.0	2216	1491	1.90		2.0	-	-	-
T5 C	0.2	2961	1195	1.74	T5' H	0.2	2961	1195	1.74
	0.4	2904	1226	1.78		0.4	2904	1226	1.78
	0.6	2848	1253	1.82		0.6	2848	1253	1.82
	0.8	2794	1276	1.85		0.8	2794	1276	1.85
	1.0	2733	1315	1.91		1.0	2733	1315	1.91
	1.2	2669	1358	1.97		1.2	2669	1358	1.97
	1.4	2608	1394	2.02		1.4	2608	1394	2.02
	1.6	2546	1441	2.09		1.6	2546	1441	2.09
	1.8	2497	1483	2.15		1.8	2497	1483	2.15
	2.0	-	-	-		2.0	-	-	-

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton)
That is not recommended for High Stage cooling or heating

For motors with 10 speed taps, DH=0 VAC uses speed taps T1C-T5C (for cooling) and DH=24VAC uses T1'H-T5'H (for E-HEAT)

APPENDIX A BLOWER PERFORMANCE DATA -AC & HP

THE FOLLOWING TABLES ARE PROVIDED FOR REFERENCE ONLY TO SHOW DDC CONTROL SETTINGS RELATIONSHIP TO UNIT CFM. BLOWER SPEED SETTINGS MUST BE SET TO MEET THE MINIMUM REQUIRED CFM OF THEIR STAGES.

3 TON

MODELS : DRC0363D,DRC0364D & DRC0367D WITH DDC CONTROL

STANDARD STATIC

DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600				621	25	0.11	739	30	0.16	812	34	0.20	879	33	0.25
800	494	25	0.09	656	31	0.14	771	35	0.20	854	39	0.26	927	40	0.32
1000	549	31	0.12	691	36	0.19	802	40	0.25	895	44	0.34	975	47	0.41
1200	605	36	0.17	726	41	0.24	833	45	0.32	937	49	0.43	1023	53	0.52
1400	660	42	0.24	760	47	0.31	865	50	0.41	978	54	0.56	1071	60	0.66
1500	688	45	0.29	778	49	0.35	881	53	0.46	999	56	0.64	1095	63	0.74

Shaded area indicates air flow below 900 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600				627	26	0.11	743	31	0.16	840	34	0.21	930	40	0.26
800	497	22	0.08	660	31	0.14	772	35	0.20	871	39	0.26	957	43	0.32
1000	550	31	0.12	693	36	0.19	801	40	0.25	902	44	0.33	984	47	0.39
1200	604	39	0.17	726	41	0.25	830	45	0.32	933	49	0.42	1011	50	0.47
1400	658	48	0.25	759	46	0.33	859	50	0.41	964	53	0.54	1038	53	0.58
1500	684	52	0.29	775	49	0.38	874	52	0.46	980	56	0.60	1052	55	0.64

Shaded area indicates air flow below 900 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

3 TON

MODELS : DRC0363W,DRC0364W & DRC0367W WITH DDC CONTROL

HIGH STATIC

DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600				632	26	0.11	742	29	0.15	839	33	0.20	930	36	0.27
800	497	24	0.08	661	30	0.14	774	34	0.20	869	39	0.25	963	42	0.34
1000	550	30	0.12	690	35	0.18	806	39	0.27	898	44	0.31	996	48	0.42
1200	604	36	0.17	719	39	0.24	839	44	0.35	928	49	0.38	1029	54	0.52
1400	658	42	0.25	748	44	0.32	871	48	0.47	958	55	0.48	1062	60	0.65
1500	684	45	0.29	763	46	0.37	887	51	0.54	972	57	0.53	1079	63	0.73
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600	1008	43	0.34	1056	38	0.39	1139	43	0.48	1222	48	0.57	1288	51	0.62
800	1038	48	0.41	1093	46	0.48	1171	50	0.58	1246	55	0.67	1309	58	0.72
1000	1069	52	0.49	1130	53	0.58	1203	58	0.69	1270	62	0.78	1330	65	0.82
1200	1100	57	0.59	1166	61	0.71	1235	65	0.83	1294	68	0.92	1351	72	0.95
1400	1130	61	0.71	1203	69	0.87	1267	73	0.99	1318	75	1.08	1372	79	1.09
1500	1146	64	0.77	1222	73	0.96	1283	76	1.08	1330	79	1.17	1382	82	1.17

Shaded area indicates air flow below 900 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600				617	26	0.11	740	30	0.15	826	32	0.20	917	36	0.26
800	494	25	0.09	656	31	0.14	769	35	0.19	860	38	0.25	950	42	0.33
1000	550	31	0.12	695	35	0.19	797	39	0.25	894	44	0.31	982	48	0.41
1200	605	37	0.18	734	40	0.25	826	44	0.31	928	50	0.39	1014	55	0.51
1400	660	42	0.26	774	45	0.33	854	49	0.40	962	56	0.49	1047	61	0.64
1500	687	45	0.31	793	47	0.37	869	51	0.45	978	59	0.55	1063	64	0.71
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600	996	41	0.34	1059	38	0.39	1136	42	0.45	1205	47	0.55	1256	50	0.60
800	1027	47	0.41	1090	46	0.47	1164	50	0.53	1230	55	0.65	1284	58	0.70
1000	1057	53	0.50	1122	54	0.56	1191	58	0.64	1255	62	0.78	1313	65	0.82
1200	1087	59	0.61	1154	62	0.68	1218	66	0.77	1279	70	0.94	1341	73	0.96
1400	1118	65	0.75	1185	70	0.81	1246	74	0.92	1304	77	1.12	1370	80	1.13
1500	1133	68	0.83	1201	74	0.88	1260	78	1.00	1316	81	1.17	1384	84	1.18

Shaded area indicates air flow below 900 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

APPENDIX A BLOWER PERFORMANCE DATA -AC & HP

4 TON

MODELS : DRC0483D,DRC0484D & DRC0487D WITH DDC CONTROL

STANDARD STATIC

DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	506	25	0.10	660	31	0.15	773	36	0.20	879	41	0.28	958	46	0.36
1000	567	32	0.14	706	38	0.20	811	42	0.25	909	46	0.35	988	51	0.43
1200	627	39	0.19	751	44	0.26	849	48	0.32	940	52	0.43	1018	55	0.53
1400	687	46	0.26	796	50	0.35	888	54	0.41	971	58	0.54	1048	60	0.65
1600	748	53	0.36	841	57	0.46	926	60	0.52	1002	63	0.67	1078	65	0.79
1800	808	60	0.50	886	63	0.61	964	66	0.66	1032	69	0.84	1108	70	0.97
2000	869	66	0.68	932	70	0.81	1003	72	0.84	1063	74	1.04	1138	75	1.18

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	483	24	0.09	638	30	0.14	753	34	0.20	860	39	0.25	948	44	0.35
1000	542	31	0.13	680	36	0.18	784	40	0.29	882	45	0.31	967	49	0.41
1200	601	38	0.17	722	43	0.23	814	46	0.39	904	50	0.37	987	54	0.50
1400	659	45	0.24	763	49	0.30	845	52	0.51	926	55	0.46	1006	58	0.59
1600	718	52	0.33	805	55	0.38	875	58	0.68	948	61	0.56	1026	63	0.71
1800	777	59	0.46	847	61	0.50	906	64	0.90	970	66	0.68	1045	68	0.85
2000	835	66	0.63	889	68	0.64	936	70	0.79	992	72	0.83	1065	72	1.02

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

4 TON

MODELS : DRC0483W,DRC0484W & DRC0487W WITH DDC CONTROLS

HIGH STATIC

DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	505	24	0.10	657	29	0.14	771	35	0.21	880	40	0.28	944	38	0.34
1000	566	31	0.13	706	37	0.19	813	42	0.26	915	47	0.35	982	46	0.42
1200	626	38	0.17	755	44	0.24	856	49	0.33	950	53	0.43	1020	54	0.51
1400	687	45	0.24	804	51	0.31	898	56	0.42	985	60	0.54	1059	62	0.62
1600	748	53	0.32	853	58	0.41	941	63	0.54	1020	67	0.67	1097	70	0.76
1800	809	60	0.43	902	65	0.53	983	70	0.68	1055	73	0.84	1135	78	0.93
2000	869	67	0.58	951	72	0.68	1026	77	0.87	1090	80	1.05	1173	87	1.14
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	1022	42	0.40	1116	48	0.48	1223	55	0.63	1205	54	0.59	1301	55	0.76
1000	1058	50	0.48	1145	55	0.57	1241	62	0.72	1247	62	0.70	1332	64	0.90
1200	1095	58	0.58	1174	63	0.66	1259	68	0.83	1289	70	0.84	1363	73	1.05
1400	1131	66	0.69	1203	71	0.78	1277	75	0.96	1331	78	1.01	1394	83	1.15
1600	1167	74	0.83	1232	78	0.91	1295	82	1.10	1373	90	1.20			
1800	1203	83	0.99	1262	86	1.07	1313	90	1.20						
2000	1239	90	1.19												

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	487	24	0.08	635	28	0.14	750	33	0.20	862	31	0.25	932	36	0.33
1000	544	30	0.12	679	35	0.18	785	40	0.25	890	39	0.30	958	44	0.39
1200	600	36	0.16	722	42	0.23	821	46	0.32	918	47	0.37	985	51	0.47
1400	657	43	0.22	766	48	0.30	856	53	0.40	946	55	0.45	1012	59	0.56
1600	713	49	0.30	810	55	0.39	891	59	0.51	974	62	0.56	1039	66	0.67
1800	769	55	0.42	854	62	0.50	927	66	0.65	1001	70	0.68	1065	74	0.80
2000	826	61	0.57	897	68	0.65	962	72	0.83	1029	78	0.83	1092	81	0.96
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	1010	40	0.40	1111	46	0.50	1173	50	0.53	1200	44	0.52	1281	58	0.71
1000	1034	48	0.47	1129	53	0.58	1192	57	0.61	1228	54	0.63	1303	65	0.83
1200	1058	55	0.57	1147	60	0.68	1210	64	0.70	1256	63	0.77	1325	72	0.98
1400	1082	63	0.68	1164	67	0.80	1229	71	0.81	1283	73	0.94	1347	79	1.15
1600	1106	70	0.81	1182	75	0.94	1248	78	0.93	1311	82	1.15	1369	86	1.18
1800	1130	77	0.97	1200	82	1.10	1266	85	1.07						
2000	1154	85	1.17	1218	90	1.20									

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

APPENDIX A BLOWER PERFORMANCE DATA -AC & HP

5 TON

MODELS : DRC0603D,DRC0604D & DRC0607D WITH DDC CONTROL

STANDARD STATIC

DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900	537	26	0.10	675	32	0.16	801	37	0.21	905	42	0.29	939	44	0.30
1100	600	34	0.14	728	39	0.21	842	44	0.27	936	48	0.36	980	50	0.38
1300	663	41	0.19	781	46	0.27	883	50	0.34	966	54	0.44	1021	57	0.47
1500	727	48	0.25	834	53	0.36	924	57	0.44	997	60	0.55	1062	63	0.59
1700	790	56	0.34	887	60	0.48	965	63	0.55	1027	66	0.69	1103	69	0.73
1900	853	63	0.46	940	67	0.63	1005	70	0.70	1058	72	0.86	1144	75	0.92
2100	916	70	0.63	993	74	0.84	1046	76	0.90	1088	78	1.07	1185	81	1.14
2300	979	78	0.84	1046	81	1.11	1087	82	1.14						
2500	1042	85	1.14												

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900	514	25	0.10	642	30	0.15	771	35	0.20	863	40	0.26	950	43	0.30
1100	569	32	0.14	689	37	0.20	808	42	0.25	894	46	0.32	974	49	0.37
1300	624	40	0.19	736	44	0.26	844	49	0.32	925	52	0.40	997	55	0.45
1500	680	47	0.26	782	51	0.35	880	55	0.41	955	58	0.50	1021	61	0.55
1700	735	54	0.35	829	58	0.46	917	62	0.52	986	65	0.63	1045	67	0.68
1900	790	62	0.47	876	65	0.61	953	68	0.66	1017	71	0.78	1069	72	0.83
2100	845	69	0.63	922	72	0.81	990	75	0.84	1048	77	0.97	1093	78	1.01
2300	900	76	0.86	969	79	1.07	1026	82	1.06						
2500	955	84	1.16												

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

5 TON

MODELS : DRC0603W,DRC0604W & DRC0607W WITH DDC CONTROL

HIGH STATIC

DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900				678	22	0.15	806	26	0.21	909	29	0.27	932	23	0.35
1100	609	24	0.15	735	27	0.20	855	31	0.27	952	34	0.34	983	29	0.43
1300	674	29	0.20	792	33	0.25	903	36	0.35	996	39	0.42	1034	35	0.52
1500	739	35	0.27	848	38	0.33	952	41	0.44	1039	44	0.52	1084	42	0.64
1700	804	40	0.36	905	43	0.43	1001	46	0.56	1083	49	0.65	1135	48	0.78
1900	869	45	0.49	962	48	0.55	1050	51	0.71	1126	54	0.81	1186	55	0.95
2100	934	50	0.66	1019	53	0.72	1098	56	0.90	1169	59	1.01	1236	61	1.16
2300	999	56	0.89	1076	58	0.93	1147	62	1.15	1213	63	1.26	1287	67	1.42
2500	1064	61	1.20	1133	64	1.20	1196	67	1.46	1256	68	1.57	1338	74	1.73
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900	1021	26	0.44	1106	30	0.50	1188	33	0.60	1266	36	0.66	1327	39	0.75
1100	1067	32	0.54	1147	36	0.59	1224	39	0.72	1297	42	0.78	1356	44	0.88
1300	1113	38	0.65	1189	42	0.71	1260	44	0.86	1327	47	0.91	1385	49	1.04
1500	1159	45	0.80	1230	48	0.85	1295	50	1.03	1358	53	1.07	1413	55	1.22
1700	1205	51	0.98	1271	53	1.02	1331	56	1.23	1388	58	1.26	1442	60	1.43
1900	1251	57	1.19	1312	59	1.22	1367	61	1.47	1419	63	1.48	1470	66	1.67
2100	1297	63	1.46	1353	65	1.46	1402	67	1.55	1449	69	1.73	1499	71	1.80
2300	1343	69	1.78	1395	71	1.75	1438	73	1.80	1480	74	1.90	1528	76	1.97
2500	1389	75	1.96	1436	77	1.97	1474	78	1.98	1510	80	2.22	1556	82	2.25

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900							694	21	0.17	814	25	0.24	924	29	0.31
1100	516	21	0.13	612	23	0.16	751	27	0.22	863	30	0.30	967	34	0.38
1300	590	26	0.17	681	29	0.21	808	32	0.29	913	36	0.38	1009	39	0.48
1500	663	32	0.23	750	34	0.27	865	38	0.38	962	41	0.49	1051	44	0.59
1700	737	38	0.31	819	40	0.36	922	43	0.49	1011	46	0.62	1093	49	0.74
1900	811	43	0.42	888	46	0.48	979	49	0.64	1060	52	0.79	1136	54	0.92
2100	885	49	0.56	957	52	0.63	1037	54	0.82	1109	57	1.00	1178	59	1.15
2300	958	55	0.76	1026	58	0.83	1094	60	1.07	1158	62	1.27	1220	64	1.43
2500	1032	60	1.03	1095	63	1.10	1151	65	1.39	1208	67	1.61	1263	69	1.78
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900	999	32	0.37	1119	29	0.54	1189	32	0.63	1253	35	0.65	1311	37	0.72
1100	1040	37	0.45	1150	35	0.64	1219	38	0.73	1282	40	0.74	1340	42	0.83
1300	1081	42	0.55	1182	40	0.75	1250	43	0.86	1312	46	0.85	1370	48	0.96
1500	1122	46	0.67	1213	46	0.88	1281	49	1.01	1342	51	0.98	1399	53	1.10
1700	1162	51	0.82	1245	52	1.03	1311	54	1.19	1372	56	1.13	1428	59	1.27
1900	1203	56	1.00	1276	57	1.21	1342	60	1.39	1402	62	1.30	1458	64	1.46
2100	1244	60	1.22	1308	63	1.42	1372	65	1.63	1431	67	1.50	1487	69	1.68
2300	1285	65	1.49	1339	68	1.67	1403	71	1.92	1461	73	1.72	1516	75	1.93
2500	1326	70	1.82	1371	74	1.96	1434	76	1.97	1491	78	1.98	1545	80	2.22

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

APPENDIX A BLOWER PERFORMANCE DATA -AC & HP

6 TON
MODELS : DRC0723D,DRC0724D & DRC0727D WITH DDC CONTROL
STANDARD STATIC
DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	574	30	0.17	692	36	0.23	814	42	0.28	912	47	0.34	990	51	0.47
1400	633	39	0.23	739	44	0.29	849	50	0.35	939	54	0.42	1013	58	0.57
1600	691	48	0.31	787	53	0.38	884	57	0.44	967	62	0.51	1036	65	0.70
1800	750	57	0.41	835	61	0.49	920	65	0.55	994	69	0.63	1059	73	0.85
2000	808	66	0.56	882	70	0.64	955	73	0.68	1021	77	0.76	1082	80	1.04
2200	867	75	0.75	930	78	0.83	990	81	0.85	1048	84	0.93			
2400	925	83	1.02	978	86	1.08	1026	89	1.06						
2600															
2800															
3000															

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	586	31	0.15	709	37	0.23	807	41	0.28	910	46	0.35	994	50	0.43
1400	646	40	0.20	759	45	0.29	851	49	0.36	946	54	0.44	1024	57	0.52
1600	706	48	0.27	808	53	0.38	894	57	0.46	981	61	0.55	1055	65	0.64
1800	766	57	0.35	857	61	0.49	938	65	0.59	1016	68	0.69	1085	72	0.78
2000	826	66	0.47	907	69	0.64	981	73	0.74	1051	76	0.86	1115	79	0.95
2200	886	74	0.62	956	77	0.83	1025	81	0.95	1087	83	1.07	1146	86	1.16
2400	947	83	0.82	1005	85	1.08	1068	88	1.20						
2600	1007	90	1.08												
2800															
3000															

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

6 TON
MODELS : DRC0723W,DRC0724W & DRC0727W WITH DDC CONTROL
HIGH STATIC
DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	604	21	0.19	722	24	0.24	831	28	0.30	928	32	0.39	1019	35	0.44
1400	671	27	0.24	781	31	0.31	883	35	0.37	975	38	0.49	1062	42	0.54
1600	737	34	0.31	840	37	0.39	935	41	0.46	1023	44	0.61	1105	48	0.66
1800	804	41	0.41	899	44	0.50	987	48	0.57	1070	51	0.76	1147	54	0.81
2000	871	47	0.53	958	51	0.64	1040	54	0.71	1117	57	0.95	1190	60	0.99
2200	937	54	0.69	1017	58	0.81	1092	61	0.89	1165	63	1.18	1233	66	1.20
2400	1004	61	0.89	1075	64	1.03	1144	67	1.11	1212	70	1.47	1276	72	1.47
2600	1070	68	1.15	1134	71	1.31	1196	74	1.38	1260	76	1.84	1319	79	1.80
2800	1137	75	1.50	1193	78	1.66	1248	80	1.72	1307	83	1.90	1362	85	2.10
3000	1204	82	1.94	1252	85	2.12	1301	87	2.14	1354	89	2.20			
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	1098	39	0.55	1169	43	0.64	1234	46	0.67	1287	43	0.85	1353	46	0.86
1400	1138	45	0.67	1206	48	0.77	1267	51	0.79	1319	49	0.99	1380	52	0.99
1600	1178	51	0.82	1242	54	0.92	1300	56	0.93	1350	55	1.16	1407	58	1.14
1800	1218	57	1.00	1278	60	1.10	1333	62	1.09	1381	61	1.37	1434	63	1.31
2000	1258	63	1.23	1314	65	1.32	1366	67	1.27	1413	67	1.60	1462	69	1.51
2200	1298	69	1.50	1350	71	1.58	1399	72	1.50	1444	74	1.88	1489	75	1.74
2400	1338	75	1.83	1387	76	1.89	1432	78	1.76	1475	80	1.90	1516	81	2.00
2600	1378	80	2.00	1423	82	2.10	1465	83	2.11	1506	86	2.20	1543	87	2.30
2800	1418	86	2.20	1459	87	2.25	1498	89	2.30						
3000															

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	578	21	0.18	702	24	0.24	816	28	0.29	922	32	0.36	1014	35	0.46
1400	648	27	0.23	762	30	0.30	867	34	0.36	965	38	0.44	1052	41	0.56
1600	717	34	0.30	822	37	0.38	917	41	0.45	1009	44	0.54	1090	47	0.68
1800	787	41	0.39	882	44	0.49	968	47	0.56	1052	50	0.66	1128	53	0.83
2000	857	48	0.51	942	51	0.62	1019	54	0.70	1095	57	0.80	1166	59	1.02
2200	927	55	0.66	1002	58	0.79	1070	60	0.87	1138	63	0.98	1204	65	1.25
2400	997	62	0.86	1062	64	1.00	1121	67	1.09	1181	69	1.19	1242	71	1.52
2600	1067	69	1.11	1122	71	1.28	1172	73	1.36	1224	75	1.46	1280	77	1.50
2800	1137	76	1.44	1182	78	1.62	1223	80	1.69	1268	81	1.78	1318	83	1.80
3000	1207	83	1.87	1242	85	2.06	1274	86	2.11	1311	88	2.18	1356	89	2.30
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	1091	38	0.50	1169	41	0.61	1224	45	0.65	1295	41	0.83	1353	45	0.94
1400	1126	44	0.60	1200	47	0.73	1256	50	0.77	1324	48	0.98	1381	51	1.10
1600	1161	50	0.72	1231	52	0.88	1287	55	0.90	1352	54	1.15	1409	57	1.30
1800	1196	56	0.86	1262	58	1.05	1319	61	1.05	1381	60	1.35	1437	63	1.52
2000	1231	62	1.03	1293	64	1.26	1351	66	1.24	1409	67	1.58	1465	69	1.78
2200	1266	67	1.23	1324	69	1.51	1382	71	1.45	1437	73	1.86	1493	75	2.09
2400	1301	73	1.47	1355	75	1.80	1414	77	1.70	1466	80	2.18	1521	81	2.46
2600	1336	79	1.76	1386	81	2.16	1445	82	2.00	1494	86	2.20	1550	87	2.25
2800	1371	85	2.11	1417	86	2.20	1477	88	2.30						
3000															

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

APPENDIX A BLOWER PERFORMANCE DATA -AC & HP

3 TON

MODELS : DRH0363D,DRH0364D & DRH0367D WITH DDC CONTROL
STANDARD STATIC
DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600				574	23	0.09	687	28	0.13	774	32	0.16	844	35	0.22
800	491	25	0.08	615	29	0.12	718	33	0.17	807	36	0.21	877	39	0.27
1000	546	31	0.12	656	35	0.16	749	38	0.22	839	41	0.28	911	43	0.35
1200	601	37	0.17	697	40	0.22	781	43	0.29	871	46	0.36	944	48	0.44
1400	656	43	0.25	738	46	0.29	812	48	0.39	903	51	0.46	977	52	0.56
1500	683	46	0.30	759	48	0.34	828	50	0.45	919	53	0.53	994	54	0.64

Shaded area indicates air flow below 900 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600				608	23	0.09	728	27	0.13	821	31	0.18	896	34	0.22
800	516	25	0.08	650	28	0.12	761	32	0.17	854	36	0.23	930	39	0.27
1000	574	30	0.12	693	34	0.17	794	37	0.22	888	41	0.30	964	43	0.34
1200	632	36	0.16	736	39	0.23	826	42	0.28	921	45	0.39	998	47	0.42
1400	690	42	0.23	779	45	0.31	859	47	0.37	954	50	0.50	1033	51	0.52
1500	719	44	0.27	800	48	0.37	876	50	0.42	971	52	0.57	1050	54	0.58

Shaded area indicates air flow below 900 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

3 TON

MODELS : DRH0363W,DRH0364W & DRH0367W WITH DDC CONTROL
HIGH STATIC
DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600	428	22	0.06	585	26	0.10	686	29	0.14	773	33	0.19	844	37	0.24
800	488	27	0.09	617	31	0.14	718	34	0.18	802	38	0.23	875	43	0.30
1000	547	32	0.13	649	35	0.18	749	40	0.23	830	44	0.29	907	48	0.37
1200	606	37	0.18	681	39	0.24	781	46	0.30	859	49	0.36	939	54	0.47
1400	665	42	0.27	713	43	0.32	813	52	0.38	887	54	0.45	970	59	0.58
1500	695	45	0.32	729	45	0.37	828	55	0.43	902	57	0.50	986	62	0.65
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600	926	37	0.27	991	41	0.34	1044	45	0.42	1109	39	0.43	1158	42	0.48
800	955	44	0.34	1019	48	0.41	1073	52	0.51	1135	49	0.54	1186	52	0.61
1000	984	51	0.42	1047	55	0.50	1103	58	0.62	1160	59	0.67	1213	63	0.78
1200	1013	58	0.53	1075	62	0.61	1133	65	0.76	1186	69	0.84	1240	74	0.99
1400	1042	65	0.66	1103	69	0.75	1163	71	0.93	1211	79	1.05	1268	84	1.17
1500	1056	68	0.74	1117	72	0.83	1177	74	1.02	1224	84	1.17	1281	89	1.19

Shaded area indicates air flow below 900 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600	452	22	0.07	620	26	0.11	725	29	0.16	820	33	0.20	895	37	0.25
800	513	21	0.10	653	30	0.15	761	33	0.20	850	38	0.25	929	42	0.32
1000	575	32	0.14	686	34	0.19	798	38	0.25	879	43	0.31	962	47	0.39
1200	636	37	0.20	719	38	0.25	834	42	0.32	908	48	0.38	996	52	0.49
1400	697	42	0.29	752	43	0.32	870	46	0.41	938	53	0.48	1029	57	0.61
1500	728	44	0.34	768	45	0.36	888	48	0.46	953	56	0.53	1046	60	0.68
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
600	984	36	0.29	1052	41	0.36	1108	45	0.42	1177	38	0.46	1228	41	0.48
800	1013	43	0.37	1081	47	0.44	1139	51	0.50	1204	48	0.57	1257	52	0.60
1000	1043	50	0.46	1110	54	0.54	1169	58	0.60	1230	58	0.71	1286	62	0.75
1200	1073	57	0.57	1139	61	0.66	1200	64	0.71	1257	67	0.89	1314	72	0.93
1400	1103	64	0.71	1168	68	0.80	1230	70	0.86	1283	77	1.11	1343	83	1.16
1500	1118	67	0.79	1182	71	0.89	1246	73	0.94	1297	82	1.16	1357	88	1.19

Shaded area indicates air flow below 900 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

APPENDIX A BLOWER PERFORMANCE DATA -AC & HP

4 TON

MODELS : DRH0483D,DRH0484D & DRH0487D WITH DDC CONTROL

STANDARD STATIC

DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	496	23	0.10	636	27	0.13	742	31	0.17	838	35	0.22	910	38	0.26
1000	555	29	0.14	676	33	0.17	772	37	0.22	858	40	0.28	928	43	0.32
1200	613	36	0.20	717	39	0.22	801	42	0.28	877	45	0.35	945	48	0.39
1400	672	42	0.29	757	45	0.29	830	48	0.35	897	50	0.43	963	53	0.48
1600	731	48	0.41	797	51	0.39	859	53	0.45	917	55	0.54	981	57	0.58
1800	789	55	0.59	838	57	0.52	888	59	0.57	936	60	0.67	999	62	0.71
2000	848	61	0.85	878	63	0.68	917	64	0.72	956	66	0.84	1017	67	0.87

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	523	23	0.09	673	27	0.13	786	31	0.18	889	34	0.22	965	37	0.27
1000	583	29	0.13	715	33	0.16	817	36	0.23	909	39	0.27	984	42	0.34
1200	644	35	0.18	757	38	0.21	847	42	0.29	930	44	0.33	1002	47	0.41
1400	705	41	0.24	799	44	0.28	877	47	0.37	950	49	0.40	1021	52	0.50
1600	766	47	0.34	841	50	0.36	908	52	0.47	970	54	0.49	1039	57	0.61
1800	827	53	0.46	883	56	0.47	938	58	0.60	991	59	0.60	1058	61	0.75
2000	888	60	0.64	925	62	0.60	968	63	0.76	1011	65	0.73	1076	66	0.91

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

4 TON

MODELS : DRH0483W,DRH0484W & DRH0487W WITH DDC CONTROL

HIGH STATIC

DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	510	27	0.11	585	23	0.11	701	29	0.15	792	34	0.21	879	39	0.26
1000	576	35	0.15	635	32	0.15	740	37	0.20	823	42	0.26	905	46	0.32
1200	641	44	0.22	685	40	0.20	778	45	0.26	854	49	0.33	931	54	0.40
1400	706	53	0.31	735	49	0.27	817	53	0.34	885	57	0.42	957	62	0.50
1600	771	62	0.45	785	58	0.36	855	61	0.43	917	65	0.54	983	70	0.62
1800	837	70	0.64	835	66	0.49	894	69	0.56	948	73	0.68	1009	78	0.77
2000	885	75	0.66	885	75	0.66	932	77	0.73	979	81	0.87	1035	85	0.97
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	944	43	0.31	1022	37	0.37	794	33	0.27	1127	42	0.54	1159	44	0.57
1000	968	50	0.39	1042	47	0.45	888	45	0.37	1155	54	0.66	1194	56	0.70
1200	992	58	0.49	1063	57	0.55	982	58	0.52	1183	65	0.81	1229	69	0.88
1400	1016	65	0.61	1083	67	0.67	1077	70	0.71	1211	76	0.98	1264	81	1.09
1600	1041	73	0.76	1103	77	0.82	1171	82	0.98	1239	88	1.20			
1800	1065	81	0.95	1123	86	1.00	1266								
2000															

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	538	21	0.11	619	23	0.12	743	29	0.16	840	33	0.22	933	38	0.27
1000	604	34	0.15	670	31	0.16	783	36	0.21	871	41	0.28	959	46	0.34
1200	670	42	0.21	722	39	0.21	823	44	0.28	903	48	0.36	985	53	0.42
1400	735	50	0.30	773	47	0.29	862	52	0.36	934	55	0.46	1010	60	0.53
1600	801	58	0.42	824	55	0.39	902	60	0.46	965	63	0.58	1036	68	0.66
1800	867	66	0.59	875	63	0.53	942	68	0.60	996	70	0.74	1062	75	0.82
2000	927	71	0.71	927	71	0.71	982	76	0.78	1027	78	0.94	1088	82	1.02
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
800	1001	42	0.33	1084	36	0.38	812	27	0.27	1194	41	0.57	1228	43	0.60
1000	1026	49	0.41	1105	46	0.46	915	40	0.37	1223	52	0.70	1265	55	0.75
1200	1051	57	0.52	1126	55	0.56	1018	53	0.53	1253	64	0.85	1301	67	0.94
1400	1077	64	0.64	1147	65	0.69	1121	66	0.74	1282	75	1.04	1338	80	1.17
1600	1102	72	0.80	1168	75	0.84	1224	80	1.04	1312	86	1.20			
1800	1127	79	1.00	1190	85	1.03									
2000	1152	87	1.20	1211											

Shaded area indicates air flow below 1200 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.

Valid motor operating range for DDC% setting is 20 - 90.

APPENDIX A BLOWER PERFORMANCE DATA -AC & HP

5 TON
MODELS : DRH0603D,DRH0604D & DRH0607D WITH DDC CONTROL
STANDARD STATIC
DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900	416	24	0.08	501	27	0.09	652	33	0.15	768	38	0.20	871	42	0.27
1100	488	31	0.11	573	34	0.13	709	40	0.20	817	44	0.26	912	48	0.34
1300	561	39	0.16	644	42	0.19	767	47	0.27	866	51	0.33	954	54	0.44
1500	634	46	0.23	716	49	0.26	824	54	0.35	914	57	0.43	995	60	0.56
1700	707	54	0.33	787	57	0.37	881	61	0.46	963	64	0.56	1036	66	0.71
1900	779	61	0.47	859	65	0.52	939	68	0.61	1012	70	0.72	1077	72	0.90
2100	852	69	0.68	931	72	0.73	996	75	0.81	1061	77	0.94	1119	79	1.14
2300	925	76	0.97	1002	80	1.02	1053	82	1.08						
2500															

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900	434	23	0.08	525	26	0.10	687	32	0.16	811	37	0.21	922	41	0.29
1100	510	30	0.11	599	34	0.15	747	39	0.21	862	43	0.27	965	47	0.36
1300	586	38	0.16	674	41	0.21	806	46	0.28	913	50	0.35	1008	53	0.46
1500	662	45	0.22	749	48	0.29	866	53	0.37	964	56	0.46	1051	59	0.59
1700	737	53	0.31	824	56	0.41	926	60	0.49	1015	62	0.59	1094	65	0.75
1900	813	60	0.44	898	63	0.57	986	66	0.65	1066	69	0.77	1137	71	0.95
2100	889	67	0.62	973	70	0.80	1045	73	0.87	1117	75	1.00	1180	77	1.14
2300	965	75	0.87	1048	78	1.13	1105	80	1.15						
2500															

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

5 TON
MODELS : DRH0603W,DRH0604W & DRH0607W WITH DDC CONTROL
HIGH STATIC
DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900							657	23	0.17	770	27	0.22	873	30	0.29
1100	493	23	0.13	583	25	0.16	712	29	0.22	817	32	0.29	914	35	0.36
1300	564	28	0.18	649	31	0.22	767	34	0.28	865	37	0.36	954	40	0.45
1500	634	34	0.24	716	36	0.29	822	39	0.36	912	42	0.46	995	45	0.56
1700	705	39	0.33	782	42	0.39	877	45	0.47	959	48	0.59	1036	50	0.70
1900	776	45	0.46	848	48	0.53	932	50	0.61	1007	53	0.75	1077	55	0.87
2100	847	51	0.63	915	53	0.72	987	56	0.79	1054	58	0.95	1117	60	1.09
2300	918	56	0.87	981	59	0.97	1042	61	1.02	1101	63	1.21	1158	65	1.35
2500	989	62	1.20	1047	65	1.31	1097	67	1.33	1148	69	1.53	1199	70	1.69
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900	943	34	0.35	1055	32	0.52	1119	35	0.59	1179	37	0.66	1234	39	0.72
1100	982	39	0.43	1086	37	0.60	1149	40	0.70	1208	42	0.78	1263	44	0.85
1300	1022	43	0.53	1116	43	0.71	1179	45	0.82	1238	47	0.91	1292	50	0.99
1500	1061	48	0.64	1146	48	0.83	1209	50	0.96	1267	53	1.07	1321	55	1.16
1700	1100	52	0.79	1177	53	0.98	1238	56	1.13	1296	58	1.26	1350	60	1.37
1900	1140	57	0.96	1207	59	1.15	1268	61	1.32	1326	63	1.48	1380	65	1.60
2100	1179	61	1.17	1237	64	1.35	1298	66	1.55	1355	68	1.73	1409	71	1.88
2300	1219	66	1.43	1268	69	1.58	1328	71	1.82	1384	74	2.04	1438	76	2.15
2500	1258	71	1.75	1298	75	1.85	1358	77	2.14	1414	79	2.16	1467	81	2.20

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900							694	23	0.17	814	26	0.24	924	30	0.31
1100	516	21	0.13	612	24	0.16	751	28	0.22	863	31	0.30	967	35	0.38
1300	590	28	0.17	681	30	0.21	808	33	0.29	913	37	0.38	1009	40	0.48
1500	663	33	0.23	750	35	0.27	865	39	0.38	962	42	0.49	1051	44	0.59
1700	737	39	0.31	819	41	0.36	922	44	0.49	1011	47	0.62	1093	49	0.74
1900	811	44	0.42	888	47	0.48	979	49	0.64	1060	52	0.79	1136	54	0.92
2100	885	50	0.56	957	52	0.63	1037	54	0.82	1109	57	1.00	1178	59	1.15
2300	958	55	0.76	1026	58	0.83	1094	60	1.07	1158	62	1.27	1220	64	1.43
2500	1032	61	1.03	1095	63	1.10	1151	65	1.39	1208	67	1.61	1263	69	1.78
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
900	999	34	0.37	1119	31	0.54	1189	34	0.63	1252	36	0.64	1310	38	0.70
1100	1040	38	0.45	1150	37	0.64	1219	39	0.73	1282	42	0.74	1340	44	0.81
1300	1081	42	0.55	1182	42	0.75	1250	44	0.86	1312	47	0.85	1370	49	0.93
1500	1122	47	0.67	1213	47	0.88	1281	50	1.01	1342	52	0.97	1400	54	1.07
1700	1162	51	0.82	1245	52	1.03	1311	55	1.19	1372	57	1.12	1430	59	1.23
1900	1203	56	1.00	1276	58	1.21	1342	60	1.39	1403	62	1.29	1460	64	1.42
2100	1244	60	1.22	1308	63	1.42	1372	65	1.63	1433	67	1.48	1490	70	1.63
2300	1285	65	1.49	1339	68	1.67	1403	70	1.92	1463	72	1.70	1520	75	1.88
2500	1326	69	1.82	1371	73	1.96	1434	75	2.25	1493	78	1.96	1550	80	2.16

Shaded area indicates air flow below 1500 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

APPENDIX A BLOWER PERFORMANCE DATA -AC & HP

6 TON
MODELS : DRH0723D,DRH0724D & DRH0727D WITH DDC CONTROL
STANDARD STATIC
DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	574	30	0.17	692	36	0.23	814	42	0.28	912	47	0.34	990	51	0.47
1400	633	39	0.23	739	44	0.29	849	50	0.35	939	54	0.42	1013	58	0.57
1600	691	48	0.31	787	53	0.38	884	57	0.44	967	62	0.51	1036	65	0.70
1800	750	57	0.41	835	61	0.49	920	65	0.55	994	69	0.63	1059	73	0.85
2000	808	66	0.56	882	70	0.64	955	73	0.68	1021	77	0.76	1082	80	1.04
2200	867	75	0.75	930	78	0.83	990	81	0.85	1048	84	0.93			
2400	925	83	1.02	978	86	1.08	1026	89	1.06						
2600															
2800															
3000															

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	586	31	0.15	709	37	0.23	807	41	0.28	910	46	0.35	994	50	0.43
1400	646	40	0.20	759	45	0.29	851	49	0.36	946	54	0.44	1024	57	0.52
1600	706	48	0.27	808	53	0.38	894	57	0.46	981	61	0.55	1055	65	0.64
1800	766	57	0.35	857	61	0.49	938	65	0.59	1016	68	0.69	1085	72	0.78
2000	826	66	0.47	907	69	0.64	981	73	0.74	1051	76	0.86	1115	79	0.95
2200	886	74	0.62	956	77	0.83	1025	81	0.95	1087	83	1.07	1146	86	1.16
2400	947	83	0.82	1005	85	1.08	1068	88	1.20						
2600	1007	90	1.08												
2800															
3000															

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

6 TON
MODELS : DRH0723W,DRH0724W & DRH0727W WITH DDC CONTROL
HIGH STATIC
DOWN FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	604	21	0.19	722	24	0.24	831	28	0.30	928	32	0.39	1019	35	0.44
1400	671	27	0.24	781	31	0.31	883	35	0.37	975	38	0.49	1062	42	0.54
1600	737	34	0.31	840	37	0.39	935	41	0.46	1023	44	0.61	1105	48	0.66
1800	804	41	0.41	899	44	0.50	987	48	0.57	1070	51	0.76	1147	54	0.81
2000	871	47	0.53	958	51	0.64	1040	54	0.71	1117	57	0.95	1190	60	0.99
2200	937	54	0.69	1017	58	0.81	1092	61	0.89	1165	63	1.18	1233	66	1.20
2400	1004	61	0.89	1075	64	1.03	1144	67	1.11	1212	70	1.47	1276	72	1.47
2600	1070	68	1.15	1134	71	1.31	1196	74	1.38	1260	76	1.84	1319	79	1.80
2800	1137	75	1.50	1193	78	1.66	1248	80	1.72	1307	83	1.90	1362	85	2.10
3000	1204	82	1.94	1252	85	2.12	1301	87	2.14	1354	89	2.20			
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	1098	39	0.55	1169	43	0.64	1234	46	0.67	1287	43	0.85	1353	46	0.86
1400	1138	45	0.67	1206	48	0.77	1267	51	0.79	1319	49	0.99	1380	52	0.99
1600	1178	51	0.82	1242	54	0.92	1300	56	0.93	1350	55	1.16	1407	58	1.14
1800	1218	57	1.00	1278	60	1.10	1333	62	1.09	1381	61	1.37	1434	63	1.31
2000	1258	63	1.23	1314	65	1.32	1366	67	1.27	1413	67	1.60	1462	69	1.51
2200	1298	69	1.50	1350	71	1.58	1399	72	1.50	1444	74	1.88	1489	75	1.74
2400	1338	75	1.83	1387	76	1.89	1432	78	1.76	1475	80	1.90	1516	81	2.00
2600	1378	80	2.00	1423	82	2.10	1465	83	2.11	1506	86	2.20	1543	87	2.30
2800	1418	86	2.20	1459	87	2.25	1498	89	2.30						
3000															

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

HORIZONTAL FLOW

CFM	0.2			0.4			0.6			0.8			1.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	578	21	0.18	702	24	0.24	816	28	0.29	922	32	0.36	1014	35	0.46
1400	648	27	0.23	762	30	0.30	867	34	0.36	965	38	0.44	1052	41	0.56
1600	717	34	0.30	822	37	0.38	917	41	0.45	1009	44	0.54	1090	47	0.68
1800	787	41	0.39	882	44	0.49	968	47	0.56	1052	50	0.66	1128	53	0.83
2000	857	48	0.51	942	51	0.62	1019	54	0.70	1095	57	0.80	1166	59	1.02
2200	927	55	0.66	1002	58	0.79	1070	60	0.87	1138	63	0.98	1204	65	1.25
2400	997	62	0.86	1062	64	1.00	1121	67	1.09	1181	69	1.19	1242	71	1.52
2600	1067	69	1.11	1122	71	1.28	1172	73	1.36	1224	75	1.46	1280	77	1.50
2800	1137	76	1.44	1182	78	1.62	1223	80	1.69	1268	81	1.78	1318	83	1.80
3000	1207	83	1.87	1242	85	2.06	1274	86	2.11	1311	88	2.18	1356	89	2.30
CFM	1.2			1.4			1.6			1.8			2.0		
	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP	RPM	DDC %	BHP
1200	1091	38	0.50	1169	41	0.61	1224	45	0.65	1295	41	0.83	1353	45	0.94
1400	1126	44	0.60	1200	47	0.73	1256	50	0.77	1324	48	0.98	1381	51	1.10
1600	1161	50	0.72	1231	52	0.88	1287	55	0.90	1352	54	1.15	1409	57	1.30
1800	1196	56	0.86	1262	58	1.05	1319	61	1.05	1381	60	1.35	1437	63	1.52
2000	1231	62	1.03	1293	64	1.26	1351	66	1.24	1409	67	1.58	1465	69	1.78
2200	1266	67	1.23	1324	69	1.51	1382	71	1.45	1437	73	1.86	1493	75	2.09
2400	1301	73	1.47	1355	75	1.80	1414	77	1.70	1466	80	2.18	1521	81	2.46
2600	1336	79	1.76	1386	81	2.16	1445	82	2.00	1494	86	2.20	1550	87	2.25
2800	1371	85	2.11	1417	86	2.20	1477	88	2.30						
3000															

Shaded area indicates air flow below 1800 SCFM (300 SCFM/ton) that is not recommended for High Stage cooling or heating.
 Valid motor operating range for DDC% setting is 20 - 90.

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRC0361D	208/230/1/60	1	15.6	83	1	0.17	0.95	1	0.75	5.7	-	-	-	-	-	26.2/26.2	40/40
											-	-	-	9.6/8.7	-	35.8/34.9	50/50
											-	-	-	-	1.7/1.5	27.9/27.7	40/40
											-	-	-	9.6/8.7	1.7/1.5	37.5/36.4	50/50
											-	-	-	-	-	29.7/33.2	40/40
											EH*D-1S05	3.8/5.0	18.1/20.8	9.6/8.7	-	41.7/44.0	50/50
														-	1.7/1.5	31.8/35.0	40/40
											EH*D-1S10	7.5/10.0	36.1/41.7	9.6/8.7	1.7/1.5	43.8/45.9	50/50
														-	-	52.3/59.2	60/60
														9.6/8.7	-	64.3/70.1	70/80
														-	1.7/1.5	54.4/61.1	60/70
											EH*D-1S16	11.3/15.0	54.2/62.5	9.6/8.7	1.7/1.5	66.4/72.0	70/80
-	-	74.8/85.3	80/90														
9.6/8.7	-	86.8/96.1	90/100														
-	1.7/1.5	77.0/87.1	80/90														
-	-	-	9.6/8.7	1.7/1.5	89.0/98.0	90/100											
DRC0363D	208/230/3/60	1	11.6	73	1	0.17	0.95	1	0.75	5.7	-	-	-	-	-	21.2/21.2	30/30
											-	-	-	9.6/8.7	-	30.8/29.9	40/40
											-	-	-	-	1.7/1.5	22.9/22.7	30/30
											-	-	-	9.6/8.7	1.7/1.5	32.5/31.4	40/40
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	21.2/22.2	30/30
														9.6/8.7	-	32.2/33.0	40/40
														-	1.7/1.5	22.9/24.0	30/30
														9.6/8.7	1.7/1.5	34.3/34.9	40/40
											EH*D-3S10	7.5/10.0	20.8/24.1	-	-	33.2/37.2	35/40
														9.6/8.7	-	45.2/48.1	50/50
														-	1.7/1.5	35.3/39.1	40/40
														9.6/8.7	1.7/1.5	47.3/49.9	50/50
EH*D-3S16	11.3/15.0	31.3/36.1	-	-	46.2/52.2	50/60											
			9.6/8.7	-	58.2/63.1	60/70											
			-	1.7/1.5	48.3/54.1	50/60											
			9.6/8.7	1.7/1.5	60.3/65.0	70/70											
DRC0363W	208/230/3/60	1	11.6	73	1	0.17	0.95	1	1.2	5	-	-	-	-	-	20.5/20.5	30/30
											-	-	-	9.6/8.7	-	30.1/29.2	40/40
											-	-	-	-	1.7/1.5	22.2/22.0	30/30
											-	-	-	9.6/8.7	1.7/1.5	31.8/30.7	40/40
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	20.5/21.3	30/30
														9.6/8.7	-	31.3/32.2	40/40
														-	1.7/1.5	22.2/23.2	30/30
														9.6/8.7	1.7/1.5	33.4/34.0	40/40
											EH*D-3S10	7.5/10.0	20.8/24.1	-	-	32.3/36.3	35/40
														9.6/8.7	-	44.3/47.2	45/50
														-	1.7/1.5	34.4/38.2	35/40
														9.6/8.7	1.7/1.5	46.4/49.1	50/50
EH*D-3S15	11.3/15.0	31.3/36.1	-	-	45.3/51.4	50/60											
			9.6/8.7	-	57.3/62.2	60/70											
			-	1.7/1.5	47.5/53.2	50/60											
			9.6/8.7	1.7/1.5	59.5/64.1	60/70											

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRC0364D	460/3/60	1	5.7	38	1	0.17	0.48	1	1.2	2.5	-	-	-	-	-	10.1	15
											-	-	-	4.3	-	14.4	20
											-	-	-	-	0.5	10.6	15
											-	-	-	4.3	0.5	14.9	20
											EH*D-4S05	5	6.01	-	-	10.6	15
														4.3	-	16.0	20
														-	0.5	11.3	15
														4.3	0.5	16.6	20
														-	-	18.2	20
											EH*D-4S10	10	12	4.3	-	23.5	25
														-	0.5	18.8	20
														4.3	0.5	24.2	25
											EH*D-4S16	15	18	-	-	25.7	30
														4.3	-	31.1	35
														-	0.5	26.3	30
4.3	0.5	31.7	35														
DRC0364W	460/3/60	1	5.7	38	1	0.17	0.48	1	1.2	2.5	-	-	-	-	-	10.1	15
											-	-	-	4.3	-	14.4	20
											-	-	-	-	0.5	10.6	15
											-	-	-	4.3	0.5	14.9	20
											EH*D-4S05	5	6.01	-	-	10.6	15
														4.3	-	16.0	20
														-	0.5	11.3	15
														4.3	0.5	16.6	20
														-	-	18.2	20
											EH*D-4S10	10	12	4.3	-	23.5	25
														-	0.5	18.8	20
														4.3	0.5	24.2	25
											EH*D-4S15	15	18	-	-	25.7	30
														4.3	-	31.1	35
														-	0.5	26.3	30
4.3	0.5	31.7	35														
DRC0367D	575/3/60	1	4	25.6	1	0.17	0.39	1	1.2	2	-	-	-	-	-	7.4	15
											-	-	-	3.5	-	10.9	15
											-	-	-	-	1.7	8.0	15
											-	-	-	3.5	1.7	11.5	15
											EH*D-7S05	5	4.81	-	-	8.5	15
														3.5	-	12.9	15
														-	1.7	9.3	15
														3.5	1.7	13.6	15
														-	-	14.5	15
											EH*D-7S10	10	9.62	3.5	-	18.9	20
														-	1.7	15.3	20
														3.5	1.7	19.7	20
											EH*D-7S16	15	14.4	-	-	20.5	25
														3.5	-	24.9	25
														-	1.7	21.3	25
3.5	1.7	25.7	30														
DRC0367W	575/3/60	1	4	25.6	1	0.17	0.39	1	1.2	2	-	-	-	-	-	7.4	15
											-	-	-	3.5	-	10.9	15
											-	-	-	-	1.7	8.0	15
											-	-	-	3.5	1.7	11.5	15
											EH*D-7S05	5	4.81	-	-	8.5	15
														3.5	-	12.9	15
														-	1.7	9.3	15
														3.5	1.7	13.6	15
														-	-	14.5	15
											EH*D-7S10	10	9.62	3.5	-	18.9	20
														-	1.7	15.3	20
														3.5	1.7	19.7	20
											EH*D-7S15	15	14.4	-	-	20.5	25
														3.5	-	24.9	25
														-	1.7	21.3	25
3.5	1.7	25.7	30														

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRC0481D	208/230/1/60	1	21.2	104	1	0.17	0.95	1	1	6.9	-	-	-	-	-	34.3/34.3	50/50
											-	-	-	9.6/8.7	-	43.9/43.0	60/60
											-	-	-	-	1.7/1.5	36.0/35.8	50/50
											-	-	-	9.6/8.7	1.7/1.5	45.6/44.5	60/60
											EH*D-1S05	3.8/5.0	18.1/20.8	-	-	34.3/34.7	50/50
														9.6/8.7	-	43.9/45.5	60/60
														-	1.7/1.5	36.0/36.5	50/50
														9.6/8.7	1.7/1.5	45.6/47.4	60/60
											EH*D-1S10	7.5/10.0	36.1/41.7	-	-	53.8/60.7	60/70
														9.6/8.7	-	65.8/71.6	70/80
														-	1.7/1.5	55.9/62.6	60/70
														9.6/8.7	1.7/1.5	67.9/73.5	70/80
											EH*D-1S15	11.3/15.0	54.2/62.5	-	-	76.3/86.8	80/90
														9.6/8.7	-	88.3/97.6	90/100
														-	1.7/1.5	78.5/88.6	80/90
														9.6/8.7	1.7/1.5	90.5/99.5	100/100
EH*D-1S22	15.0/20.0	72.2/83.3	-	-	98.9/113	100/125											
			9.6/8.7	-	111/124	125/125											
			-	1.7/1.5	101/115	110/125											
			9.6/8.7	1.7/1.5	113/126	125/150											
DRC0483D	208/230/3/60	1	14	83.1	1	0.17	0.95	1	1	6.9	-	-	-	-	-	25.4/25.4	35/35
											-	-	-	9.6/8.7	-	35.0/34.1	45/45
											-	-	-	-	1.7/1.5	27.1/26.9	40/40
											-	-	-	9.6/8.7	1.7/1.5	36.7/35.6	50/45
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	25.4/25.4	35/35
														9.6/8.7	-	35.0/34.5	45/45
														-	1.7/1.5	27.1/26.9	40/40
														9.6/8.7	1.7/1.5	36.7/36.4	50/45
											EH*D-3S10	7.5/10.0	20.8/24.1	-	-	34.7/38.7	35/40
														9.6/8.7	-	46.7/49.6	50/50
														-	1.7/1.5	36.8/40.6	40/45
														9.6/8.7	1.7/1.5	48.8/51.4	50/60
											EH*D-3S15	11.3/15.0	31.3/36.1	-	-	47.7/53.7	50/60
														9.6/8.7	-	59.7/64.6	60/70
														-	1.7/1.5	49.8/55.6	50/60
														9.6/8.7	1.7/1.5	61.8/66.5	70/70
EH*D-3S22	15.0/19.9	41.5/47.9	-	-	60.5/68.5	70/70											
			9.6/8.7	-	72.5/79.3	80/80											
			-	1.7/1.5	62.6/70.3	70/80											
			9.6/8.7	1.7/1.5	74.6/81.2	80/90											
DRC0483W	208/230/3/60	1	14	83.1	1	0.17	0.95	1	1.2	5	-	-	-	-	-	23.5/23.5	35/35
											-	-	-	9.6/8.7	-	33.1/32.2	45/45
											-	-	-	-	1.7/1.5	25.2/25.0	35/35
											-	-	-	9.6/8.7	1.7/1.5	34.8/33.7	45/45
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	23.5/23.5	35/35
														9.6/8.7	-	33.1/32.2	45/45
														-	1.7/1.5	25.2/25.0	35/35
														9.6/8.7	1.7/1.5	34.8/34.0	45/45
											EH*D-3S10	7.5/10.0	20.8/24.1	-	-	32.3/36.3	35/40
														9.6/8.7	-	44.3/47.2	45/50
														-	1.7/1.5	34.4/38.2	35/40
														9.6/8.7	1.7/1.5	46.4/49.1	50/50
											EH*D-3S15	11.3/15.0	31.3/36.1	-	-	45.3/51.4	50/60
														9.6/8.7	-	57.3/62.2	60/70
														-	1.7/1.5	47.5/53.2	50/60
														9.6/8.7	1.7/1.5	59.5/64.1	60/70
EH*D-3S21	15.0/19.9	41.5/47.9	-	-	58.1/66.1	60/70											
			9.6/8.7	-	70.1/77.0	80/80											
			-	1.7/1.5	60.2/68.0	70/70											
			9.6/8.7	1.7/1.5	72.2/78.8	80/80											

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet		Optional Power Exhaust		Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP		
DRC0484D	460/3/60	1	6.4	41	1	0.17	0.48	1	1.2	2.5	-	-	-	-	-	11.0	15		
											-	-	-	4.3	-	15.3	20		
											-	-	-	-	-	0.5	11.5	15	
											-	-	-	4.3	0.5	15.8	20		
											-	-	-	-	-	-	11.0	15	
											EH*D-4S05	5	6.01	4.3	-	16.0	20		
														-	0.5	11.5	15		
														4.3	0.5	16.6	20		
											EH*D-4S10	10	12	-	-	18.2	20		
														4.3	-	23.5	25		
														-	0.5	18.8	20		
											EH*D-4S15	15	18	4.3	0.5	24.2	25		
														-	-	25.7	30		
														4.3	-	31.1	35		
											EH*D-4S22	20	24.1	-	-	26.3	30		
														4.3	0.5	31.7	35		
-	-	33.2	35																
-	-	-	4.3	-	38.6	40													
-	-	-	-	-	33.8	35													
-	-	-	4.3	0.5	39.2	40													
DRC0484W	460/3/60	1	6.4	41	1	0.17	0.48	1	1.2	2.5	-	-	-	-	-	11.0	15		
											-	-	-	4.3	-	15.3	20		
											-	-	-	-	-	0.5	11.5	15	
											-	-	-	4.3	0.5	15.8	20		
											-	-	-	-	-	-	11.0	15	
											EH*D-4S05	5	6.01	4.3	-	16.0	20		
														-	0.5	11.5	15		
														4.3	0.5	16.6	20		
											EH*D-4S10	10	12	-	-	18.2	20		
														4.3	-	23.5	25		
														-	0.5	18.8	20		
											EH*D-4S15	15	18	4.3	0.5	24.2	25		
														-	-	25.7	30		
														4.3	-	31.1	35		
											EH*D-4S21	20	24.1	-	-	26.3	30		
														4.3	0.5	31.7	35		
-	-	33.2	35																
-	-	-	4.3	-	38.6	40													
-	-	-	-	-	33.8	35													
-	-	-	4.3	0.5	39.2	40													
DRC0487D	575/3/60	1	4.6	33	1	0.17	0.39	1	1.2	2	-	-	-	-	-	8.1	15		
											-	-	-	3.5	-	11.6	15		
											-	-	-	-	-	1.7	8.7	15	
											-	-	-	3.5	1.7	12.2	15		
											-	-	-	-	-	-	8.5	15	
											EH*D-7S05	5	4.81	3.5	-	12.9	15		
														-	1.7	9.3	15		
														3.5	1.7	13.6	15		
											EH*D-7S10	10	9.62	-	-	14.5	15		
														3.5	-	18.9	20		
														-	1.7	15.3	20		
											EH*D-7S15	15	14.4	3.5	1.7	19.7	20		
														-	-	20.5	25		
														3.5	-	24.9	25		
											EH*D-7S22	20	19.2	-	-	21.3	25		
														3.5	1.7	25.7	30		
-	-	26.6	30																
-	-	-	3.5	-	30.9	35													
-	-	-	-	-	27.3	30													
-	-	-	3.5	1.7	31.7	35													
DRC0487W	575/3/60	1	4.6	33	1	0.17	0.39	1	1.2	2	-	-	-	-	-	8.1	15		
											-	-	-	3.5	-	11.6	15		
											-	-	-	-	-	1.7	8.7	15	
											-	-	-	3.5	1.7	12.2	15		
											-	-	-	-	-	-	8.5	15	
											EH*D-7S05	5	4.81	3.5	-	12.9	15		
														-	1.7	9.3	15		
														3.5	1.7	13.6	15		
											EH*D-7S10	10	9.62	-	-	14.5	15		
														3.5	-	18.9	20		
														-	1.7	15.3	20		
											EH*D-7S15	15	14.4	3.5	1.7	19.7	20		
														-	-	20.5	25		
														3.5	-	24.9	25		
											EH*D-7S21	20	19.2	-	-	21.3	25		
														3.5	1.7	25.7	30		
-	-	26.6	30																
-	-	-	3.5	-	30.9	35													
-	-	-	-	-	27.3	30													
-	-	-	3.5	1.7	31.7	35													

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRC0601D	208/230/1/60	1	26.9	139.9	1	0.33	2.6	1	1	6.9	-	-	-	-	-	43.2/43.2	70/70
											-	-	-	9.6/8.7	-	52.8/51.9	70/70
											-	-	-	-	1.7/1.5	44.9/44.7	70/70
											-	-	-	9.6/8.7	1.7/1.5	54.5/53.4	80/80
											-	-	-	-	-	43.2/43.2	70/70
											EH*D-1S05	3.8/5.0	18.1/20.8	9.6/8.7	-	52.8/51.9	70/70
														-	1.7/1.5	44.9/44.7	70/70
											EH*D-1S10	7.5/10.0	36.1/41.7	9.6/8.7	-	54.5/53.4	80/80
														-	1.7/1.5	53.8/60.7	70/70
											EH*D-1S15	11.3/15.0	54.2/62.5	9.6/8.7	-	65.8/71.6	70/80
														-	1.7/1.5	55.9/62.6	70/70
											EH*D-1S22	15.0/20.0	72.2/83.3	9.6/8.7	-	67.9/73.5	80/80
														-	1.7/1.5	76.3/86.8	80/90
											-	-	-	9.6/8.7	-	78.5/88.6	80/90
											-	-	-	-	-	90.5/99.5	100/100
											-	-	-	9.6/8.7	-	98.9/113	100/125
-	-	-	-	-	111/124	125/125											
-	-	-	9.6/8.7	-	101/115	110/125											
-	-	-	-	-	113/126	125/150											
DRC0603D	208/230/3/60	1	16.2	110	1	0.33	2.6	1	1	6.9	-	-	-	-	-	29.8/29.8	45/45
											-	-	-	9.6/8.7	-	39.4/38.5	50/50
											-	-	-	-	1.7/1.5	31.5/31.3	45/45
											-	-	-	9.6/8.7	1.7/1.5	41.1/40.0	50/50
											-	-	-	-	-	29.8/29.8	45/45
											EH*D-3S05	3.8/5.0	10.4/12.0	9.6/8.7	-	39.4/38.5	50/50
														-	1.7/1.5	31.5/31.3	45/45
											EH*D-3S10	7.5/10.0	20.8/24.1	9.6/8.7	-	41.1/40.0	50/50
														-	1.7/1.5	34.7/38.7	45/45
											EH*D-3S15	11.3/15.0	31.3/36.1	9.6/8.7	-	46.7/49.6	50/50
														-	1.7/1.5	36.8/40.6	45/45
											EH*D-3S22	15.0/19.9	41.5/47.9	9.6/8.7	-	48.8/51.4	50/60
														-	1.7/1.5	47.7/53.7	50/60
											-	-	-	9.6/8.7	-	59.7/64.6	60/70
											-	-	-	-	-	49.8/55.6	50/60
											-	-	-	9.6/8.7	-	61.8/66.5	70/70
-	-	-	-	-	60.5/68.5	70/70											
-	-	-	9.6/8.7	-	72.5/79.3	80/80											
-	-	-	-	-	62.6/70.3	70/80											
-	-	-	9.6/8.7	-	74.6/81.2	80/90											
DRC0603W	208/230/3/60	1	16.2	110	1	0.33	2.6	1	2.3	7.7	-	-	-	-	-	30.6/30.6	45/45
											-	-	-	9.6/8.7	-	40.2/39.3	50/50
											-	-	-	-	1.7/1.5	32.3/32.1	45/45
											-	-	-	9.6/8.7	1.7/1.5	41.9/40.8	50/50
											-	-	-	-	-	30.6/30.6	45/45
											EH*D-3S05	3.8/5.0	10.4/12.0	9.6/8.7	-	40.2/39.3	50/50
														-	1.7/1.5	32.3/32.1	45/45
											EH*D-3S10	7.5/10.0	20.8/24.1	9.6/8.7	-	41.9/40.8	50/50
														-	1.7/1.5	35.7/39.7	45/45
											EH*D-3S15	11.3/15.0	31.3/36.1	9.6/8.7	-	47.7/50.6	50/60
														-	1.7/1.5	37.8/41.6	45/45
											EH*D-3S20	15.0/19.9	41.5/47.9	9.6/8.7	-	49.8/52.4	50/60
														-	1.7/1.5	48.7/54.7	50/60
											-	-	-	9.6/8.7	-	60.7/65.6	70/70
											-	-	-	-	-	50.8/56.6	60/60
											-	-	-	9.6/8.7	-	62.8/67.5	70/70
-	-	-	-	-	61.5/69.5	70/70											
-	-	-	9.6/8.7	-	73.5/80.3	80/90											
-	-	-	-	-	63.6/71.3	70/80											
-	-	-	9.6/8.7	-	75.6/82.2	80/90											

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRC0604D	460/3/60	1	7.6	52	1	0.33	1.6	1	1.2	2.5	-	-	-	-	-	13.6	20
											-	-	-	4.3	-	17.9	25
											-	-	-	-	0.5	14.1	20
											-	-	-	4.3	0.5	18.4	25
											-	-	-	-	-	13.6	20
											EH*D-4S05	5	6.01	4.3	-	17.9	25
														-	0.5	14.1	20
														4.3	0.5	18.4	25
											EH*D-4S10	10	12	-	-	18.2	20
														4.3	-	23.5	25
														-	0.5	18.8	20
											EH*D-4S15	15	18	4.3	0.5	24.2	25
														-	-	25.7	30
														4.3	-	31.1	35
											EH*D-4S22	20	24.1	-	-	26.3	30
														4.3	0.5	31.7	35
-	-	33.2	35														
-	-	-	4.3	-	38.6	40											
-	-	-	-	0.5	33.8	35											
-	-	-	4.3	0.5	39.2	40											
DRC0604W	460/3/60	1	7.6	52	1	0.33	1.6	1	2.3	4.5	-	-	-	-	-	15.6	20
											-	-	-	4.3	-	19.9	25
											-	-	-	-	0.5	16.1	20
											-	-	-	4.3	0.5	20.4	25
											-	-	-	-	-	15.6	20
											EH*D-4S05	5	6.01	4.3	-	19.9	25
														-	0.5	16.1	20
														4.3	0.5	20.4	25
											EH*D-4S10	10	12	-	-	20.7	25
														4.3	-	26.0	30
														-	0.5	21.3	25
											EH*D-4S15	15	18	4.3	0.5	26.7	30
														-	-	28.2	30
														4.3	-	33.6	35
											EH*D-4S20	20	24.1	-	0.5	28.8	30
														4.3	0.5	34.2	35
-	-	35.7	40														
-	-	-	4.3	-	41.1	45											
-	-	-	-	0.5	36.3	40											
-	-	-	4.3	0.5	41.7	45											
DRC0607D	575/3/60	1	5.3	38.9	1	0.33	1.144	1	1.2	2	-	-	-	-	-	9.8	15
											-	-	-	3.5	-	13.3	15
											-	-	-	-	1.7	10.4	15
											-	-	-	3.5	1.7	13.9	15
											-	-	-	-	-	9.8	15
											EH*D-7S05	5	4.81	3.5	-	13.3	15
														-	1.7	10.4	15
														3.5	1.7	13.9	15
											EH*D-7S10	10	9.62	-	-	14.5	15
														3.5	-	18.9	20
														-	1.7	15.3	20
											EH*D-7S15	15	14.4	3.5	1.7	19.7	20
														-	-	20.5	25
														3.5	-	24.9	25
											EH*D-7S22	20	19.2	-	1.7	21.3	25
														3.5	1.7	25.7	30
-	-	26.6	30														
-	-	-	3.5	-	30.9	35											
-	-	-	-	1.7	27.3	30											
-	-	-	3.5	1.7	31.7	35											
DRC0607W	575/3/60	1	5.3	38.9	1	0.33	1.144	1	2.3	3.8	-	-	-	-	-	11.6	15
											-	-	-	3.5	-	15.1	20
											-	-	-	-	1.7	12.2	15
											-	-	-	3.5	1.7	15.7	20
											-	-	-	-	-	11.6	15
											EH*D-7S05	5	4.81	3.5	-	15.1	20
														-	1.7	12.2	15
														3.5	1.7	15.9	20
											EH*D-7S10	10	9.62	-	-	16.8	20
														3.5	-	21.2	25
														-	1.7	17.5	20
											EH*D-7S15	15	14.4	3.5	1.7	21.9	25
														-	-	22.8	25
														3.5	-	27.2	30
											EH*D-7S20	20	19.2	-	1.7	23.5	25
														3.5	1.7	27.9	30
-	-	28.8	30														
-	-	-	3.5	-	33.2	35											
-	-	-	-	1.7	29.6	30											
-	-	-	3.5	1.7	33.9	35											

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRC0723D	208/230/3/60	1	17.6	136	1	0.33	2	1	1.2	5	-	-	-	-	-	29.0/29.0	45/45
											-	-	-	9.6/8.7	-	38.6/37.7	50/50
											-	-	-	-	1.7/1.5	30.7/30.5	45/45
											-	-	-	9.6/8.7	1.7/1.5	40.3/39.2	50/50
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	29.0/29.0	45/45
														9.6/8.7	-	38.6/37.7	50/50
														-	1.7/1.5	30.7/30.5	45/45
														9.6/8.7	1.7/1.5	40.3/39.2	50/50
											EH*D-3S10	7.5/10.0	20.8/24.1	-	-	32.3/36.3	45/45
														9.6/8.7	-	44.3/47.2	50/50
														-	1.7/1.5	34.4/38.2	45/45
														9.6/8.7	1.7/1.5	46.4/49.1	50/50
											EH*D-3S15	11.3/15.0	31.3/36.1	-	-	45.3/51.4	50/60
														9.6/8.7	-	57.3/62.2	60/70
														-	1.7/1.5	47.5/53.2	50/60
														9.6/8.7	1.7/1.5	59.5/64.1	60/70
											EH*D-3S21	15.0/19.9	41.5/47.9	-	-	58.1/66.1	60/70
														9.6/8.7	-	70.1/77.0	80/80
														-	1.7/1.5	60.2/68.0	70/70
														9.6/8.7	1.7/1.5	72.2/78.8	80/80
EH*D-3S31	21.6/28.8	60.0/69.3	-	-	81.3/92.9	90/100											
			9.6/8.7	-	93.3/104	100/110											
			-	1.7/1.5	83.4/94.7	90/100											
			9.6/8.7	1.7/1.5	95.4/106	100/110											
DRC0723W	208/230/3/60	1	17.6	136	1	0.33	2	1	2.3	7.7	-	-	-	-	-	31.7/31.7	45/45
											-	-	-	9.6/8.7	-	41.3/40.4	50/50
											-	-	-	-	1.7/1.5	33.4/33.2	50/50
											-	-	-	9.6/8.7	1.7/1.5	43.0/41.9	60/50
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	31.7/31.7	45/45
														9.6/8.7	-	41.3/40.4	50/50
														-	1.7/1.5	33.4/33.2	50/50
														9.6/8.7	1.7/1.5	43.0/41.9	60/50
											EH*D-3S10	7.5/10.0	20.8/24.1	-	-	35.7/39.7	45/45
														9.6/8.7	-	47.7/50.6	50/60
														-	1.7/1.5	37.8/41.6	50/50
														9.6/8.7	1.7/1.5	49.8/52.4	60/60
											EH*D-3S15	11.3/15.0	31.3/36.1	-	-	48.7/54.7	50/60
														9.6/8.7	-	60.7/65.6	70/70
														-	1.7/1.5	50.8/56.6	60/60
														9.6/8.7	1.7/1.5	62.8/67.5	70/70
											EH*D-3S20	15.0/19.9	41.5/47.9	-	-	61.5/69.5	70/70
														9.6/8.7	-	73.5/80.3	80/90
														-	1.7/1.5	63.6/71.3	70/80
														9.6/8.7	1.7/1.5	75.6/82.2	80/90
EH*D-3S30	21.6/28.8	60.0/69.3	-	-	84.7/96.2	90/100											
			9.6/8.7	-	96.7/107	100/110											
			-	1.7/1.5	86.8/98.1	90/100											
			9.6/8.7	1.7/1.5	98.8/109	100/110											

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRC0724D	460/3/60	1	8.5	66.1	1	0.33	0.85	1	1.2	2.5	-	-	-	-	-	13.9	20
											-	-	-	4.3	-	18.2	25
											-	-	-	-	0.5	14.4	20
											-	-	-	4.3	0.5	18.7	25
											-	-	-	-	-	13.9	20
											-	-	-	4.3	-	18.2	25
											-	-	-	-	0.5	14.4	20
											-	-	-	4.3	0.5	18.7	25
											-	-	-	-	-	18.2	20
											-	-	-	4.3	-	23.5	25
											-	-	-	-	0.5	18.8	20
											-	-	-	4.3	0.5	24.2	25
											-	-	-	-	-	25.7	30
											-	-	-	4.3	-	31.1	35
											-	-	-	-	0.5	26.3	30
											-	-	-	4.3	0.5	31.7	35
											-	-	-	-	-	33.2	35
											-	-	-	4.3	-	38.6	40
											-	-	-	-	0.5	33.8	35
											-	-	-	4.3	0.5	39.2	40
											-	-	-	-	-	48.2	50
											-	-	-	4.3	-	53.6	60
											-	-	-	-	0.5	48.9	50
											-	-	-	4.3	0.5	54.2	60
DRC0724W	460/3/60	1	8.5	66.1	1	0.33	0.85	1	2.3	4.5	-	-	-	-	-	15.9	20
											-	-	-	4.3	-	20.2	25
											-	-	-	-	0.5	16.4	20
											-	-	-	4.3	0.5	20.7	25
											-	-	-	-	-	15.9	20
											-	-	-	4.3	-	20.2	25
											-	-	-	-	0.5	16.4	20
											-	-	-	4.3	0.5	20.7	25
											-	-	-	-	-	20.7	25
											-	-	-	4.3	-	26.0	30
											-	-	-	-	0.5	21.3	25
											-	-	-	4.3	0.5	26.7	30
											-	-	-	-	-	28.2	30
											-	-	-	4.3	-	33.6	35
											-	-	-	-	0.5	28.8	30
											-	-	-	4.3	0.5	34.2	35
											-	-	-	-	-	35.7	40
											-	-	-	4.3	-	41.1	45
											-	-	-	-	0.5	36.3	40
											-	-	-	4.3	0.5	41.7	45
											-	-	-	-	-	50.7	60
											-	-	-	4.3	-	56.1	60
											-	-	-	-	0.5	51.4	60
											-	-	-	4.3	0.5	56.7	60
DRC0727D	575/3/60	1	6.3	55.3	1	0.33	0.67	1	1.2	2	-	-	-	-	-	10.6	15
											-	-	-	3.5	-	14.1	20
											-	-	-	-	1.7	11.2	15
											-	-	-	3.5	1.7	14.7	20
											-	-	-	-	-	10.6	15
											-	-	-	4.81	-	14.1	20
											-	-	-	-	1.7	11.2	15
											-	-	-	3.5	1.7	14.7	20
											-	-	-	-	-	14.5	15
											-	-	-	4.81	-	18.9	20
											-	-	-	-	1.7	15.3	20
											-	-	-	3.5	1.7	19.7	20
											-	-	-	-	-	20.5	25
											-	-	-	4.81	-	24.9	25
											-	-	-	-	1.7	21.3	25
											-	-	-	3.5	1.7	25.7	30
											-	-	-	-	-	26.6	30
											-	-	-	4.81	-	30.9	35
											-	-	-	-	1.7	27.3	30
											-	-	-	3.5	1.7	31.7	35
											-	-	-	-	-	38.6	40
											-	-	-	4.81	-	43.0	45
											-	-	-	-	1.7	39.3	40
											-	-	-	3.5	1.7	43.7	45
DRC0727W	575/3/60	1	6.3	55.3	1	0.33	0.67	1	2.3	3.8	-	-	-	-	-	12.4	15
											-	-	-	3.5	-	15.9	20
											-	-	-	-	1.7	13.0	15
											-	-	-	3.5	1.7	16.5	20
											-	-	-	-	-	12.4	15
											-	-	-	4.81	-	15.9	20
											-	-	-	-	1.7	13.0	15
											-	-	-	3.5	1.7	16.5	20
											-	-	-	-	-	16.8	20
											-	-	-	4.81	-	21.2	25
											-	-	-	-	1.7	17.5	20
											-	-	-	3.5	1.7	21.9	25
											-	-	-	-	-	22.8	25
											-	-	-	4.81	-	27.2	30
											-	-	-	-	1.7	23.5	25
											-	-	-	3.5	1.7	27.9	30
											-	-	-	-	-	28.8	30
											-	-	-	4.81	-	33.2	35
											-	-	-	-	1.7	29.6	30
											-	-	-	3.5	1.7	33.9	35
											-	-	-	-	-	40.8	45
											-	-	-	4.81	-	45.2	50
											-	-	-	-	1.7	41.6	45
											-	-	-	3.5	1.7	46.0	50

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRH0361D	208/230/1/60	1	15.6	83	1	0.17	0.95	1	0.75	5.7	-	-	-	-	-	26.2/26.2	40/40
											-	-	-	9.6/8.7	-	35.8/34.9	50/50
											-	-	-	-	1.7/1.5	27.9/27.7	40/40
											-	-	-	9.6/8.7	1.7/1.5	37.5/36.4	50/50
											EH*D-1S05	3.8/5.0	18.1/20.8	-	-	48.8/52.2	50/60
														9.6/8.7	-	58.4/60.9	60/70
														-	1.7/1.5	50.5/53.7	60/60
														9.6/8.7	1.7/1.5	60.1/62.4	70/70
											EH*D-1S10	7.5/10.0	36.1/41.7	-	-	71.3/78.3	80/80
														9.6/8.7	-	80.9/87.0	90/90
														-	1.7/1.5	73.0/79.8	80/80
														9.6/8.7	1.7/1.5	82.6/88.5	90/90
											EH*D-1S16	11.3/15.0	54.2/62.5	-	-	93.9/104	100/110
														9.6/8.7	-	104/113	110/125
-	1.7/1.5	95.6/106	100/110														
9.6/8.7	1.7/1.5	105/115	110/125														
DRH0363D	208/230/3/60	1	11.6	73	1	0.17	0.95	1	0.75	5.7	-	-	-	-	-	21.2/21.2	30/30
											-	-	-	9.6/8.7	-	30.8/29.9	40/40
											-	-	-	-	1.7/1.5	22.9/22.7	30/30
											-	-	-	9.6/8.7	1.7/1.5	32.5/31.4	40/40
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	34.2/36.2	40/40
														9.6/8.7	-	43.8/44.9	50/50
														-	1.7/1.5	35.9/37.7	40/45
														9.6/8.7	1.7/1.5	45.5/46.4	50/50
											EH*D-3S10	7.5/10.0	20.8/24.1	-	-	47.2/51.2	50/60
														9.6/8.7	-	56.8/59.9	60/60
														-	1.7/1.5	48.9/52.7	50/60
														9.6/8.7	1.7/1.5	58.5/61.4	60/70
											EH*D-3S16	11.3/15.0	31.3/36.1	-	-	60.2/66.3	70/70
														9.6/8.7	-	69.8/75.0	70/80
-	1.7/1.5	61.9/67.8	70/70														
9.6/8.7	1.7/1.5	71.5/76.5	80/80														
DRH0363W	208/230/3/60	1	11.6	73	1	0.17	0.95	1	1.2	5	-	-	-	-	-	20.5/20.5	30/30
											-	-	-	9.6/8.7	-	30.1/29.2	40/40
											-	-	-	-	1.7/1.5	22.2/22.0	30/30
											-	-	-	9.6/8.7	1.7/1.5	31.8/30.7	40/40
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	33.5/35.5	40/40
														9.6/8.7	-	43.1/44.2	50/50
														-	1.7/1.5	35.2/37.0	40/45
														9.6/8.7	1.7/1.5	44.8/45.7	50/50
											EH*D-3S10	7.5/10.0	20.8/24.1	-	-	46.5/50.5	50/60
														9.6/8.7	-	56.1/59.2	60/60
														-	1.7/1.5	48.2/52.0	50/60
														9.6/8.7	1.7/1.5	57.8/60.7	60/70
											EH*D-3S15	11.3/15.0	31.3/36.1	-	-	59.5/65.6	60/70
														9.6/8.7	-	69.1/74.3	70/80
-	1.7/1.5	61.2/67.1	70/70														
9.6/8.7	1.7/1.5	70.8/75.8	80/80														

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply		
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP	
DRH0364D	460/3/60	1	5.7	38	1	0.17	0.48	1	1.2	2.5	-	-	-	-	-	10.1	15	
											-	-	-	4.3	-	14.4	20	
											-	-	-	-	-	0.5	10.6	15
											-	-	-	4.3	-	0.5	14.9	20
											EH*D-4S05	5	6.01	-	-	-	17.6	20
														4.3	-	21.9	25	
														-	0.5	18.1	20	
														4.3	0.5	22.4	25	
														-	-	25.1	30	
											EH*D-4S10	10	12	4.3	-	29.4	30	
														-	0.5	25.6	30	
														4.3	0.5	29.9	30	
											EH*D-4S16	15	18	-	-	32.7	35	
														4.3	-	37.0	40	
														-	0.5	33.2	35	
4.3	0.5	37.5	40															
DRH0364W	460/3/60	1	5.7	38	1	0.17	0.48	1	1.2	2.5	-	-	-	-	-	10.1	15	
											-	-	-	4.3	-	14.4	20	
											-	-	-	-	-	0.5	10.6	15
											-	-	-	4.3	-	0.5	14.9	20
											EH*D-4S05	5	6.01	-	-	-	17.6	20
														4.3	-	21.9	25	
														-	0.5	18.1	20	
														4.3	0.5	22.4	25	
														-	-	25.1	30	
											EH*D-4S10	10	12	4.3	-	29.4	30	
														-	0.5	25.6	30	
														4.3	0.5	29.9	30	
											EH*D-4S15	15	18	-	-	32.7	35	
														4.3	-	37.0	40	
														-	0.5	33.2	35	
4.3	0.5	37.5	40															
DRH0367D	575/3/60	1	4	25.6	1	0.17	0.39	1	1.2	2	-	-	-	-	-	7.4	15	
											-	-	-	3.5	-	10.9	15	
											-	-	-	-	-	1.7	8.0	15
											-	-	-	3.5	-	1.7	11.5	15
											EH*D-7S05	5	4.81	-	-	-	13.4	15
														3.5	-	16.9	20	
														-	1.7	14.0	15	
														3.5	1.7	17.5	20	
														-	-	19.4	20	
											EH*D-7S10	10	9.62	3.5	-	22.9	25	
														-	1.7	20.0	20	
														3.5	1.7	23.5	25	
											EH*D-7S16	15	14.4	-	-	25.4	30	
														3.5	-	28.9	30	
														-	1.7	26.0	30	
3.5	1.7	29.5	30															
DRH0367W	575/3/60	1	4	25.6	1	0.17	0.39	1	1.2	2	-	-	-	-	-	7.4	15	
											-	-	-	3.5	-	10.9	15	
											-	-	-	-	-	1.7	8.0	15
											-	-	-	3.5	-	1.7	11.5	15
											EH*D-7S05	5	4.81	-	-	-	13.4	15
														3.5	-	16.9	20	
														-	1.7	14.0	15	
														3.5	1.7	17.5	20	
														-	-	19.4	20	
											EH*D-7S10	10	9.62	3.5	-	22.9	25	
														-	1.7	20.0	20	
														3.5	1.7	23.5	25	
											EH*D-7S15	15	14.4	-	-	25.4	30	
														3.5	-	28.9	30	
														-	1.7	26.0	30	
3.5	1.7	29.5	30															

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRH0481D	208/230/1/60	1	21.2	104	1	0.33	3.5	1	1	6.9	-	-	-	-	-	36.8/36.8	50/50
											-	-	-	9.6/8.7	-	46.4/45.5	60/60
											-	-	-	-	1.7/1.5	38.5/38.3	50/50
											-	-	-	9.6/8.7	1.7/1.5	48.1/47.0	60/60
											-	-	-	-	-	59.4/62.9	70/70
											EH*D-1S05	3.8/5.0	18.1/20.8	9.6/8.7	-	69.0/71.6	80/80
														-	1.7/1.5	61.1/64.4	70/80
											EH*D-1S10	7.5/10.0	36.1/41.7	9.6/8.7	1.7/1.5	70.7/73.1	80/80
														-	-	82.0/88.9	90/90
											EH*D-1S15	11.3/15.0	54.2/62.5	9.6/8.7	-	91.6/97.6	100/100
														-	1.7/1.5	83.7/90.4	90/100
														9.6/8.7	1.7/1.5	93.3/99.1	100/100
														-	-	105/115	110/125
											EH*D-1S22	15.0/20.0	72.2/83.3	9.6/8.7	-	114/124	125/125
														-	1.7/1.5	106/116	110/125
														9.6/8.7	1.7/1.5	116/125	125/150
-	-	127/141	150/150														
EH*D-1S22	15.0/20.0	72.2/83.3	9.6/8.7	-	137/150	150/150											
			-	1.7/1.5	129/143	150/150											
			9.6/8.7	1.7/1.5	138/151	150/175											
			-	-	-	-											
DRH0483D	208/230/3/60	1	14	83.1	1	0.33	3.5	1	1	6.9	-	-	-	-	-	27.9/27.9	40/40
											-	-	-	9.6/8.7	-	37.5/36.6	50/50
											-	-	-	-	1.7/1.5	29.6/29.4	40/40
											-	-	-	9.6/8.7	1.7/1.5	39.2/38.1	50/50
											-	-	-	-	-	41.0/43.0	50/50
											EH*D-3S05	3.8/5.0	10.4/12.0	9.6/8.7	-	50.6/51.7	60/60
														-	1.7/1.5	42.7/44.5	50/50
											EH*D-3S10	7.5/10.0	20.8/24.1	9.6/8.7	1.7/1.5	52.3/53.2	60/60
														-	-	54.0/58.0	60/60
											EH*D-3S15	11.3/15.0	31.3/36.1	9.6/8.7	-	63.6/66.7	70/70
														-	1.7/1.5	55.7/59.5	60/60
														9.6/8.7	1.7/1.5	65.3/68.2	70/70
														-	-	67.0/73.1	70/80
											EH*D-3S22	15.0/19.9	41.5/47.9	9.6/8.7	-	76.6/81.8	80/90
														-	1.7/1.5	68.7/74.6	70/80
														9.6/8.7	1.7/1.5	78.3/83.3	80/90
-	-	79.8/87.8	80/90														
EH*D-3S22	15.0/19.9	41.5/47.9	9.6/8.7	-	89.4/96.5	90/100											
			-	1.7/1.5	81.5/89.3	90/90											
-	-	-	9.6/8.7	1.7/1.5	91.1/98.0	100/100											
DRH0483W	208/230/3/60	1	14	83.1	1	0.33	3.5	1	1.2	5	-	-	-	-	-	26.0/26.0	40/40
											-	-	-	9.6/8.7	-	35.6/34.7	45/45
											-	-	-	-	1.7/1.5	27.7/27.5	40/40
											-	-	-	9.6/8.7	1.7/1.5	37.3/36.2	50/50
											-	-	-	-	-	39.1/41.1	50/50
											EH*D-3S05	3.8/5.0	10.4/12.0	9.6/8.7	-	48.7/49.8	60/60
														-	1.7/1.5	40.8/42.6	50/50
											EH*D-3S10	7.5/10.0	20.8/24.1	9.6/8.7	1.7/1.5	50.4/51.3	60/60
														-	-	52.1/56.1	60/60
											EH*D-3S15	11.3/15.0	31.3/36.1	9.6/8.7	-	61.7/64.8	70/70
														-	1.7/1.5	53.8/57.6	60/60
														9.6/8.7	1.7/1.5	63.4/66.3	70/70
														-	-	65.1/71.2	70/80
											EH*D-3S21	15.0/19.9	41.5/47.9	9.6/8.7	-	74.7/79.9	80/80
														-	1.7/1.5	66.8/72.7	70/80
														9.6/8.7	1.7/1.5	76.4/81.4	80/90
-	-	77.9/85.9	80/90														
EH*D-3S21	15.0/19.9	41.5/47.9	9.6/8.7	-	87.5/94.6	90/100											
			-	1.7/1.5	79.6/87.4	80/90											
-	-	-	9.6/8.7	1.7/1.5	89.2/96.1	90/100											

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet		Optional Power Exhaust		Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP		
DRH0484D	460/3/60	1	6.4	41	1	0.33	1.6	1	1.2	2.5	-	-	-	-	-	12.1	15		
											-	-	-	4.3	-	16.4	20		
											-	-	-	-	0.5	12.6	15		
											-	-	-	4.3	0.5	16.9	20		
											-	-	-	-	-	19.6	20		
											EH*D-4S05	5	6.01	4.3	-	23.9	25		
														-	0.5	20.1	25		
														4.3	0.5	24.4	25		
											-	-	-	-	-	27.1	30		
											EH*D-4S10	10	12	4.3	-	31.4	35		
														-	0.5	27.6	30		
														4.3	0.5	31.9	35		
											-	-	-	-	-	34.7	35		
											EH*D-4S15	15	18	4.3	-	39.0	40		
														-	0.5	35.2	40		
4.3	0.5	39.5	40																
-	-	-	-	-	42.2	45													
EH*D-4S22	20	24.1	4.3	-	46.5	50													
			-	0.5	42.7	45													
			4.3	0.5	47.0	50													
DRH0484W	460/3/60	1	6.4	41	1	0.33	1.6	1	1.2	2.5	-	-	-	-	-	12.1	15		
											-	-	-	4.3	-	16.4	20		
											-	-	-	-	0.5	12.6	15		
											-	-	-	4.3	0.5	16.9	20		
											-	-	-	-	-	19.6	20		
											EH*D-4S05	5	6.01	4.3	-	23.9	25		
														-	0.5	20.1	25		
														4.3	0.5	24.4	25		
											-	-	-	-	-	27.1	30		
											EH*D-4S10	10	12	4.3	-	31.4	35		
														-	0.5	27.6	30		
														4.3	0.5	31.9	35		
											-	-	-	-	-	34.7	35		
											EH*D-4S15	15	18	4.3	-	39.0	40		
														-	0.5	35.2	40		
4.3	0.5	39.5	40																
-	-	-	-	-	42.2	45													
EH*D-4S21	20	24.1	4.3	-	46.5	50													
			-	0.5	42.7	45													
			4.3	0.5	47.0	50													
DRH0487D	575/3/60	1	4.6	33	1	0.33	1.54	1	1.2	2	-	-	-	-	-	9.2	15		
											-	-	-	3.5	-	12.7	15		
											-	-	-	-	1.7	9.8	15		
											-	-	-	3.5	1.7	13.3	15		
											-	-	-	-	-	15.2	20		
											EH*D-7S05	5	4.81	3.5	-	18.7	20		
														-	1.7	15.8	20		
														3.5	1.7	19.3	20		
											-	-	-	-	-	21.3	25		
											EH*D-7S10	10	9.62	3.5	-	24.8	25		
														-	1.7	21.9	25		
														3.5	1.7	25.4	30		
											-	-	-	-	-	27.3	30		
											EH*D-7S15	15	14.4	3.5	-	30.8	35		
														-	1.7	27.9	30		
3.5	1.7	31.4	35																
-	-	-	-	-	33.3	35													
EH*D-7S22	20	19.2	3.5	-	36.8	40													
			-	1.7	33.9	35													
			3.5	1.7	37.4	40													
DRH0487W	575/3/60	1	4.6	33	1	0.33	1.54	1	1.2	2	-	-	-	-	-	9.2	15		
											-	-	-	3.5	-	12.7	15		
											-	-	-	-	1.7	9.8	15		
											-	-	-	3.5	1.7	13.3	15		
											-	-	-	-	-	15.2	20		
											EH*D-7S05	5	4.81	3.5	-	18.7	20		
														-	1.7	15.8	20		
														3.5	1.7	19.3	20		
											-	-	-	-	-	21.3	25		
											EH*D-7S10	10	9.62	3.5	-	24.8	25		
														-	1.7	21.9	25		
														3.5	1.7	25.4	30		
											-	-	-	-	-	27.3	30		
											EH*D-7S15	15	14.4	3.5	-	30.8	35		
														-	1.7	27.9	30		
3.5	1.7	31.4	35																
-	-	-	-	-	33.3	35													
EH*D-7S21	20	19.2	3.5	-	36.8	40													
			-	1.7	33.9	35													
			3.5	1.7	37.4	40													

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRH0601D	208/230/1/60	1	26.9	139.9	1	0.33	3.5	1	1	6.9	-	-	-	-	-	44.1/44.1	70/70
											-	-	-	9.6/8.7	-	53.7/52.8	80/70
											-	-	-	-	1.7/1.5	45.8/45.6	70/70
											-	-	-	9.6/8.7	1.7/1.5	55.4/54.3	80/80
											-	-	-	-	-	66.6/70.1	80/90
											EH*D-1S05	3.8/5.0	18.1/20.8	9.6/8.7	-	76.2/78.8	90/100
														-	1.7/1.5	68.3/71.6	90/90
											EH*D-1S10	7.5/10.0	36.1/41.7	9.6/8.7	1.7/1.5	77.9/80.3	100/100
														-	-	89.2/96.1	100/110
														9.6/8.7	-	98.8/105	110/110
														-	1.7/1.5	90.9/97.6	100/110
											EH*D-1S15	11.3/15.0	54.2/62.5	9.6/8.7	1.7/1.5	100/106	110/110
														-	-	112/122	125/125
														9.6/8.7	-	121/131	125/150
														-	1.7/1.5	113/124	125/125
											EH*D-1S22	15.0/20.0	72.2/83.3	9.6/8.7	1.7/1.5	123/132	125/150
-	-	134/148	150/150														
9.6/8.7	-	144/157	150/175														
-	1.7/1.5	136/150	150/150														
-	-	-	9.6/8.7	1.7/1.5	146/158	150/175											
DRH0603D	208/230/3/60	1	16.2	110	1	0.33	3.5	1	1	6.9	-	-	-	-	-	30.7/30.7	45/45
											-	-	-	9.6/8.7	-	40.3/39.4	50/50
											-	-	-	-	1.7/1.5	32.4/32.2	45/45
											-	-	-	9.6/8.7	1.7/1.5	42.0/40.9	50/50
											-	-	-	-	-	43.7/45.7	50/50
											EH*D-3S05	3.8/5.0	10.4/12.0	9.6/8.7	-	53.3/54.4	60/60
														-	1.7/1.5	45.4/47.2	50/60
											EH*D-3S10	7.5/10.0	20.8/24.1	9.6/8.7	1.7/1.5	55.0/55.9	60/60
														-	-	56.7/60.7	60/70
														9.6/8.7	-	66.3/69.4	70/70
														-	1.7/1.5	58.4/62.2	60/70
											EH*D-3S15	11.3/15.0	31.3/36.1	9.6/8.7	1.7/1.5	68.0/70.9	70/80
														-	-	69.8/75.8	70/80
														9.6/8.7	-	79.4/84.5	80/90
														-	1.7/1.5	71.5/77.3	80/80
											EH*D-3S22	15.0/19.9	41.5/47.9	9.6/8.7	1.7/1.5	81.1/86.0	90/90
-	-	82.5/90.5	90/100														
9.6/8.7	-	92.1/99.2	100/100														
-	1.7/1.5	84.2/92.0	90/100														
-	-	-	9.6/8.7	1.7/1.5	93.8/101	100/110											
DRH0603W	208/230/3/60	1	16.2	110	1	0.33	3.5	1	2.3	7.7	-	-	-	-	-	31.5/31.5	45/45
											-	-	-	9.6/8.7	-	41.1/40.2	50/50
											-	-	-	-	1.7/1.5	33.2/33.0	45/45
											-	-	-	9.6/8.7	1.7/1.5	42.8/41.7	50/50
											-	-	-	-	-	44.5/46.5	50/50
											EH*D-3S05	3.8/5.0	10.4/12.0	9.6/8.7	-	54.1/55.2	60/60
														-	1.7/1.5	46.2/48.0	50/60
											EH*D-3S10	7.5/10.0	20.8/24.1	9.6/8.7	1.7/1.5	55.8/56.7	60/60
														-	-	57.5/61.5	60/70
														9.6/8.7	-	67.1/70.2	70/80
														-	1.7/1.5	59.2/63.0	70/70
											EH*D-3S15	11.3/15.0	31.3/36.1	9.6/8.7	1.7/1.5	68.8/71.7	70/80
														-	-	70.6/76.6	80/80
														9.6/8.7	-	80.2/85.3	90/90
														-	1.7/1.5	72.3/78.1	80/80
											EH*D-3S20	15.0/19.9	41.5/47.9	9.6/8.7	1.7/1.5	81.9/86.8	90/90
-	-	83.3/91.3	90/100														
9.6/8.7	-	92.9/100	100/110														
-	1.7/1.5	85.0/92.8	90/100														
-	-	-	9.6/8.7	1.7/1.5	94.6/102	100/110											

APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRH0604D	460/3/60	1	7.6	52	1	0.33	1.6	1	1.2	2.5	-	-	-	-	-	13.6	20
											-	-	-	4.3	-	17.9	25
											-	-	-	-	0.5	14.1	20
											-	-	-	4.3	0.5	18.4	25
											-	-	-	-	-	21.2	25
											EH*D-4S05	5	6.01	4.3	-	25.5	30
														-	0.5	21.7	25
														4.3	0.5	26.0	30
											EH*D-4S10	10	12	-	-	28.7	30
														4.3	-	33.0	35
														-	0.5	29.2	30
											EH*D-4S15	15	18	4.3	-	33.5	35
														-	-	36.2	40
														4.3	-	40.5	45
											EH*D-4S22	20	24.1	-	-	36.7	40
														4.3	0.5	41.0	45
-	-	43.7	45														
-	-	-	4.3	-	48.0	50											
-	-	-	-	0.5	44.2	45											
-	-	-	4.3	0.5	48.5	50											
DRH0604W	460/3/60	1	7.6	52	1	0.33	1.6	1	2.3	4.5	-	-	-	-	-	15.6	20
											-	-	-	4.3	-	19.9	25
											-	-	-	-	0.5	16.1	20
											-	-	-	4.3	0.5	20.4	25
											-	-	-	-	-	23.2	25
											EH*D-4S05	5	6.01	4.3	-	27.5	30
														-	0.5	23.7	25
														4.3	0.5	28.0	30
											EH*D-4S10	10	12	-	-	30.7	35
														4.3	-	35.0	35
														-	0.5	31.2	35
											EH*D-4S15	15	18	4.3	-	35.5	40
														-	-	38.2	40
														4.3	-	42.5	45
											EH*D-4S20	20	24.1	-	-	38.7	40
														4.3	0.5	43.0	45
-	-	45.7	50														
-	-	-	4.3	-	50.0	60											
-	-	-	-	0.5	46.2	50											
-	-	-	4.3	0.5	50.5	60											
DRH0607D	575/3/60	1	5.3	38.9	1	0.33	1.54	1	1.2	2	-	-	-	-	-	10.2	15
											-	-	-	3.5	-	13.7	15
											-	-	-	-	1.7	10.8	15
											-	-	-	3.5	1.7	14.3	15
											-	-	-	-	-	16.2	20
											EH*D-7S05	5	4.81	3.5	-	19.7	20
														-	1.7	16.8	20
														3.5	1.7	20.3	25
											EH*D-7S10	10	9.62	-	-	22.2	25
														3.5	-	25.7	30
														-	1.7	22.8	25
											EH*D-7S15	15	14.4	3.5	-	26.3	30
														-	-	28.2	30
														3.5	-	31.7	35
											EH*D-7S22	20	19.2	-	-	28.8	30
														3.5	1.7	32.3	35
-	-	34.2	35														
-	-	-	3.5	-	37.7	40											
-	-	-	-	1.7	34.8	35											
-	-	-	3.5	1.7	38.3	40											
DRH0607W	575/3/60	1	5.3	38.9	1	0.33	1.54	1	2.3	3.8	-	-	-	-	-	12.0	15
											-	-	-	3.5	-	15.5	20
											-	-	-	-	1.7	12.6	15
											-	-	-	3.5	1.7	16.1	20
											-	-	-	-	-	18.0	20
											EH*D-7S05	5	4.81	3.5	-	21.5	25
														-	1.7	18.6	20
														3.5	1.7	22.1	25
											EH*D-7S10	10	9.62	-	-	24.0	25
														3.5	-	27.5	30
														-	1.7	24.6	25
											EH*D-7S15	15	14.4	3.5	-	28.1	30
														-	-	30.0	35
														3.5	-	33.5	35
											EH*D-7S20	20	19.2	-	-	30.6	35
														3.5	1.7	34.1	35
-	-	36.0	40														
-	-	-	3.5	-	39.5	40											
-	-	-	-	1.7	36.6	40											
-	-	-	3.5	1.7	40.1	45											


APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DRH0723D	208/230/3/60	1	17.6	136	1	0.33	2	1	1.2	5	-	-	-	-	-	29.0/29.0	45/45
											-	-	-	9.6/8.7	-	38.6/37.7	50/50
											-	-	-	-	1.7/1.5	30.7/30.5	45/45
											-	-	-	9.6/8.7	1.7/1.5	40.3/39.2	50/50
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	42.0/44.0	50/50
														9.6/8.7	-	51.6/52.7	60/60
														-	1.7/1.5	43.7/45.5	50/60
														9.6/8.7	1.7/1.5	53.3/54.2	60/60
														-	-	55.0/59.0	60/70
														9.6/8.7	-	64.6/67.7	70/70
											EH*D-3S10	7.5/10.0	20.8/24.1	-	1.7/1.5	56.7/60.5	60/70
														9.6/8.7	1.7/1.5	66.3/69.2	70/80
														-	-	68.0/74.1	70/80
														9.6/8.7	-	77.6/82.8	80/90
											EH*D-3S15	11.3/15.0	31.3/36.1	-	1.7/1.5	69.7/75.6	70/80
														9.6/8.7	1.7/1.5	79.3/84.3	80/90
														-	-	80.8/88.8	90/90
														9.6/8.7	-	90.4/97.5	100/100
											EH*D-3S21	15.0/19.9	41.5/47.9	-	1.7/1.5	82.5/90.3	90/100
														9.6/8.7	1.7/1.5	92.1/99.0	100/100
-	-	104/116	110/125														
9.6/8.7	-	114/124	125/125														
EH*D-3S31	21.6/28.8	60.0/69.3	-	1.7/1.5	106/117	110/125											
			9.6/8.7	1.7/1.5	115/126	125/150											
			-	-	31.7/31.7	45/45											
			-	-	41.3/40.4	50/50											
DRH0723W	208/230/3/60	1	17.6	136	1	0.33	2	1	2.3	7.7	-	-	-	-	-	31.7/31.7	45/45
											-	-	-	9.6/8.7	-	41.3/40.4	50/50
											-	-	-	-	1.7/1.5	33.4/33.2	50/50
											-	-	-	9.6/8.7	1.7/1.5	43.0/41.9	60/50
											EH*D-3S05	3.8/5.0	10.4/12.0	-	-	44.7/46.7	50/60
														9.6/8.7	-	54.3/55.4	60/60
														-	1.7/1.5	46.4/48.2	60/60
														9.6/8.7	1.7/1.5	56.0/56.9	70/70
														-	-	57.7/61.7	70/70
														9.6/8.7	-	67.3/70.4	70/80
											EH*D-3S10	7.5/10.0	20.8/24.1	-	1.7/1.5	59.4/63.2	70/70
														9.6/8.7	1.7/1.5	69.0/71.9	80/80
														-	-	70.7/76.8	80/80
														9.6/8.7	-	80.3/85.5	90/90
											EH*D-3S15	11.3/15.0	31.3/36.1	-	1.7/1.5	72.4/78.3	80/80
														9.6/8.7	1.7/1.5	82.0/87.0	90/90
														-	-	83.5/91.5	90/100
														9.6/8.7	-	93.1/100	100/110
											EH*D-3S20	15.0/19.9	41.5/47.9	-	1.7/1.5	85.2/93.0	90/100
														9.6/8.7	1.7/1.5	94.8/102	100/110
-	-	107/118	110/125														
9.6/8.7	-	116/127	125/150														
EH*D-3S30	21.6/28.8	60.0/69.3	-	1.7/1.5	108/120	110/125											
			9.6/8.7	1.7/1.5	118/128	125/150											
			-	-													
			9.6/8.7	1.7/1.5													


APPENDIX B ELECTRICAL DATA

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet		Optional Power Exhaust		Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	QTY	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP		
DRH0724D	460/3/60	1	8.5	66.1	1	0.33	0.85	1	1.2	2.5	-	-	-	-	-	13.9	20		
											-	-	-	4.3	-	18.2	25		
											-	-	-	-	0.5	14.4	20		
											-	-	-	4.3	0.5	18.7	25		
											-	-	-	-	-	21.4	25		
											-	-	-	4.3	-	25.7	30		
											-	-	-	-	0.5	21.9	25		
											-	-	-	4.3	0.5	26.2	30		
											-	-	-	-	-	29.0	30		
											-	-	-	4.3	-	33.3	35		
											-	-	-	-	0.5	29.5	30		
											-	-	-	4.3	0.5	33.8	35		
											-	-	-	-	-	36.5	40		
											-	-	-	4.3	-	40.8	45		
											-	-	-	-	0.5	37.0	40		
											-	-	-	4.3	0.5	41.3	45		
											-	-	-	-	-	44.0	45		
											-	-	-	4.3	-	48.3	50		
											-	-	-	-	0.5	44.5	45		
											-	-	-	4.3	0.5	48.8	50		
											-	-	-	-	-	59.0	60		
-	-	-	4.3	-	63.3	70													
-	-	-	-	0.5	59.5	60													
-	-	-	4.3	0.5	63.8	70													
DRH0724W	460/3/60	1	8.5	66.1	1	0.33	0.85	1	2.3	4.5	-	-	-	-	-	15.9	20		
											-	-	-	4.3	-	20.2	25		
											-	-	-	-	0.5	16.4	20		
											-	-	-	4.3	0.5	20.7	25		
											-	-	-	-	-	23.4	30		
											-	-	-	4.3	-	27.7	30		
											-	-	-	-	0.5	23.9	30		
											-	-	-	4.3	0.5	28.2	35		
											-	-	-	-	-	31.0	35		
											-	-	-	4.3	-	35.3	40		
											-	-	-	-	0.5	31.5	35		
											-	-	-	4.3	0.5	35.8	40		
											-	-	-	-	-	38.5	40		
											-	-	-	4.3	-	42.8	45		
											-	-	-	-	0.5	39.0	40		
											-	-	-	4.3	0.5	43.3	45		
											-	-	-	-	-	46.0	50		
											-	-	-	4.3	-	50.3	60		
											-	-	-	-	0.5	46.5	50		
											-	-	-	4.3	0.5	50.8	60		
											-	-	-	-	-	61.0	70		
-	-	-	4.3	-	65.3	70													
-	-	-	-	0.5	61.5	70													
-	-	-	4.3	0.5	65.8	70													
DRH0727D	575/3/60	1	6.3	55.3	1	0.33	0.67	1	1.2	2	-	-	-	-	-	10.6	15		
											-	-	-	3.5	-	14.1	20		
											-	-	-	-	1.7	11.2	15		
											-	-	-	3.5	1.7	14.7	20		
											-	-	-	-	-	16.6	20		
											-	-	-	3.5	-	20.1	25		
											-	-	-	-	1.7	17.2	20		
											-	-	-	3.5	1.7	20.7	25		
											-	-	-	-	-	22.6	25		
											-	-	-	3.5	-	26.1	30		
											-	-	-	-	1.7	23.2	25		
											-	-	-	3.5	1.7	26.7	30		
											-	-	-	-	-	28.6	30		
											-	-	-	3.5	-	32.1	35		
											-	-	-	-	1.7	29.2	30		
											-	-	-	3.5	1.7	32.7	35		
											-	-	-	-	-	34.7	35		
											-	-	-	3.5	-	38.2	40		
											-	-	-	-	1.7	35.3	40		
											-	-	-	3.5	1.7	38.8	40		
											-	-	-	-	-	46.7	50		
-	-	-	3.5	-	50.2	60													
-	-	-	-	1.7	47.3	50													
-	-	-	3.5	1.7	50.8	60													
DRH0727W	575/3/60	1	6.3	55.3	1	0.33	0.67	1	2.3	3.8	-	-	-	-	-	12.4	15		
											-	-	-	3.5	-	15.9	20		
											-	-	-	-	1.7	13.0	15		
											-	-	-	3.5	1.7	16.5	20		
											-	-	-	-	-	18.4	20		
											-	-	-	3.5	-	21.9	25		
											-	-	-	-	1.7	19.0	20		
											-	-	-	3.5	1.7	22.5	25		
											-	-	-	-	-	24.4	25		
											-	-	-	3.5	-	27.9	30		
											-	-	-	-	1.7	25.0	30		
											-	-	-	3.5	1.7	28.5	30		
											-	-	-	-	-	30.4	35		
											-	-	-	3.5	-	33.9	35		
											-	-	-	-	1.7	31.0	35		
											-	-	-	3.5	1.7	34.5	35		
											-	-	-	-	-	36.5	40		
											-	-	-	3.5	-	40.0	40		
											-	-	-	-	1.7	37.1	40		
											-	-	-	3.5	1.7	40.6	45		
											-	-	-	-	-	48.5	50		
-	-	-	3.5	-	52.0	60													
-	-	-	-	1.7	49.1	50													
-	-	-	3.5	1.7	52.6	60													


APPENDIX C UNIT DIMENSIONS

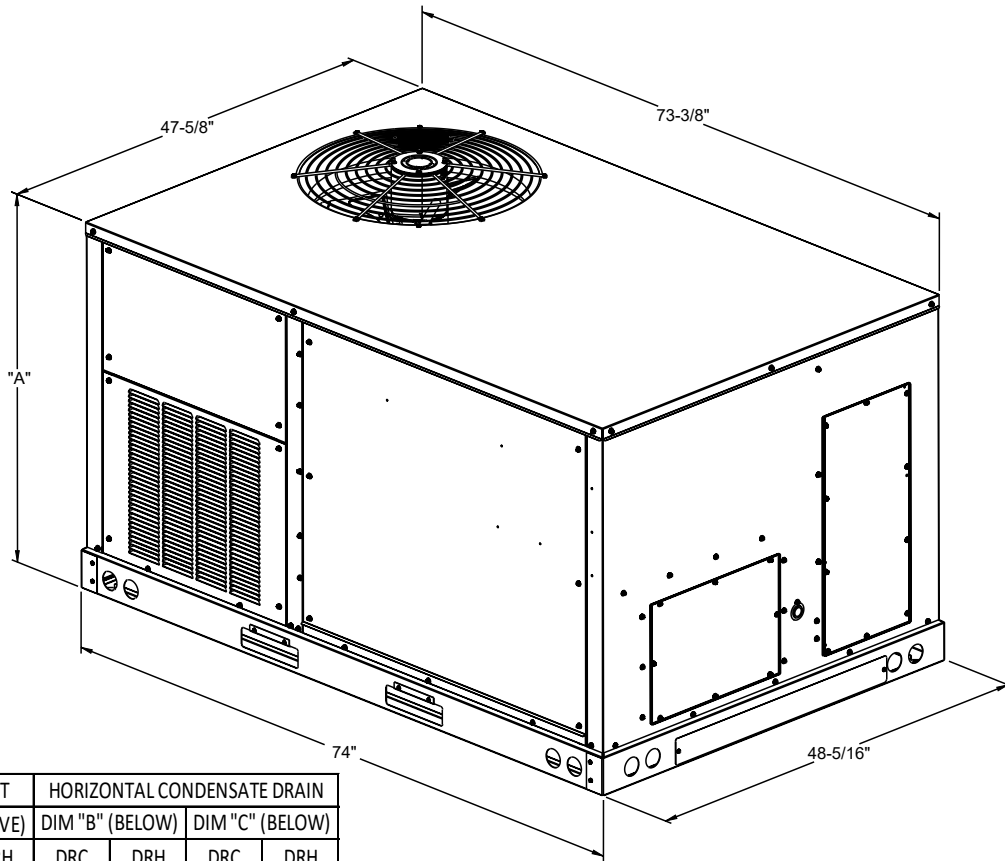

TONNAGE	UNIT HEIGHT		HORIZONTAL CONDENSATE DRAIN			
	DIM "A" (ABOVE)		DIM "B" (BELOW)		DIM "C" (BELOW)	
	DRC	DRH	DRC	DRH	DRC	DRH
3 TON	39-7/8"	43-1/2"	20"		11-1/2"	15"
4 TON	43-1/2"				15"	
5 TON					8-1/8"	
6 TON	53-3/4"				15"	

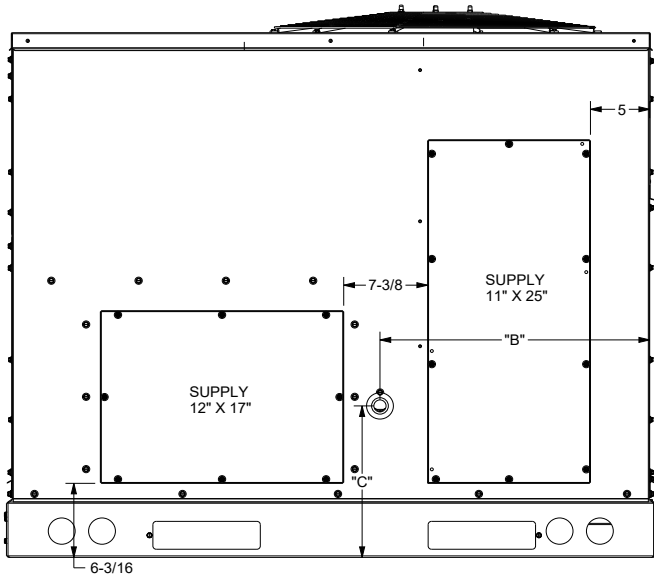

HORIZONTAL DISCHARGE

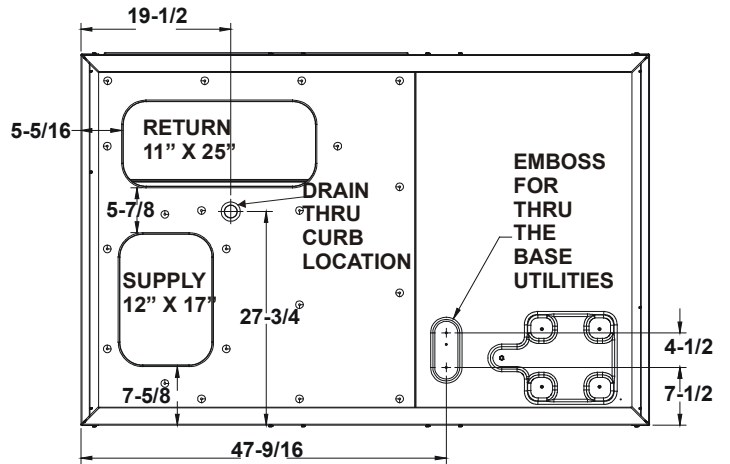

**BOTTOM VIEW OF UNIT
VERTICAL DISCHARGE**

NOTE: REFER TO IOD-7082 INCLUDED IN THE LITERATURE PACK FOR INSTALLING HORIZONTAL DUCT COVERS.

APPENDIX D AIR FLOW FOR ELECTRIC HEAT

AIR FLOW FOR ELECTRIC HEAT

UNIT	HEATER KIT MODEL NUMBER	kW	MINIMUM CFM	MAXIMUM CFM		
3 ton AC STD Static	EH*D-*S05A	5	1325	1500		
	EH*D-*S10A	10				
	EH*D-*S15A	15				
3 ton HP STD Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
3 ton AC HI Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
3 ton HP HI Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
4 ton AC STD Static	EH*D-*S05A	5	1600	2000		
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
4 ton HP STD Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
4 ton AC HI Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
4 ton HP HI Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
5 ton AC STD Static	EH*D-*S05A	5			1900	2500
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
5 ton HP STD Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
5 ton AC HI Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
5 ton HP HI Static	EH*D-*S05A	5				
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
6 ton AC/HP STD Static	EH*D-*S05A	5	2100	3000		
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
	EH*D-*S30A	30				
6 ton AC/HP HI Static	EH*D-*S05A	5	2175			
	EH*D-*S10A	10				
	EH*D-*S15A	15				
	EH*D-*S20A	20				
	EH*D-*S30B	30				


HEATER KIT MODEL NUMBER NOMENCLATURE

	EH	X	D	-	3	S	15	A
	1,2	3	4	-	5	6	7,8	9
Electric Heater								
Heater Type								
X	Staged							
S	SCR (modulating)							
Drive System								
B	Belt Drive							
D	Direct Drive							
Voltage								
1	208-230/1/60		Single Phase 60 Hz					
3	208-230/3/60		Three Phase 60 Hz					
4	460/3/60		Three Phase 60 Hz					
7	575/3/60		Three Phase 60 Hz					
Chassis								
S	Small							
M	Medium							
L	Large							
Kilowatt								
05	5 kW							
10	10 kW							
15	15 kW							
20	20 kW							
30	30 kW							
Limit Configuration								
None	Line Break							
A	Pilot duty Config 1							
B	Pilot duty Config 2							
C	Pilot duty Config 3							
D	Pilot duty Config 4							

WIRING DIAGRAMS

WARNING

HIGH VOLTAGE!
DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT. MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.

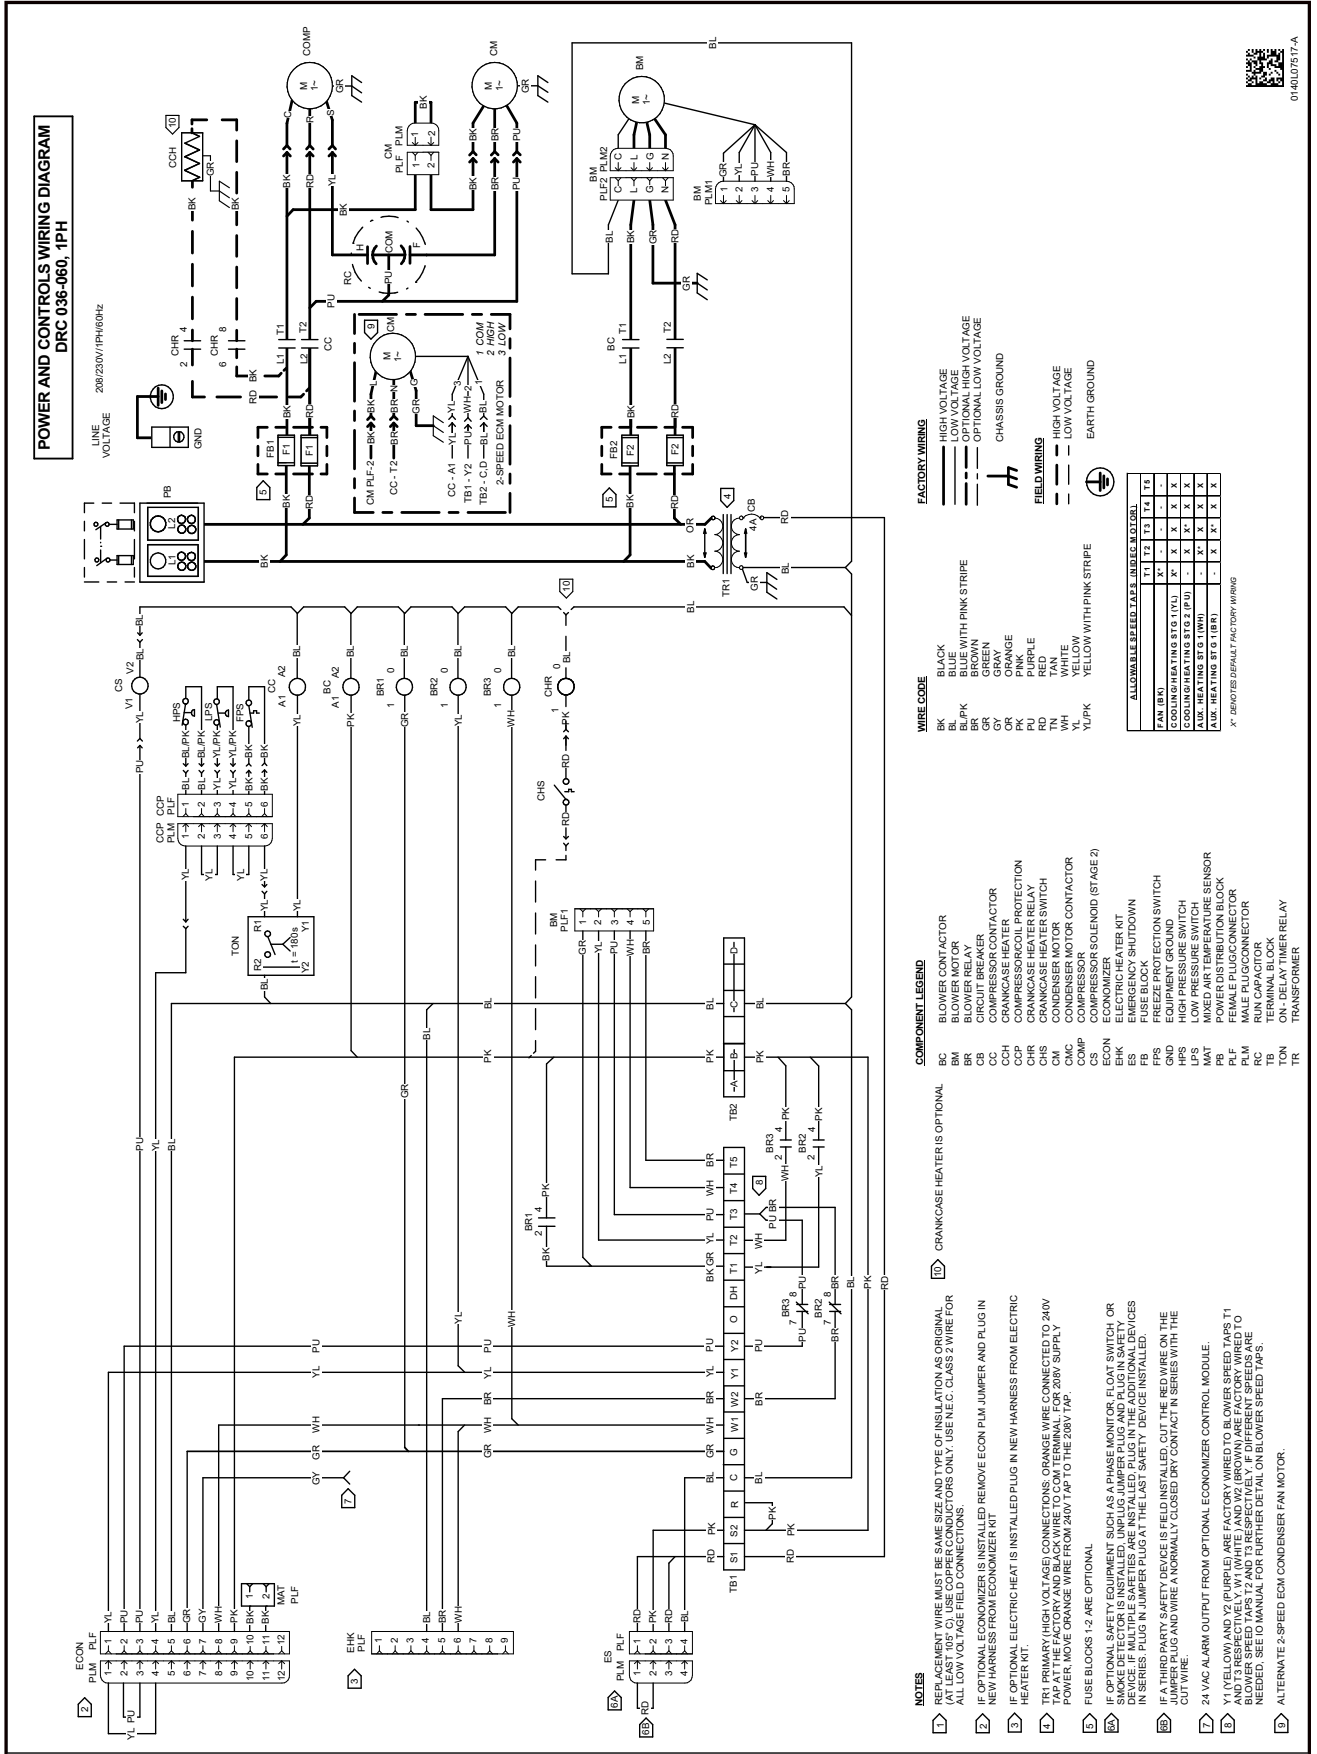


Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WIRING DIAGRAMS



WARNING
 HIGH VOLTAGE!
 DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT. MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.

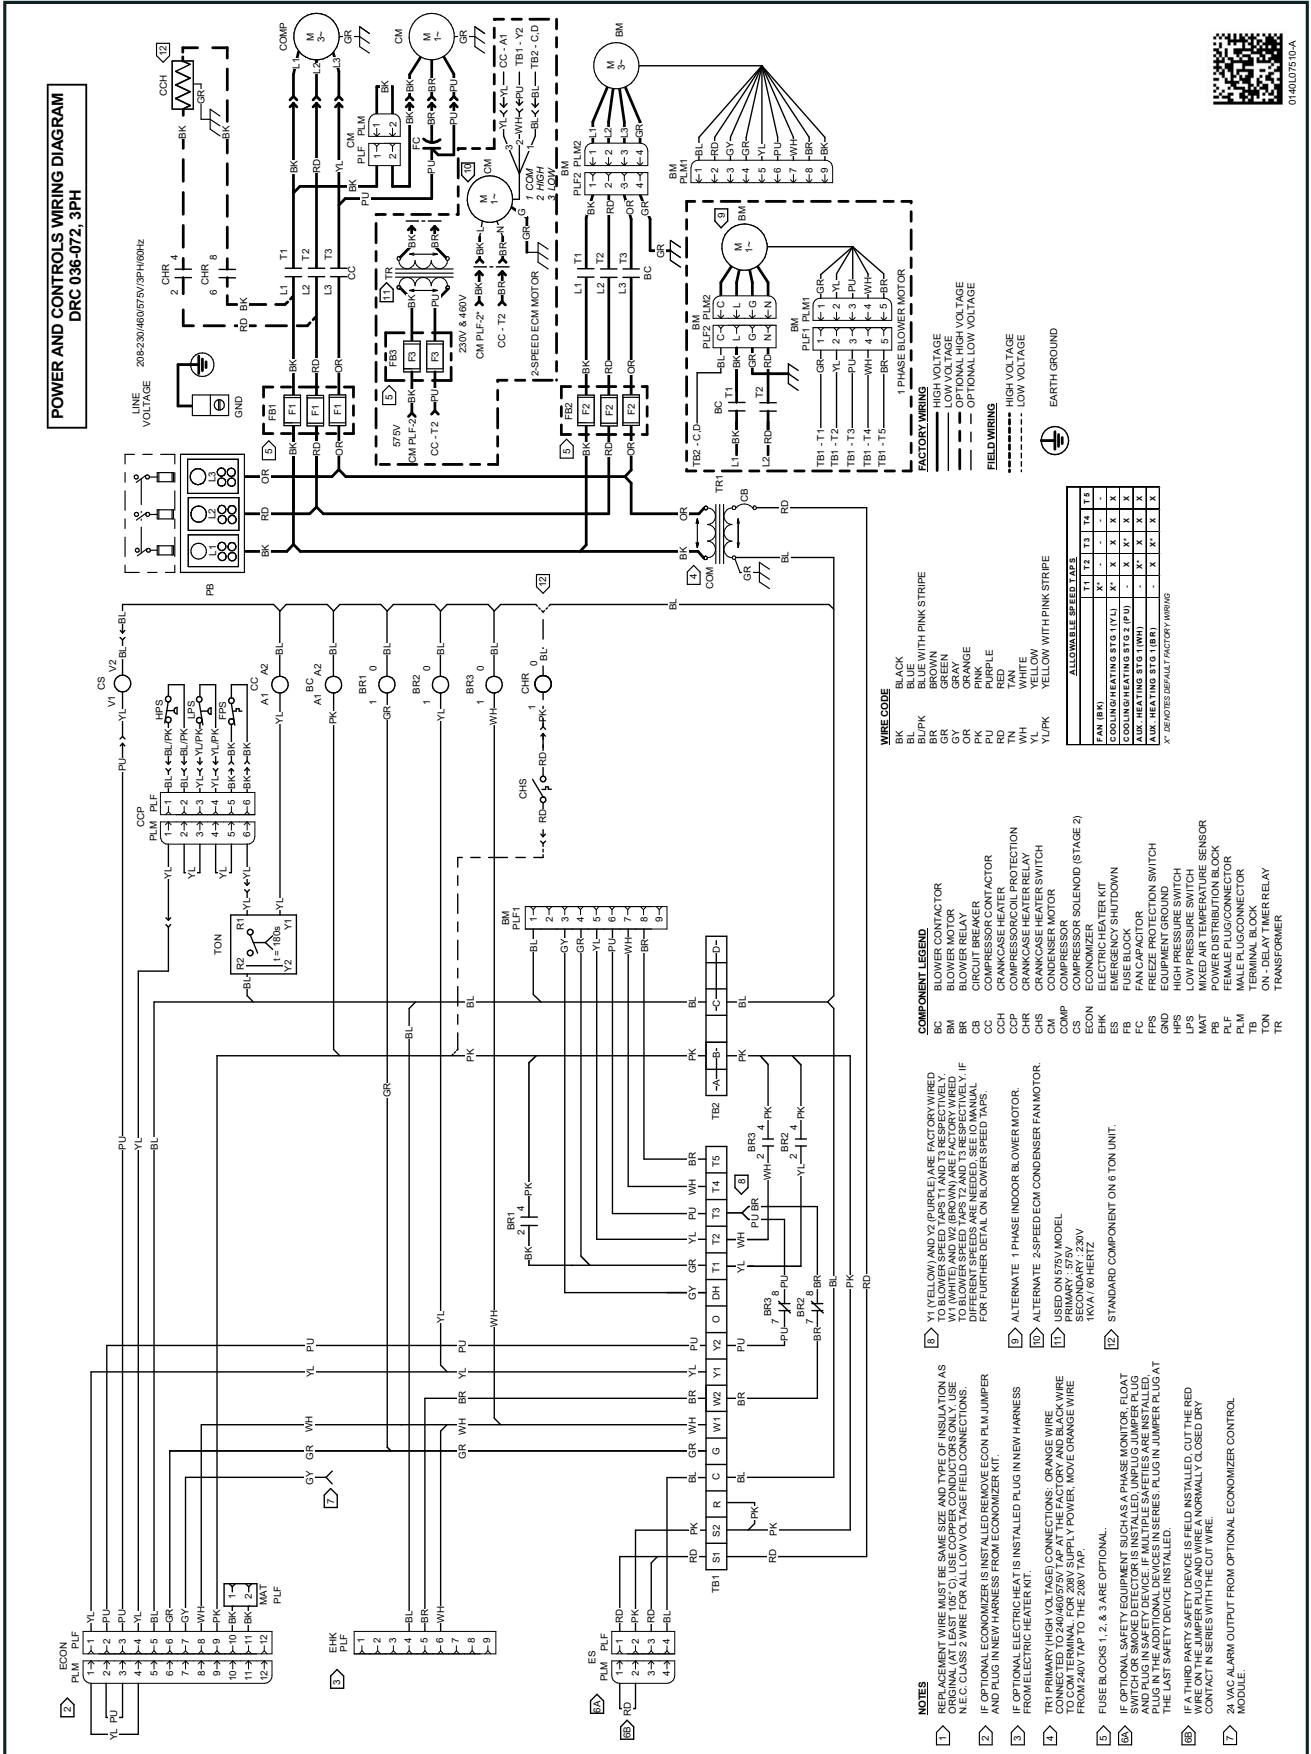


0146107510-A

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WARNING
 HIGH VOLTAGE!
 DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT. MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.

POWER AND CONTROLS WIRING DIAGRAM
 DRC 0356-072, 3PH (H/STATIC)

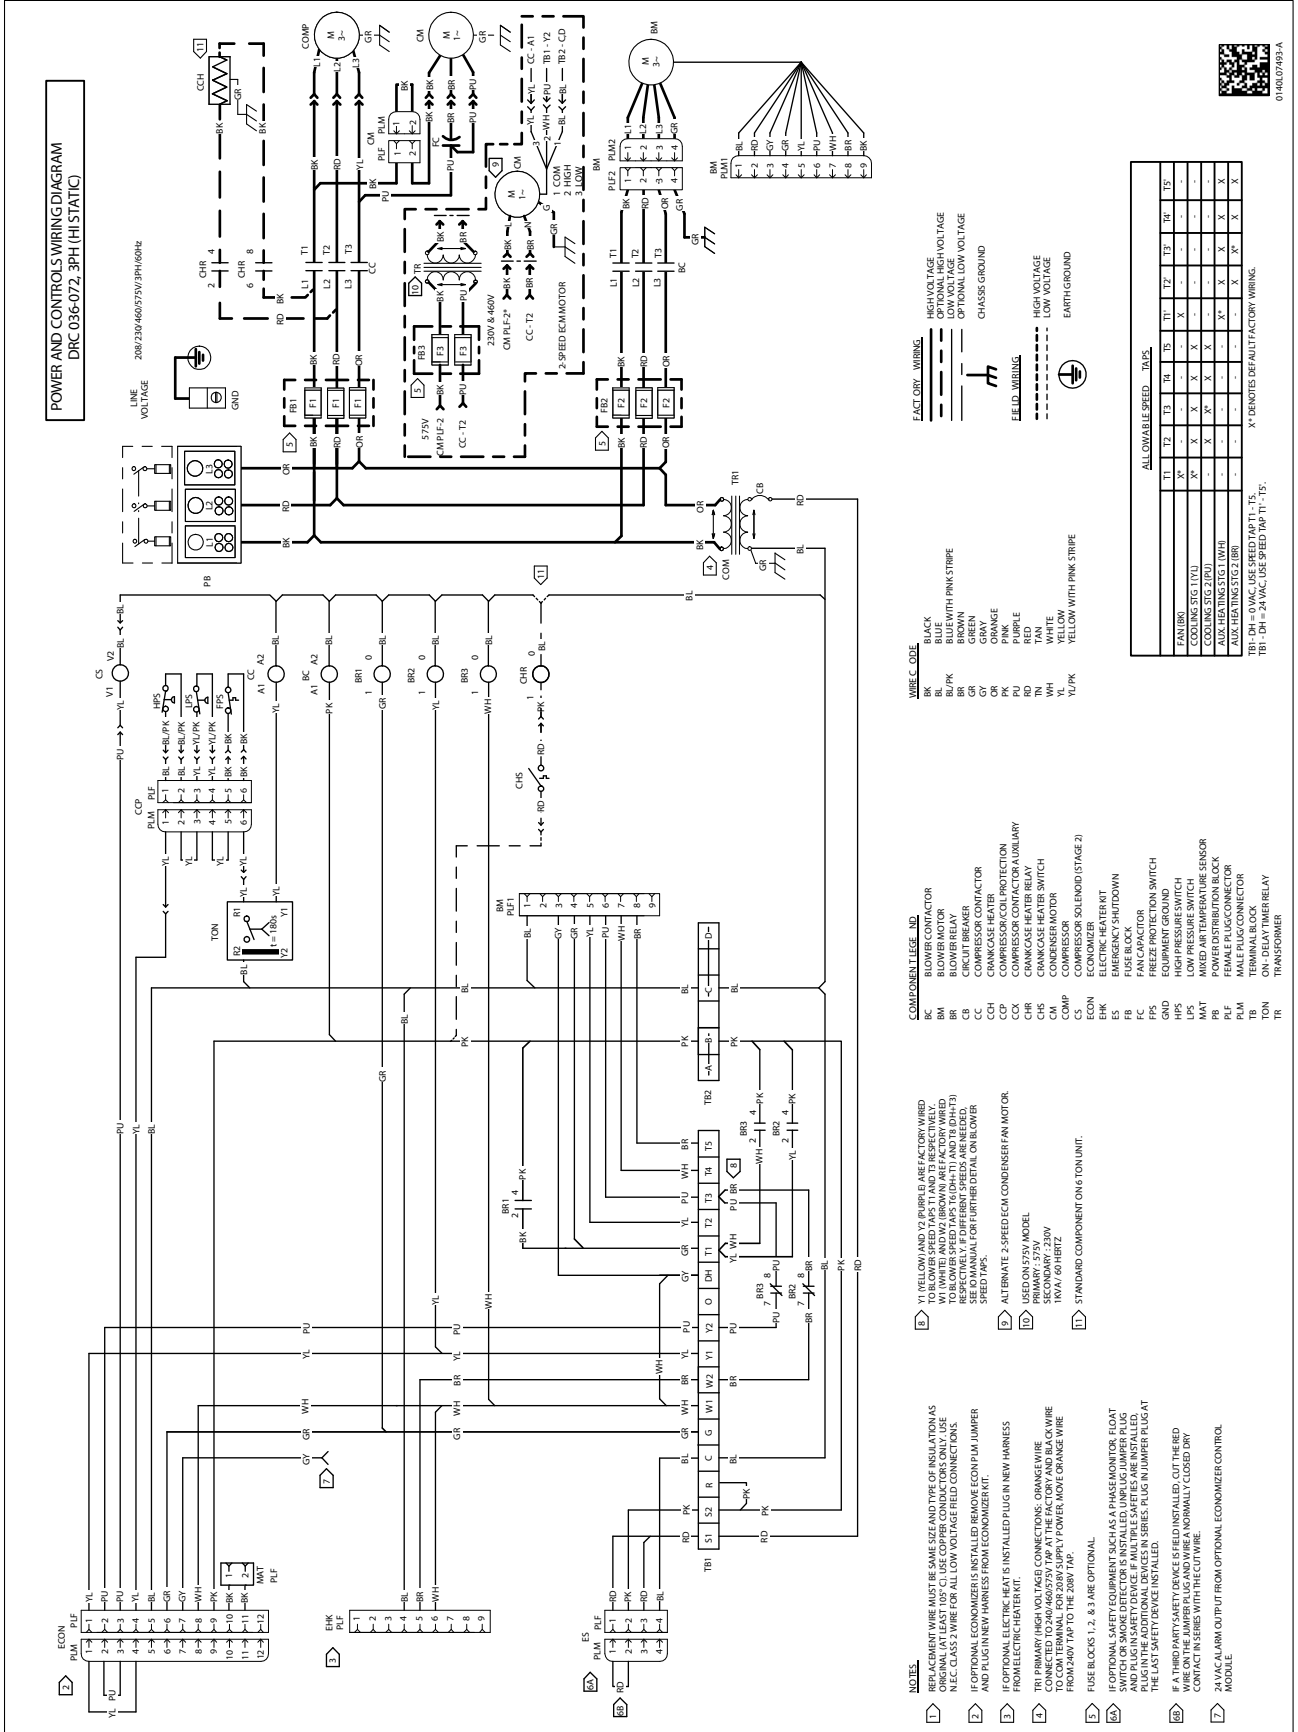

- WIRE COLOR**
- BLACK
 - BLUE
 - BLUE WITH PINK STRIPE
 - BROWN
 - BROWN WITH PINK STRIPE
 - GRAY
 - ORANGE
 - PURPLE
 - RED
 - RED WITH PINK STRIPE
 - WHITE
 - YELLOW
 - YELLOW WITH PINK STRIPE
- FACTORY WIRING**
- HIGH VOLTAGE
 - LOW VOLTAGE
 - OPTIONAL LOW VOLTAGE
 - CHASSIS GROUND
- FIELD WIRING**
- HIGH VOLTAGE
 - LOW VOLTAGE
 - EARTH GROUND

COMPONENT LEGEND

BC	BLOWER CONTACTOR
BM	BLOWER MOTOR
BR	BLOWER RELAY
CB	CIRCUIT BREAKER
CC	COMPRESSOR CONTACTOR
CCH	CRANKCASE HEATER
CCO	CRANKCASE HEATER PROTECTION
CCR	CRANKCASE HEATER RELAY
CHS	CRANKCASE HEATER SWITCH
CH	CRANKCASE HEATER
COMP	COMPRESSOR
CS	COMPRESSOR SOLENOID (STAGE 2)
ECOM	ECONOMIZER
EHR	ELECTRIC HEATER/PTC
EMK	ELECTRIC MOTOR
FB	FUSE BLOCK
FC	FAN CAPACITOR
FPS	FREZE PROTECTION SWITCH
HPS	HIGH PRESSURE SWITCH
LPS	LOW PRESSURE SWITCH
MAT	MIXED AIR TEMPERATURE SENSOR
PIB	POWER DISTRIBUTION BLOCK
PLM	PLUG IN LUMPER
PLM1	PLUG IN LUMPER
PLM2	PLUG IN LUMPER
TR	TERMINAL BLOCK
TB	TERMINAL BLOCK
ON	ON-DELAY TIMER RELAY
TR	TRANSFORMER

- NOTES**
- REPLACEMENT WIRE MUST BE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL WIRE. USE THE SAME TYPE OF WIRE FOR ALL WIRING CONNECTIONS. USE CLASS 3 WIRE FOR ALL LOW VOLTAGE FIELD CONNECTIONS.
 - IF OPTIONAL 3-Phase Power is used, the 3-Phase Power must be connected to the 3-Phase Power terminals on the control board. The 3-Phase Power must be connected to the 3-Phase Power terminals on the control board. The 3-Phase Power must be connected to the 3-Phase Power terminals on the control board.
 - IF OPTIONAL ELECTRIC HEAT IS INSTALLED, PLUG IN NEW HEATERS FROM ELECTRIC HEATER KIT.
 - IF OPTIONAL 2-SPEED CON. CONDENSER FAN MOTOR IS USED ON 575V MODEL, SECONDARY 230V 1N/1-60 HERTZ.
 - FUSE BLOCKS 1, 2, & 3 ARE OPTIONAL.
 - IF OPTIONAL SAFETY EQUIPMENT SUCH AS A PHASE MONITOR, FLOAT SWITCH OR SMOKE DETECTOR IS INSTALLED, UNPLUG LUMPER PLUG FROM THE SAFETY DEVICES IN SERIES WITH THE SAFETY DEVICES. THE LAST SAFETY DEVICE INSTALLED.
 - IF A THIRD PARTY SAFETY DEVICE IS FIELD INSTALLED, CUT THE RED WIRE ON THE JUMPER PLUG AND WIRE A NORMALLY CLOSED DRY CONTACT IN SERIES WITH THE CUT WIRE.
 - 24 VAC ALARM OUTPUT FROM OPTIONAL ECONOMIZER CONTROL MODULE.

ALLOWABLE SPEED TAPS

	T1	T2	T3	T4	T5	T1'	T2'	T3'	T4'	T5'
FAN MOTOR	X	X	X	X	X	X	X	X	X	X
COOLING STG 1 (PU)	X	X	X	X	X	X	X	X	X	X
COOLING STG 2 (PU)	X	X	X	X	X	X	X	X	X	X
MIXED AIR TEMPERATURE SENSOR	X	X	X	X	X	X	X	X	X	X
POWER DISTRIBUTION BLOCK	X	X	X	X	X	X	X	X	X	X
PLUG IN LUMPER	X	X	X	X	X	X	X	X	X	X
MALE PLUG CONNECTOR	X	X	X	X	X	X	X	X	X	X
TERMINAL BLOCK	X	X	X	X	X	X	X	X	X	X
ON-DELAY TIMER RELAY	X	X	X	X	X	X	X	X	X	X
TRANSFORMER	X	X	X	X	X	X	X	X	X	X

T1 - DH = 0 VAC, USE SPEED TAP T1 - T5.
 T1' - DH = 24 VAC, USE SPEED TAP T1' - T5'.
 * DENOTES DEFAULT FACTORY WIRING.


0140,07493.A

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WIRING DIAGRAMS



WARNING
 HIGH VOLTAGE!
 DISCONNECT ALL POWER BEFORE SERVICING OR INSTALLING THIS UNIT. MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.

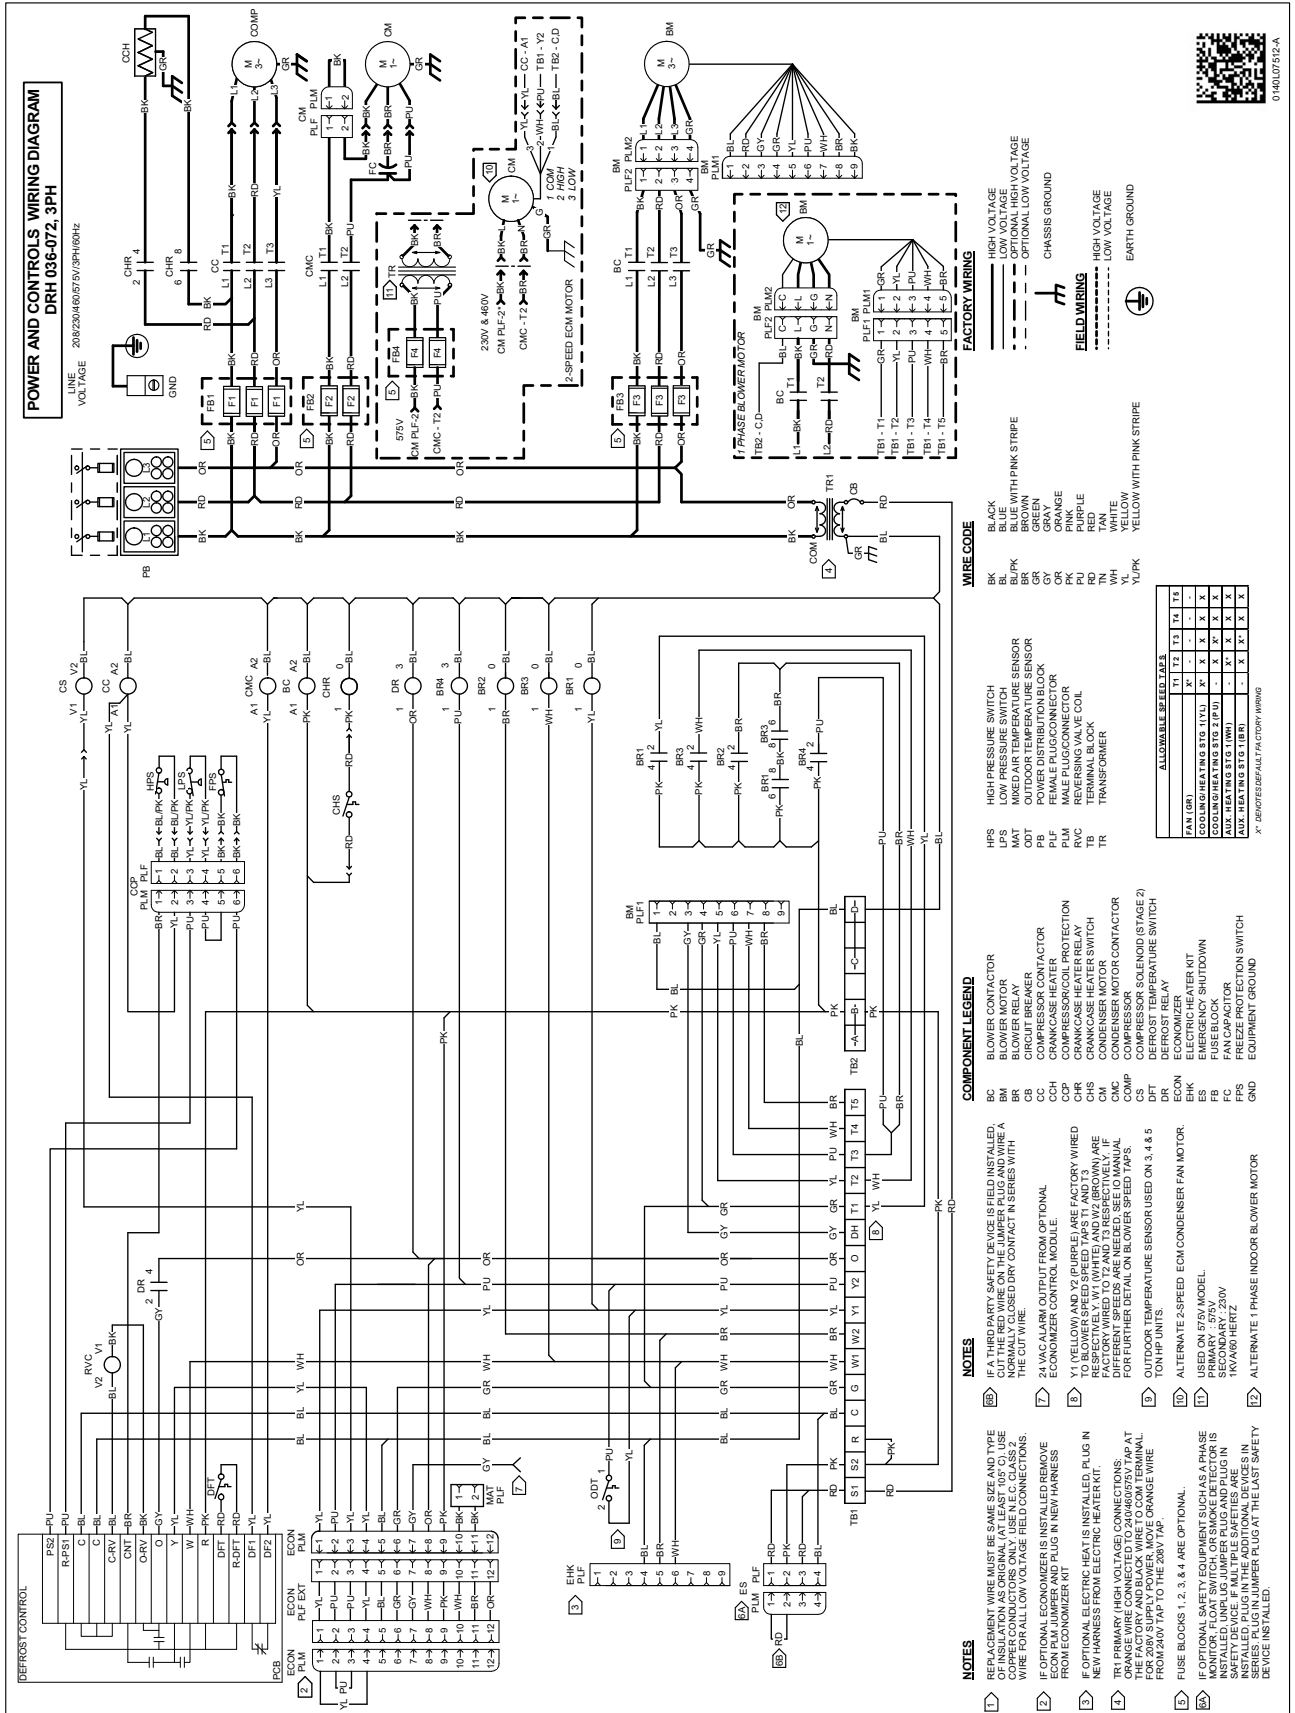

01461031925A

Wiring is subject to change. Always refer to the wiring diagram for the unit for the most up-to-date wiring.



Start-up Checklist

**Store in job file*

Date: _____ Location: _____
Model Number: _____
Serial Number: _____
Technician: _____ Unit #: _____

Pre Start-Up

(Check each item as completed)

- Verify all packaging material has been removed.
- Remove all shipping brackets per installation instructions.
- Verify the job site voltage agrees with the unit serial plate.
- Verify condensate connection is installed per installation instructions.
- Verify proper clearance around the unit for safety, service, maintenance and proper unit operation.
- Verify proper weatherproofing of all ductwork, roof curbs and electrical connections.
- Check that the flue screen is in place.
- Check gas piping for leaks.
- Verify gas pressure to the unit is within the range specified on the serial plate.
- Check to ensure that all fans, pulleys and wheels are secure.
- Check for proper belt tension and alignment per installation instructions.
- Check refrigerant piping for rubbing and leaks. *Repair if necessary.*
- Check unit wiring to ensure it is not in contact with refrigerant piping or sharp metal edges.
- Check all electrical connections and terminals. *Tighten as needed.*
- Verify that the crankcase heaters have been energized for 24 hours.
- Verify the scroll compressor(s) are rotating in the right direction.
- Verify all accessories are installed and operating correctly.
- Check filters and replace if necessary.
- Verify the installation of the thermostat.



Start-up Checklist

Start-Up
(Insert the values as each item is completed.)

ELECTRICAL

Supply Voltage	L1 - L2	_____	L2 - L3	_____	L3 - L1	_____
Circuit 1 Compressor Amps	L1	_____	L2	_____	L3	_____
Circuit 2 Compressor Amps	L1	_____	L2	_____	L3	_____
Blower Amps	L1	_____	L2	_____	L3	_____
Condenser Fan Amps	Fan 1	_____	Fan 2	_____	Fan 3	_____

BLOWER EXTERNAL STATIC PRESSURE

Return Air Static Pressure	_____	IN. W.C.
Supply Air Static Pressure	_____	IN. W.C.
Total External Static Pressure	_____	IN. W.C.
Blower Wheel RPM	_____	RPM

TEMPERATURES

Outdoor Air Temperature	_____	DB	_____	WB
Return Air Temperature	_____	DB	_____	WB
Cooling Supply Air Temperature	_____	DB	_____	WB
Heating Supply Air Temperature	_____	DB	_____	

PRESSURES

Gas Inlet Pressure	_____	IN. W.C.		
Gas Manifold Pressure	_____	IN. W.C. (Low Fire)	_____	IN. W.C. (High Fire)
Suction Circuit 1	_____	PSIG	_____	°F
Superheat (Orifice System)			_____	°F
Suction Circuit 2	_____	PSIG	_____	°F
Superheat (Orifice System)			_____	°F
Discharge Circuit 1	_____	PSIG	_____	°F
Subcooling (TXV System)			_____	°F
Discharge Circuit 2	_____	PSIG	_____	°F
Subcooling (TXV System)			_____	°F

(HEAT PUMP ONLY)

Suction Circuit 1	_____	PSIG	_____	°F
Suction Circuit 2	_____	PSIG	_____	°F
Discharge Circuit 1	_____	PSIG	_____	°F
Discharge Circuit 2	_____	PSIG	_____	°F

CUSTOMER FEEDBACK

Daikin Comfort Technologies is very interested in all product comments.

Please fill out the feedback form on the following link:

<https://daikincomfort.com/contact-us>

You can also scan the QR code on the right to be directed to the feedback page.



PRODUCT REGISTRATION

Thank you for your recent purchase. Though not required to get the protection of the standard warranty, registering your product is a relatively short process, and entitles you to additional warranty protection, except that failure by California and Quebec residents to register their product does not diminish their warranty rights. The duration of warranty coverages in Texas and Florida differs in some cases.

For Product Registration, please register by following this link:

<https://daikincomfort.com/owner-support/product-registration>

You can also scan the QR code on the right to be directed to the Product Registration page.



Our continuing commitment to quality products may mean a change in specifications without notice.

©2019-2020, 2022-2023 **DAIKIN COMFORT TECHNOLOGIES MANUFACTURING, L.P.**

19001 Kermier Rd., Waller, TX 77484

www.daikincomfort.com