

RELAY HARNESS ADAPTOR KIT FOR REMOTE SENSOR (KRCS01-4B)
TO CONNECT VRV-INDOOR (FXZQ*TBVJU, FXSQ*TBVJU, FXMQ*TBVJU,
FBQ*TBVJU).

WHRSZQ-4B-TBV

3P707625-1




The two-dimensional bar
codes a manufacturing code.


INSTALLATION MANUAL

READ THE INSTRUCTIONS PROVIDED HEREIN CAREFULLY IN ADVANCE AND INSTALL THIS KIT CORRECTLY.

PLEASE READ THESE "SAFETY PRECAUTIONS" CAREFULLY BEFORE INSTALLING

- The following two conventions are used to indicate and classify precautions in this manual.
Always heed the important safety information provided with them.

 **WARNING** Failure to follow these instructions properly may result in personal injury or loss of life.

 **CAUTION** Failure to observe these instructions properly may result in property damage or personal injury, which may be serious depending on the circumstances.

- Make sure that the unit operates properly after completing the installation, and explain to the customer how to operate the unit and keep it maintained.
Also, advise the customer that they should keep this installation manual along with other manual for future reference.
- At the time of the installation, read the installation manual of the unit along with the electric diagram.

WARNING

Ask your dealer or qualified personnel to carry out installation work.

Do not attempt to install the air conditioner yourself. Improper installation may result in water leakage, electric shocks or fire.

Install the kit in accordance with the instructions in this installation manual.
Improper installation may result in electric shocks or fire.

Be sure to use only the specified accessories and parts for the installation work.
Failure to use the specified parts may cause the kit to fail or result in electric shocks or fire.

Make certain that all electrical work is carried out by qualified personnel according to the local laws and regulations and this installation manual, using a separate circuit.
Insufficient capacity of the power supply circuit or improper electrical construction may lead to electric shocks or fire.

Turn off the unit before touching electrical parts.
An electric shock may be received if charged parts come in contact with humans.

Be sure to use the specified wires and fix them securely so that no external force resulting from the wires will be imposed on any terminal connections.
Improper connections or securing of wires may result in abnormal heat build-up or fire.

Position the wires so that the cover will not rise when wiring the power supply.
Make sure that the cover is attached securely. If the cover is attached improperly, electric shocks or fire may result.

CAUTION



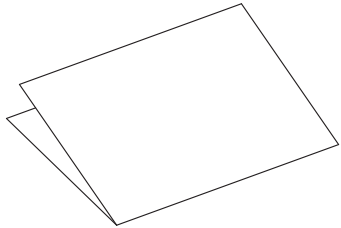
- This product is usable with Remote Sensor for connecting to Indoor unit in the table on the right (List of combination).
- In addition to the instruction below, follow the directions outline in the installation manuals for the Indoor unit and the Remote Sensor.

KIT NAME	REMOTE SENSOR	MODEL NAME OF THE INDOOR
WHRSZQ-4B-TBV	KRCS01-4B	FXZQ ~ TBVJU
		FXSQ ~ TBVJU
		FXMQ ~ TBVJU
		FBQ ~ TBVJU

ACCESSORIES

- Check if the following accessories are included in this Kit. (Following table)

NOTE : Do not throw away the accessories until the installation work is completed.

NAME	RELAY HARNESS (L=2inches)	WIRE TIE	INSTALLATION MANUAL
NO. OF PCS.	1	1	1
SHAPE			

INSTALLATION

- Connect Relay Harness to the lead Wire of Remote Sensor and X16A connector on Indoor units as shown in Figures below.
- Fix Relay Harness to other low voltage Harness with Wire Tie in the Control Box.

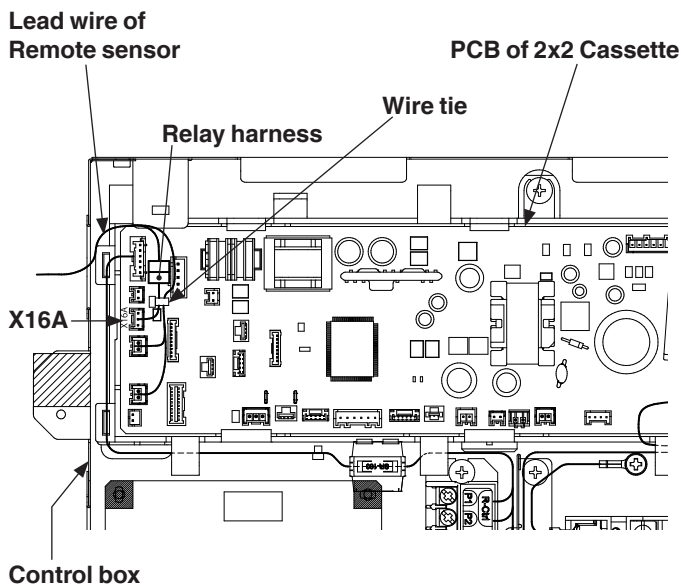


Figure for FXZQ~TB*

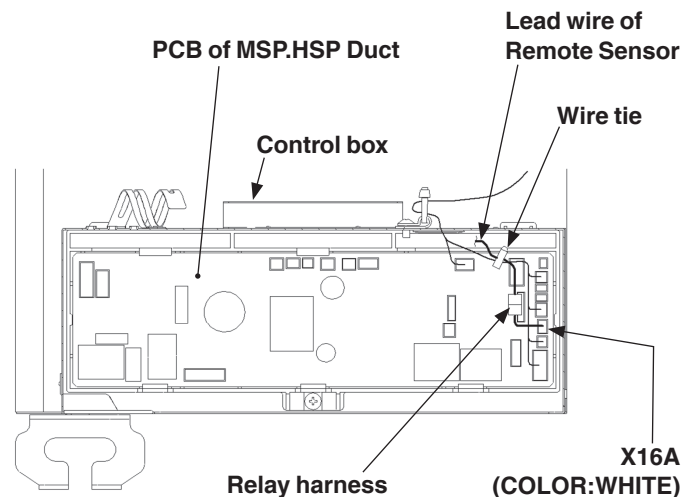


Figure for FXSQ~TB*, FXMQ~TB*, FBQ~TB*