



Base Efficiency Air Conditioner
Belt-Drive Packaged Rooftop Unit
DBC Commercial
6 Nominal Tons
15 IEER / 11.2 EER



*Complete warranty details available from your local distributor or manufacturer's representative
or at www.daikincomfort.com or www.daikinac.com

A woman with blonde hair tied in a bun, wearing a light-colored business suit, is looking down at a clipboard she is holding. She is standing on a staircase with a metal railing. The background is slightly blurred, showing the steps of the staircase.

Our Perfect Package:

Harnessing energy-efficient performance, proven technology, and enhanced comfort for life.

Since becoming the first company in Japan to manufacture packaged air conditioning systems, in 1951, Daikin has supported comfortable indoor living based on the strengths and technologies that have led to the growth of the company becoming one of the world's largest manufacturers of HVAC products, systems and refrigerants.

Today, as a comprehensive global manufacturer of HVAC products and systems, the Daikin brand is committed to being recognized as a truly global and excellent company capable of continually creating new value for its customers. The company plans to pursue sustainable growth and foster business operations that consistently harmonize with the goals of improving indoor comfort.


The group philosophy of the company includes:

- » Creating new value continuously for customers
- » Developing world leading energy-saving technology
- » Being a flexible and dynamic organization
- » Allowing employees to be the driving force for the success of the company
- » Fostering an atmosphere of best practices, boldness, and innovation
- » Thinking and acting globally



Contents

2	Introduction	2
4	Nomenclature	4
5	Features and Benefits	5
	Applications	8
	Serviceability	8
9	Product Specifications	9
	Coil Dimensions	9
	AHRI Ratings	9
	Sound Data	9
10	Expanding Cooling Data	10
12	Electric Heater Data	12
13	Air Flow	13
14	Static Pressure	14
15	Electrical Data	15
18	Wiring Diagrams	18
19	Dimensional Data	19
20	Electrical Connections	20
	Unit Clearances	20
21	Installation	21
	Weights	21

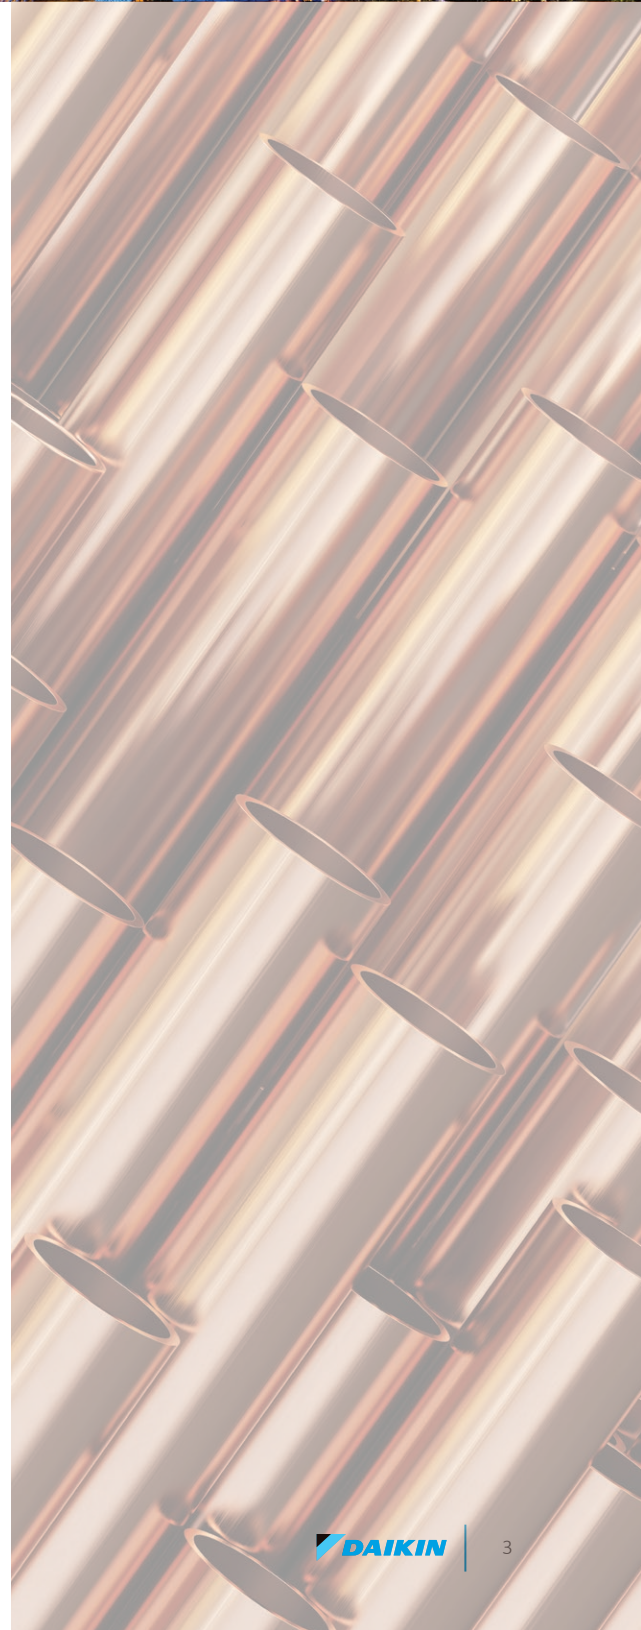

Nomenclature

	D	B	C	072	3	V	XXX	A	X	A	X	X	X	X	X	X	X	X	A	*	
	1	2	3	4,5,6	7	8	9,10,11	12	13	14	15	16	17	18	19	20	21	22	23	24	
																				Revision Levels	
																				Major & Minor	

Daikin Packaged Rooftop Units (RTUs) are built to perform, with features and options that help provide low installation and operation costs, superior indoor air quality, efficient operation, and longevity.

Installation

Daikin Packaged units are designed with fast and easy installation in mind and are ideal for both new construction and retrofit projects. Our packaged rooftop units are built to be a direct replacement for most rooftop units on the field without the need of a curb adapter, to be able to replace the unit in a shorter time and at a lower cost (compared to the previous design).

Cabinet Construction

Daikin packaged rooftop units are made with high quality galvanized steel with a powder-paint finish to provide higher corrosion resistance.

- » Easy accessibility using our tool-less filter access.
- » The interior surface in the indoor air section is fully insulated to prevent sweating and thermal losses, using our foil face fiberglass insulation which also omits exposed filter fibers into the airstream.
- » 1" Raised flanged edges around the supply and return offer easy installation for the duct connections.

- » The full perimeter base rail is built using heavy gauge galvanized steel for a stronger structural installation, the base rails are a minimum of 3 ½" tall and include holes to allow for overhead rigging and lifting with forklifts.
- » Electrical lines can be brought through the base of the unit or through the horizontal knockout for easy installation and accessibility on the field.

Compressor

High performance, low noise scroll compressors with stage control to match the required total load for efficient part load control.

- » Resiliently factory-mounted on rubber grommets for vibration isolation
- » Refrigeration circuit includes both low- and high-pressure transducer, high pressure safety switch and temperature sensors for the suction and discharge.
- » Unit is factory charged with environmentally friendly R-410A refrigerant.
- » Two-stage scroll compressor for partial load applications.
- » Compressor location outside the condenser section to avoid air bypass.
- » Internal overload protection included with compressor.

Supply Fan

Indoor forward curb fans paired with belt-drive motors provide an easy in the field belt and pulley adjustment for airflow control.

- » Slide out forward curb fan for easy maintenance and replacement.
- » High-static drive options for application with high airflow/static requirements.
- » Each fan assembly is dynamically trim balanced at the factory before shipment for quick start-up and efficient operation.
- » Motor with thermal overload and phase failure protection is provided for motor long lasting operation.



Coils

All units use large face area outdoor coils. These coils are constructed with seamless copper tubes, mechanically bonded into aluminum plate-type fins with full drawn collars to completely cover the tubes for high operating efficiencies.

The indoor coil section is installed in a draw through configuration to provide better dehumidification.

- » Coils are factory pressure tested to ensure pressure and leak integrity.
- » Copper tube / aluminum fin coils on condenser and evaporator
- » 5mm Smart Coil Technology on all condenser coils for improved performance and reduced refrigerant load.

Controls and Wiring

Packaged rooftop units come equipped with a well-organized, large, easy to use weatherproof internal control box with easy access, for a better user experience.

- » Units are factory-wired with labeled color-coded wires and complete 24-volt Electromechanical controls package.
- » Units include single-point power entry as standard and also available with electric heat kits if selected.
- » Terminal blocks are provided as standard for easy installation and field power wiring.

Filtration

Unit provides a draw-through filter section as standard for better air quality and long lasting component maintenance.

- » Filters installed on the units are standard off the shelf sizes for easy replacement.
- » One or two size filter per unit for low maintenance cost and easy replacement.
- » Easy and fast filter service access.

Heating Section

Wide ranging of electric heat selections effectively handle most comfort heating demand from morning warm-up control to full heat.

Electric Heat

ETL approved electric heat is factory assembled, installed and tested.

- » Heating control is fully integrated into the unit's control system for quick start-up and reliable control.
- » Durable low watt density, nickel chromium elements provide longer life (compared to units without)..
- » Fuses are provided in each branch circuit to a maximum of 48 Amps per NEC requirements.
- » Single-point power connection reduces installation cost.
- » For operational safeties electric heat includes automatic reset, and high temperature limit safety protection and an airflow safety switch to prevent electric heat operation in the event of no airflow.

Electrical

Units are completely wired and tested at the factory to provide faster commissioning and start-up.

- » Wiring complies with NEC requirements and all applicable UL standards.
- » For ease of use, wiring and electrical components are number coded and labeled according to the electrical diagram.
- » A 120 V GFI convenience receptacle requiring independent power supply for the receptacle is optional.
- » An optional unit powered 20 amp 115 V convenience receptacle, complete with factory mounted transformer, disconnect switch, and primary and secondary overload protection, eliminates the need to pull a separate 115 V power source.
- » Supply air fan, compressor, and condenser fan motor branch circuits have individual short circuit protection. Unit includes knockouts in the bottom of the main control panels for field wiring entrance.
- » A single-point power connection with power block is standard and a terminal board is provided for connecting low voltage control wiring.
- » For better serviceability an optional non-fused disconnect switch can be installed inside the control panel and operated by an externally mounted handle to disconnect the electrical power at the unit



Applications

Daikin Rooftop units are intended for comfort cooling applications in normal heating, ventilating, and air conditioning. Consult your local Daikin sales representative for applications involving operations at high ambient temperatures, high altitudes, non-cataloged voltages, or for job-specific unit selections that fall outside of the range of the catalog tables.

For proper operation, units should be rigged in accordance with instructions stated on the installation manual. Fire dampers, if required, must be installed in the ductwork according to local and/or state codes. No space is allowed for these dampers in the unit.

Follow factory check, test and start procedures explicitly to achieve satisfactory start-up and operation.

Most rooftop applications take advantage of the significant energy savings provided with economizer operation. When an economizer system is used, mechanical refrigeration is typically not required below an ambient temperature of 50°F.

Serviceability

Daikin packaged rooftop units are built with serviceability in mind, designed to make future maintenance and service on the unit easy and accessible.

- » Our packaged rooftop units offer a slide out blower to facilitate the access and removal of the fan.
- » Filter panels on the small chassis line offer tool-less access for easy maintenance.
- » Independent compressor outside of the air bypass to eliminate component blockage and provide easy access.
- » Labeled field connections, color coded and continuously marked wire to identify point-to-point component connections.
- » All 3 - 5 ton units are designed for convertible airflow orientation to serve downflow or horizontal applications. Every unit ships prepared to convert to horizontal orientation in the field if required.
- » Condenser clean out from inside-out.
- » Easy access to gas valves and control panel.



Model	DBC0723V000001S	DBC0724V000001S	DBC0727V000001S
COOLING CAPACITY			
Total BTU/H	69,000	69,000	69,000
IEER / EER	15.0 / 11.2	15.0 / 11.2	15.0 / 11.2
AHRI Reference #	205301569	205301569	205301569
EVAPORATOR MOTOR COIL			
Motor Type	2-Speed Belt-Drive	2-Speed Belt-Drive	2-Speed Belt-Drive
External Static Pressure (ESP)	Standard	Standard	Standard
Wheel Dia. X Width	12x10	12x10	12x10
Indoor Nominal CFM	2130	2130	2130
RPM	1740	1740	1745
Indoor Horsepower	2.00	2.00	2.00
Filter Size (in)	14 X 20 X 2 (2) 20 X 20 X 2 (2)	14 X 20 X 2 (2) 20 X 20 X 2 (2)	14 X 20 X 2 (2) 20 X 20 X 2 (2)
Drain Size (NPT)	¾	¾	¾
R-410A Refrigerant Charge (oz.)	154	154	154
Evaporator Coil Face Area (ft²)	9.2	9.2	9.2
Rows Deep/ Fins per Inch	4/16	4/16	4/16
CONDENSER FAN/COIL			
Quantity of Condenser Fan Motors	1	1	1
RPM (High/Low stage)	1122	1050	1050
Outdoor Horsepower	0.33	0.33	0.33
Fan Diameter/ # Fan Blades	22 / 4	22 / 4	22 / 4
Face Area (ft²)	19.0	19.0	19.0
Rows Deep / Fins per Inch	2 / 28	2 / 28	2 / 28
COMPRESSOR			
Quantity / Type / Stages	1 / Scroll / 2	1 / Scroll / 2	1 / Scroll / 2
Compressor RLA / LRA	17.6 / 136.0	8.5 / 66.1	6.3 / 55.3
ELECTRICAL DATA			
Voltage-Phase-Frequency	208/230-3-60	460-3-60	575-3-60
Indoor Blower FLA	6.0	2.9	2.4
Max External Static (In. W.C.)	1.8	1.8	1.8
Outdoor Fan FLA	2.0	0.85	0.67
Min. Circuit Ampacity¹	30.0 / 30.0	14.3	11.0
Max. Overcurrent Protection (A)²	45 / 45	20	15
Power Supply Conduit Hole Dia. (in)	1.125	1.125	1.125
Low-Voltage Conduit Hole Dia. (in)	0.5	0.5	0.5
OPERATING WEIGHT (LBS.)			
Operating Weight (lbs)	678	678	678
SHIPPING WEIGHT (LBS.)			
Ship Weight (lbs)	724	724	724

¹ Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

² May use fuses or HACR-type circuit breakers of the same size as noted.

Note: Always check the S&R plate for electrical data on the unit being installed.

Coil Dimensions

Model	Tons	Fin height in.	Fin length in.
DBC	6	34.64	38.07

AHRI Ratings

MODEL	CAPACITY	EER	IEER
DBC0723/DBC0724/DBC0727	69000	11.2	15

Sound Data

Model	OUTDOOR SOUND (DB) AT 60 HZ								
	A-Weighted	63	125	250	500	1000	2000	4000	8000
72	81	82.7	80.6	80.5	77.7	75.2	72.1	69.7	67.2

Notes:

¹ Outdoor sound data is measured in accordance with AHRI standard 270.

² Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environment factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.

³ A-weighted sound ratings filter out high and very low frequencies, to better approximate the response of "average" human ear. A-weighted measurements for Daikin units are taken in accordance with AHRI standard 270.

		Outdoor Ambient Temperature																							
		65				75				85				95				105				115			
IDB	Airflow	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
Entering Indoor Wet Bulb Temperature																									
70	Capacity	70,007	70,998	73,095	-	69,378	70,370	72,467	-	67,545	68,537	70,634	-	64,392	65,383	67,480	-	60,537	61,529	63,626	-	57,018	58,010	60,107	-
	S/T	0.63	0.55	0.41	-	0.64	0.56	0.41	-	0.67	0.59	0.44	-	0.69	0.61	0.46	-	1.00	0.63	0.48	-	1.00	0.69	0.54	-
	Evap dT	21.17	19.24	15.64	-	21.11	19.19	15.58	-	21.39	19.46	15.86	-	21.10	19.17	15.56	-	20.84	18.91	15.31	-	22.05	20.12	16.51	-
	Pr Suc	122	123	126	-	129	131	134	-	136	137	140	-	141	143	146	-	147	148	151	-	153	155	158	-
	Pr Dis	255	256	258	-	296	297	299	-	338	339	341	-	384	385	386	-	433	434	436	-	485	486	488	-
	TotalPower	4,434	4,430	4,421	-	4,947	4,943	4,934	-	5,520	5,516	5,507	-	6,140	6,136	6,127	-	6,833	6,829	6,820	-	7,645	7,641	7,633	-
2128	Capacity	71,122	72,113	74,210	-	70,493	71,485	73,582	-	68,660	69,652	71,749	-	65,506	66,498	68,595	-	61,652	62,644	64,741	-	58,133	59,125	61,222	-
	S/T	0.72	0.64	0.49	-	0.73	0.64	0.50	-	0.75	0.67	0.52	-	1.00	0.69	0.55	-	1.00	0.72	0.57	-	1.00	0.77	0.62	-
	Evap dT	19.69	17.76	14.16	-	19.64	17.71	14.11	-	19.91	17.98	14.38	-	19.62	17.69	14.09	-	19.36	17.43	13.83	-	20.57	18.64	15.04	-
	Pr Suc	124	125	129	-	131	133	136	-	138	139	142	-	143	145	148	-	149	150	153	-	155	157	160	-
	Pr Dis	258	259	261	-	298	300	301	-	341	342	344	-	386	387	389	-	435	436	438	-	488	489	491	-
	TotalPower	4,468	4,464	4,455	-	4,981	4,977	4,968	-	5,554	5,550	5,541	-	6,174	6,170	6,161	-	6,866	6,862	6,854	-	7,679	7,675	7,666	-
2700	Capacity	73,781	74,773	76,870	-	73,153	74,144	76,241	-	71,320	72,311	74,408	-	68,166	69,157	71,254	-	64,312	65,303	67,400	-	60,793	61,784	63,881	-
	S/T	0.77	0.69	0.54	-	0.77	0.69	0.55	-	0.80	0.72	0.57	-	1.00	0.74	0.59	-	1.00	0.76	0.62	-	1.00	0.82	0.67	-
	Evap dT	17.72	15.79	12.19	-	17.66	15.74	12.13	-	17.94	16.01	12.41	-	17.64	15.72	12.11	-	17.39	15.46	11.86	-	18.59	16.67	13.06	-
	Pr Suc	129	130	133	-	136	137	141	-	142	144	147	-	148	149	153	-	153	155	158	-	160	162	165	-
	Pr Dis	263	264	266	-	303	304	306	-	345	346	348	-	391	392	394	-	440	441	443	-	492	493	495	-
	TotalPower	4,512	4,508	4,500	-	5,026	5,022	5,013	-	5,599	5,595	5,586	-	6,219	6,215	6,206	-	6,911	6,907	6,898	-	7,724	7,720	7,711	-
1800	Capacity	70,048	71,039	73,136	76,340	69,419	70,411	72,508	75,711	67,586	68,578	70,675	73,878	64,432	65,424	67,521	70,724	60,578	61,570	63,667	66,870	57,059	58,051	60,148	63,351
	S/T	0.77	0.69	0.55	0.39	0.78	0.70	0.55	0.40	1.00	0.73	0.58	0.42	1.00	0.75	0.60	0.45	1.00	0.77	0.62	0.47	1.00	1.00	0.68	0.53
	Evap dT	25.41	23.48	19.88	16.15	25.36	23.43	19.83	16.09	25.63	23.70	20.10	16.37	25.34	23.41	19.81	16.07	25.08	23.15	19.55	15.82	26.29	24.36	20.76	17.02
	Pr Suc	122	123	126	132	129	131	134	139	136	137	140	145	141	143	146	151	147	148	151	156	153	155	158	163
	Pr Dis	256	257	258	263	296	297	299	303	338	339	341	346	384	385	387	391	433	434	436	440	485	486	488	493
	TotalPower	4,431	4,427	4,418	4,457	4,944	4,940	4,931	4,970	5,517	5,513	5,504	5,543	6,137	6,133	6,124	6,163	6,829	6,825	6,817	6,856	7,642	7,638	7,629	7,669
2128	Capacity	71,163	72,154	74,251	77,454	70,534	71,526	73,623	76,826	68,701	69,693	71,790	74,993	65,547	66,539	68,636	71,839	61,693	62,684	64,782	67,985	58,174	59,166	61,263	64,466
	S/T	0.86	0.78	0.63	0.48	0.87	0.78	0.64	0.48	1.00	0.81	0.66	0.51	1.00	0.83	0.68	0.53	1.00	0.86	0.71	0.55	1.00	1.00	0.76	0.61
	Evap dT	23.93	22.01	18.40	14.67	23.88	21.95	18.35	14.62	24.15	22.22	18.62	14.89	23.86	21.93	18.33	14.60	23.60	21.67	18.07	14.34	24.81	22.88	19.28	15.55
	Pr Suc	124	125	129	134	131	133	136	141	138	139	142	148	143	145	148	153	149	150	153	159	156	157	160	165
	Pr Dis	258	259	261	266	299	300	302	306	341	342	344	348	386	388	389	394	436	437	438	443	488	489	491	495
	TotalPower	4,464	4,460	4,452	4,491	4,978	4,974	4,965	5,004	5,550	5,546	5,538	5,577	6,170	6,166	6,158	6,197	6,863	6,859	6,850	6,890	7,676	7,672	7,663	7,702
2700	Capacity	73,822	74,814	76,911	80,114	73,194	74,185	76,282	79,486	71,361	72,352	74,449	77,652	68,207	69,198	71,295	74,499	64,352	65,344	67,441	70,644	60,834	61,825	63,922	67,126
	S/T	0.91	0.83	0.68	0.52	1.00	0.83	0.69	0.53	1.00	0.86	0.71	0.56	1.00	0.88	0.73	0.58	1.00	1.00	0.76	0.60	1.00	1.00	0.81	0.66
	Evap dT	21.96	20.03	16.43	12.70	21.91	19.98	16.38	12.64	22.18	20.25	16.65	12.91	21.89	19.96	16.36	12.62	21.63	19.70	16.10	12.37	22.84	20.91	17.31	13.57
	Pr Suc	129	130	133	138	136	137	141	146	142	144	147	152	148	149	153	158	153	155	158	163	160	162	165	170
	Pr Dis	263	264	266	270	303	304	306	311	346	347	348	353	391	392	394	398	440	441	443	448	493	494	495	500
	TotalPower	4,509	4,505	4,496	4,536	5,022	5,018	5,010	5,049	5,595	5,591	5,582	5,622	6,215	6,211	6,202	6,242	6,908	6,904	6,895	6,934	7,721	7,717	7,708	7,747

		Outdoor Ambient Temperature																							
		65				75				85				95				105				115			
IDB	Airflow	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	Capacity	70,411	71,403	73,500	76,703	69,783	70,775	72,872	76,075	67,950	68,941	71,039	74,242	64,796	65,788	67,885	71,088	60,942	61,933	64,030	67,234	57,423	58,415	60,512	63,715
	S/T	0.91	0.83	0.68	0.53	1.00	0.83	0.69	0.53	1.00	0.86	0.71	0.56	1.00	0.88	0.74	0.58	1.00	1.00	0.76	0.61	1.00	1.00	0.82	0.66
	Evap dT	29.68	27.75	24.15	20.42	29.63	27.70	24.10	20.36	29.90	27.97	24.37	20.64	29.61	27.68	24.08	20.34	29.35	27.42	23.82	20.09	30.56	28.63	25.03	21.29
	Pr Suc	122	124	127	132	130	131	134	140	136	138	141	146	142	143	146	152	147	149	152	157	154	155	158	164
	Pr Dis	256	257	259	263	296	297	299	304	339	340	342	346	384	385	387	392	433	434	436	441	486	487	489	493
	TotalPower	4,433	4,429	4,421	4,460	4,947	4,943	4,934	4,973	5,519	5,515	5,507	5,546	6,139	6,135	6,127	6,166	6,832	6,828	6,819	6,859	7,645	7,641	7,632	7,671
2128	Capacity	71,526	72,518	74,615	77,818	70,898	71,889	73,987	77,190	69,065	70,056	72,153	75,357	65,911	66,903	69,000	72,203	62,057	63,048	65,145	68,348	58,538	59,529	61,626	64,830
	S/T	1.00	0.91	0.77	0.61	1.00	0.92	0.77	0.62	1.00	0.95	0.80	0.64	1.00	1.00	0.82	0.67	1.00	1.00	0.84	0.69	1.00	1.00	0.90	0.75
	Evap dT	28.20	26.28	22.67	18.94	28.15	26.22	22.62	18.89	28.42	26.49	22.89	19.16	28.13	26.20	22.60	18.87	27.87	25.95	22.34	18.61	29.08	27.15	23.55	19.82
	Pr Suc	124	126	129	134	132	133	136	142	138	140	143	148	144	145	149	154	149	151	154	159	156	158	161	166
	Pr Dis	259	260	262	266	299	300	302	306	341	342	344	349	387	388	390	394	436	437	439	443	488	490	491	496
	TotalPower	4,467	4,463	4,454	4,493	4,980	4,976	4,967	5,007	5,553	5,549	5,540	5,580	6,173	6,169	6,160	6,200	6,866	6,862	6,853	6,892	7,678	7,674	7,666	7,705
2700	Capacity	74,186	75,177	77,274	80,478	73,557	74,549	76,646	79,849	71,724	72,716	74,813	78,016	68,570	69,562	71,659	74,862	64,716	65,708	67,805	71,008	61,197	62,189	64,286	67,489
	S/T	1.00	0.96	0.81	0.66	1.00	0.97	0.82	0.67	1.00	0.99	0.85	0.69	1.00	1.00	0.87	0.71	1.00	1.00	0.89	0.74	1.00	1.00	0.95	0.79
	Evap dT	26.23	24.30	20.70	16.97	26.18	24.25	20.65	16.91	26.45	24.52	20.92	17.19	26.16	24.23	20.63	16.89	25.90	23.97	20.37	16.64	27.11	25.18	21.58	17.84
	Pr Suc	129	131	134	139	137	138	141	146	143	145	148	153	149	150	153	158	154	155	159	164	161	162	165	170
	Pr Dis	263	264	266	271	304	305	307	311	346	347	349	353	392	393	394	399	441	442	444	448	493	494	496	500
	TotalPower	4,512	4,508	4,499	4,538	5,025	5,021	5,012	5,052	5,598	5,594	5,585	5,624	6,218	6,214	6,205	6,244	6,911	6,907	6,898	6,937	7,723	7,719	7,711	7,750
85	Capacity	71,594	72,586	74,683	77,886	70,966	71,957	74,054	77,258	69,133	70,124	72,221	75,425	65,979	66,970	69,068	72,271	62,125	63,116	65,213	68,416	58,606	59,597	61,694	64,898
	S/T	1.00	0.94	0.79	0.64	1.00	0.94	0.80	0.64	1.00	1.00	0.82	0.67	1.00	1.00	0.85	0.69	1.00	1.00	0.87	0.71	1.00	1.00	1.00	0.77
	Evap dT	33.47	31.54	27.94	24.20	33.41	31.48	27.88	24.15	33.68	31.76	28.15	24.42	33.39	31.46	27.86	24.13	33.14	31.21	27.61	23.87	34.34	32.41	28.81	25.08
	Pr Suc	124	126	129	134	132	133	136	141	138	140	143	148	144	145	148	153	149	150	154	159	156	157	160	165
	Pr Dis	257	258	260	265	298	299	300	305	340	341	343	347	385	387	388	393	435	436	437	442	487	488	490	494
	TotalPower	4,443	4,439	4,430	4,470	4,956	4,952	4,944	4,983	5,529	5,525	5,516	5,556	6,149	6,145	6,136	6,176	6,842	6,838	6,829	6,868	7,655	7,651	7,642	7,681
2128	Capacity	72,709	73,701	75,798	79,001	72,081	73,072	75,169	78,373	70,248	71,239	73,336	76,539	67,094	68,085	70,182	73,386	63,239	64,231	66,328	69,531	59,721	60,712	62,809	66,013
	S/T	1.00	1.00	0.87	0.72	1.00	1.00	0.88	0.73	1.00	1.00	0.91	0.75	1.00	1.00	0.93	0.78	1.00	1.00	0.95	0.80	1.000	1.000	1.000	0.855
	Evap dT	31.99	30.06	26.46	22.73	31.94	30.01	26.41	22.68	32.21	30.28	26.68	22.95	31.92	29.99	26.39	22.66	31.66	29.73	26.13	22.40	32.87	30.94	27.34	23.61
	Pr Suc	126	128	131	136	134	135	138	144	140	142	145	150	146	147	150	156	151	153	156	161	158	159	162	168
	Pr Dis	260	261	263	267	300	301	303	308	343	344	345	350	388	389	391	396	437	438	440	445	490	491	493	497
	TotalPower	4,477	4,473	4,464	4,503	4,990	4,986	4,977	5,017	5,563	5,559	5,550	5,589	6,183	6,179	6,170	6,209	6,876	6,872	6,863	6,902	7,688	7,684	7,675	7,715
2700	Capacity	75,369	76,360	78,457	81,660	74,740	75,732	77,829	81,032	72,907	73,899	75,996	79,199	69,753	70,745	72,842	76,045	65,899	66,890	68,987	72,191	62,380	63,372	65,469	68,672
	S/T	1.00	1.00	0.92	0.77	1.00	1.00	0.93	0.78	1.00	1.00	0.96	0.80	1.00	1.00	0.98	0.82	1.00	1.00	1.00	0.85	1.00	1.00	1.00	0.90
	Evap dT	30.02	28.09	24.49	20.75	29.96	28.03	24.43	20.70	30.23	28.31	24.70	20.97	29.94	28.01	24.41	20.68	29.69	27.76	24.16	20.42	30.89	28.96	25.36	21.63
	Pr Suc	131	132	136	141	138	140	143	148	145	146	149	155	150	152	155	160	156	157	160	166	162	164	167	172
	Pr Dis	265	266	267	272	305	306	308	312	347	348	350	355	393	394	396	400	442	443	445	449	494	495	497	502
	TotalPower	4,522	4,518	4,509	4,548	5,035	5,031	5,022	5,061	5,608	5,604	5,595	5,634	6,228	6,224	6,215	6,254	6,920	6,916	6,908	6,947	7,733	7,729	7,720	7,760

kW = Total system power

Amps: Unit amps (comp. + evaporator + condenser fan motors)

Shaded area reflects AHRI (TVA) conditions

High and low pressures are measured at the liquid and suction access fittings.

Design Subcooling, 16 - 19 °F @ the liquid access fitting connection ARI 95 test conditions. Design Superheat 8 - 12 °F @ the compressor suction access fitting connection.

Electrical Heater Data

ELECTRIC HEATERS								
MODEL #	MIN AIRFLOW	MAX AIRFLOW	EH*B-*S05	EH*B-*S10	EH*B-*S15	EH*B-*S18	EH*B-*S20	EH*B-*S30
DBC072*	1950	2700	X	X	X	X	X	X

DBC072*V Standard Belt-Drive Downshot

ESP, IN H ₂ O	TURNS OPEN																	
	0			1			2			3			4			5		
	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP
0.1	2898	1315	1.90	2754	1245	1.62	2612	1175	1.37	2498	1110	1.16	2366	1040	0.97	2227	970	0.79
0.2	2838	1315	1.85	2690	1245	1.57	2544	1175	1.33	2423	1110	1.12	2283	1040	0.93	2137	970	0.75
0.3	2777	1315	1.81	2624	1245	1.53	2472	1175	1.28	2345	1110	1.08	2198	1040	0.89	2041	970	0.71
0.4	2714	1315	1.76	2557	1245	1.48	2399	1175	1.24	2265	1110	1.04	2108	1040	0.84	1941	970	0.67
0.5	2649	1315	1.71	2486	1245	1.43	2322	1175	1.19	2180	1110	0.99	2013	1040	0.80	1833	970	0.63
0.6	2583	1315	1.66	2414	1245	1.39	2242	1175	1.15	2092	1110	0.95	1913	1040	0.76	-	-	-
0.7	2514	1315	1.61	2339	1245	1.34	2159	1175	1.10	1999	1110	0.90	1805	1040	0.71	-	-	-
0.8	2443	1315	1.56	2260	1245	1.29	2072	1175	1.05	1900	1110	0.86	-	-	-	-	-	-

DBC072*S High-Static Belt-Drive Downshot

ESP, IN H ₂ O	TURNS OPEN																	
	0			1			2			3			4			5		
	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP
0.6	-	-	-	-	-	-	2630	1385	1.88	2492	1315	1.60	2337	1245	1.34	2179	1175	1.11
0.7	-	-	-	-	-	-	2569	1385	1.83	2425	1315	1.55	2264	1245	1.29	2098	1175	1.07
0.8	-	-	-	-	-	-	2507	1385	1.78	2357	1315	1.50	2188	1245	1.25	2013	1175	1.02
0.9	-	-	-	-	-	-	2442	1385	1.73	2285	1315	1.45	2109	1245	1.20	1924	1175	0.97
1.0	-	-	-	2514	1455	1.96	2375	1385	1.68	2211	1315	1.40	2026	1245	1.15	1828	1175	0.93
1.1	-	-	-	2452	1455	1.91	2306	1385	1.62	2134	1315	1.35	1938	1245	1.10	-	-	-
1.2	-	-	-	2387	1455	1.86	2234	1385	1.57	2053	1315	1.30	1846	1245	1.05	-	-	-
1.3	-	-	-	2321	1455	1.80	2159	1385	1.52	1968	1315	1.25	-	-	-	-	-	-
1.4	-	-	-	2251	1455	1.75	2080	1385	1.46	1878	1315	1.19	-	-	-	-	-	-
1.5	2346	1525	2.00	2179	1455	1.69	1998	1385	1.41	-	-	-	-	-	-	-	-	-
1.6	2280	1525	1.94	2104	1455	1.63	1911	1385	1.35	-	-	-	-	-	-	-	-	-
1.7	2211	1525	1.88	2026	1455	1.57	1819	1385	1.29	-	-	-	-	-	-	-	-	-
1.8	2140	1525	1.82	1943	1455	1.51	-	-	-	-	-	-	-	-	-	-	-	-

¹To operate below 0.6" H₂O external static pressure, motor and blower sheave must be changed to VL34 and AK59 respectively, or equivalents.

DBC072*V Standard Belt-Drive Horizontal

ESP, IN H ₂ O	TURNS OPEN																	
	0			1			2			3			4			5		
	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP
0.1	2840	1315	1.87	2701	1245	1.59	2563	1175	1.35	2437	1110	1.14	2296	1040	0.94	2151	970	0.77
0.2	2782	1315	1.82	2638	1245	1.55	2496	1175	1.30	2365	1110	1.10	2217	1040	0.90	2064	970	0.73
0.3	2722	1315	1.77	2574	1245	1.50	2427	1175	1.26	2289	1110	1.06	2134	1040	0.86	1973	970	0.69
0.4	2661	1315	1.73	2508	1245	1.46	2355	1175	1.22	2211	1110	1.01	2048	1040	0.82	1876	970	0.65
0.5	2598	1315	1.68	2440	1245	1.41	2280	1175	1.17	2129	1110	0.97	1956	1040	0.78	-	-	-
0.6	2533	1315	1.63	2369	1245	1.36	2202	1175	1.13	2044	1110	0.93	1860	1040	0.74	-	-	-
0.7	2466	1315	1.58	2296	1245	1.31	2121	1175	1.08	1953	1110	0.88	-	-	-	-	-	-
0.8	2397	1315	1.53	2219	1245	1.27	2036	1175	1.03	1858	1110	0.84	-	-	-	-	-	-

DBC072*S High-Static Belt-Drive Horizontal

ESP, IN H ₂ O	TURNS OPEN																	
	0			1			2			3			4			5		
	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP	CFM	RPM	BHP
0.6	-	-	-	-	-	-	2655	1385	1.90	2520	1315	1.62	2369	1245	1.36	2213	1175	1.13
0.7	-	-	-	-	-	-	2594	1385	1.85	2454	1315	1.57	2296	1245	1.31	2132	1175	1.09
0.8	-	-	-	-	-	-	2531	1385	1.80	2385	1315	1.52	2219	1245	1.27	2046	1175	1.04
0.9	-	-	-	-	-	-	2466	1385	1.75	2313	1315	1.47	2140	1245	1.22	1956	1175	0.99
1.0	-	-	-	2552	1455	2.00	2399	1385	1.70	2239	1315	1.42	2056	1245	1.17	1860	1175	0.94
1.1	-	-	-	2489	1455	1.94	2330	1385	1.64	2161	1315	1.37	1968	1245	1.12	-	-	-
1.2	-	-	-	2424	1455	1.89	2258	1385	1.59	2080	1315	1.32	1875	1245	1.06	-	-	-
1.3	-	-	-	2357	1455	1.83	2183	1385	1.53	1995	1315	1.26	-	-	-	-	-	-
1.4	-	-	-	2287	1455	1.77	2104	1385	1.48	1904	1315	1.21	-	-	-	-	-	-
1.5	-	-	-	2215	1455	1.72	2022	1385	1.42	1808	1315	1.15	-	-	-	-	-	-
1.6	2328	1525	1.98	2139	1455	1.66	1935	1385	1.36	-	-	-	-	-	-	-	-	-
1.7	2259	1525	1.92	2060	1455	1.60	1842	1385	1.30	-	-	-	-	-	-	-	-	-
1.8	2186	1525	1.86	1976	1455	1.54	-	-	-	-	-	-	-	-	-	-	-	-

¹To operate below 0.6" H₂O external static pressure, motor and blower sheave must be changed to VL34 and AK59 respectively, or equivalents.


3-6 TONS		
DOWNFLOW ECONOMIZER PRESSURE DROP		
Cabinet	CFM	SP in.wg.
6 Ton	1800	.13"
	2400	.22"
	3000	.33"


3-6 TONS		
HORIZONTAL ECONOMIZER PRESSURE DROP		
Cabinet	CFM	SP in.wg.
6 Ton	1800	.24"
	2400	.41"
	3000	.61"

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	TYPE	HP	FLA	PART #	KW*	FLA	FLA	FLA	MCA	MOP
DBC0723S	208/230/3/60	1	17.56	136	1	0.33	2	2-Speed Belt-Drive High-Static	2	6	-	-	-	-	-	30.0/30.0	45/45
											-	-	-	9.6/8.7	-	39.6/38.7	50/50
											-	-	-	-	1.7/1.5	31.7/31.5	45/45
											-	-	-	9.6/8.7	1.7/1.5	41.3/40.2	50/50
											EH*B-3S05	3.76/5.00	10.4/12.0	-	-	30.0/30.0	45/45
														9.6/8.7	-	39.6/38.7	50/50
														-	1.7/1.5	31.7/31.5	45/45
														9.6/8.7	1.7/1.5	41.3/40.2	50/50
											EH*B-3S10	7.51/10.0	20.8/24.1	-	-	33.6/37.6	45/45
														9.6/8.7	-	45.6/48.4	50/50
														-	1.7/1.5	35.7/39.4	45/45
														9.6/8.7	1.7/1.5	47.7/50.3	50/60
											EH*B-3S15	11.3/15.0	31.3/36.1	-	-	46.6/52.6	50/60
														9.6/8.7	-	58.6/63.5	60/70
														-	1.7/1.5	48.7/54.5	50/60
														9.6/8.7	1.7/1.5	60.7/65.4	70/70
											EH*B-3S18	13.5/18.0	37.5/43.3	-	-	54.4/61.6	60/70
														9.6/8.7	-	66.4/72.5	70/80
														-	1.7/1.5	56.5/63.5	60/70
														9.6/8.7	1.7/1.5	68.5/74.4	70/80
											EH*B-3S20	15.0/19.9	41.5/47.9	-	-	59.4/67.3	60/70
														9.6/8.7	-	71.4/78.2	80/80
														-	1.7/1.5	61.5/69.2	70/70
														9.6/8.7	1.7/1.5	73.5/80.1	80/90
											EH*B-3S30	21.6/28.8	60.0/69.3	-	-	82.6/94.1	90/100
														9.6/8.7	-	94.6/105	100/110
														-	1.7/1.5	84.7/96.0	90/100
														9.6/8.7	1.7/1.5	96.7/107	100/110
DBC0723V	208/230/3/60	1	17.56	136	1	0.33	2	2-Speed Belt-Drive Standard Static	2	6	-	-	-	-	-	30.0/30.0	45/45
											-	-	-	9.6/8.7	-	39.6/38.7	50/50
											-	-	-	-	1.7/1.5	31.7/31.5	45/45
											-	-	-	9.6/8.7	1.7/1.5	41.3/40.2	50/50
											EH*B-3S05	3.76/5.00	10.4/12.0	-	-	30.0/30.0	45/45
														9.6/8.7	-	39.6/38.7	50/50
														-	1.7/1.5	31.7/31.5	45/45
														9.6/8.7	1.7/1.5	41.3/40.2	50/50
											EH*B-3S10	7.51/10.0	20.8/24.1	-	-	33.6/37.6	45/45
														9.6/8.7	-	45.6/48.4	50/50
														-	1.7/1.5	35.7/39.4	45/45
														9.6/8.7	1.7/1.5	47.7/50.3	50/60
											EH*B-3S15	11.3/15.0	31.3/36.1	-	-	46.6/52.6	50/60
														9.6/8.7	-	58.6/63.5	60/70
														-	1.7/1.5	48.7/54.5	50/60
														9.6/8.7	1.7/1.5	60.7/65.4	70/70
											EH*B-3S18	13.5/18.0	37.5/43.3	-	-	54.4/61.6	60/70
														9.6/8.7	-	66.4/72.5	70/80
														-	1.7/1.5	56.5/63.5	60/70
														9.6/8.7	1.7/1.5	68.5/74.4	70/80
											EH*B-3S20	15.0/19.9	41.5/47.9	-	-	59.4/67.3	60/70
														9.6/8.7	-	71.4/78.2	80/80
														-	1.7/1.5	61.5/69.2	70/70
														9.6/8.7	1.7/1.5	73.5/80.1	80/90
											EH*B-3S30	21.6/28.8	60.0/69.3	-	-	82.6/94.1	90/100
														9.6/8.7	-	94.6/105	100/110
														-	1.7/1.5	84.7/96.0	90/100
														9.6/8.7	1.7/1.5	96.7/107	100/110


Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	TYPE	HP	FLA	PART #	KW*	FLA	FLA	FLA	MCA	MOP
DBC0724S	460/3/60	1	8.46	66.1	1	0.33	0.85	2-Speed Belt-Drive High-Static	2	2.9	-	-	-	-	-	14.3	20
											-	-	-	4.3	-	18.6	25
											-	-	-	-	0.5	14.8	20
											-	-	-	4.3	0.5	19.1	25
											-	-	-	-	-	14.3	20
											EH*B-4S05	5	6.01	4.3	-	18.6	25
											-	-	-	-	0.5	14.8	20
											-	-	-	4.3	0.5	19.1	25
											EH*B-4S10	10	12	-	-	18.7	20
											-	-	-	4.3	-	24	25
											-	-	-	-	0.5	19.3	20
											-	-	-	4.3	0.5	24.7	25
											EH*B-4S15	15	18	-	-	26.2	30
											-	-	-	4.3	-	31.6	35
											-	-	-	-	0.5	26.8	30
											-	-	-	4.3	0.5	32.2	35
											EH*B-4S18	18	21.7	-	-	30.7	35
											-	-	-	4.3	-	36.1	40
											-	-	-	-	0.5	31.3	35
											-	-	-	4.3	0.5	36.7	40
											EH*B-4S20	20	24.1	-	-	33.7	35
											-	-	-	4.3	-	39.1	40
											-	-	-	-	0.5	34.3	35
											-	-	-	4.3	0.5	39.7	40
											EH*B-4S30	30	36.1	-	-	48.7	50
											-	-	-	4.3	-	54.1	60
											-	-	-	-	0.5	49.4	50
											-	-	-	4.3	0.5	54.7	60
DBC0724V	460/3/60	1	8.46	66.1	1	0.33	0.85	2-Speed Belt-Drive Standard Static	2	2.9	-	-	-	-	-	14.3	20
											-	-	-	4.3	-	18.6	25
											-	-	-	-	0.5	14.8	20
											-	-	-	4.3	0.5	19.1	25
											-	-	-	-	-	14.3	20
											EH*B-4S05	5	6.01	4.3	-	18.6	25
											-	-	-	-	0.5	14.8	20
											-	-	-	4.3	0.5	19.1	25
											EH*B-4S10	10	12	-	-	18.7	20
											-	-	-	4.3	-	24	25
											-	-	-	-	0.5	19.3	20
											-	-	-	4.3	0.5	24.7	25
											EH*B-4S15	15	18	-	-	26.2	30
											-	-	-	4.3	-	31.6	35
											-	-	-	-	0.5	26.8	30
											-	-	-	4.3	0.5	32.2	35
											EH*B-4S18	18	21.7	-	-	30.7	35
											-	-	-	4.3	-	36.1	40
											-	-	-	-	0.5	31.3	35
											-	-	-	4.3	0.5	36.7	40
											EH*B-4S20	20	24.1	-	-	33.7	35
											-	-	-	4.3	-	39.1	40
											-	-	-	-	0.5	34.3	35
											-	-	-	4.3	0.5	39.7	40
											EH*B-4S30	30	36.1	-	-	48.7	50
											-	-	-	4.3	-	54.1	60
											-	-	-	-	0.5	49.4	50
											-	-	-	4.3	0.5	54.7	60

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	TYPE	HP	FLA	PART #	KW*	FLA	FLA	FLA	MCA	MOP
DBC0727S	575/3/60	1	6.35	55.3	1	0.33	0.67	2-Speed Belt-Drive High-Static	2	2.4	-	-	-	-	-	11	15
											-	-	-	3.5	-	14.5	20
											-	-	-	-	0.6	11.6	15
											-	-	-	3.5	0.6	15.1	20
											EH*B-7S05	5	4.81	-	-	11	15
														3.5	-	14.5	20
														-	0.6	11.6	15
														3.5	0.6	15.1	20
											EH*B-7S10	10	9.62	-	-	15	20
														3.5	-	19.4	20
														-	0.6	15.8	20
														3.5	0.6	20.2	25
											EH*B-7S15	15	14.4	-	-	21	25
														3.5	-	25.4	30
														-	0.6	21.8	25
														3.5	0.6	26.2	30
											EH*B-7S18	18	17.3	-	-	24.7	25
														3.5	-	29	30
														-	0.6	25.4	30
														3.5	0.6	29.8	30
											EH*B-7S20	20	19.2	-	-	27.1	30
														3.5	-	31.4	35
														-	0.6	27.8	30
														3.5	0.6	32.2	35
											EH*B-7S30	30	28.9	-	-	39.1	40
														3.5	-	43.5	45
														-	0.6	39.8	40
														3.5	0.6	44.2	45
DBC0727V	575/3/60	1	6.35	55.3	1	0.33	0.67	2-Speed Belt-Drive Standard Static	2	2.4	-	-	-	-	-	11	15
											-	-	-	3.5	-	14.5	20
											-	-	-	-	0.6	11.6	15
											-	-	-	3.5	0.6	15.1	20
											EH*B-7S05	5	4.81	-	-	11	15
														3.5	-	14.5	20
														-	0.6	11.6	15
														3.5	0.6	15.1	20
											EH*B-7S10	10	9.62	-	-	15	20
														3.5	-	19.4	20
														-	0.6	15.8	20
														3.5	0.6	20.2	25
											EH*B-7S15	15	14.4	-	-	21	25
														3.5	-	25.4	30
														-	0.6	21.8	25
														3.5	0.6	26.2	30
											EH*B-7S18	18	17.3	-	-	24.7	25
														3.5	-	29	30
														-	0.6	25.4	30
														3.5	0.6	29.8	30
											EH*B-7S20	20	19.2	-	-	27.1	30
														3.5	-	31.4	35
														-	0.6	27.8	30
														3.5	0.6	32.2	35
											EH*B-7S30	30	28.9	-	-	39.1	40
														3.5	-	43.5	45
														-	0.6	39.8	40
														3.5	0.6	44.2	45

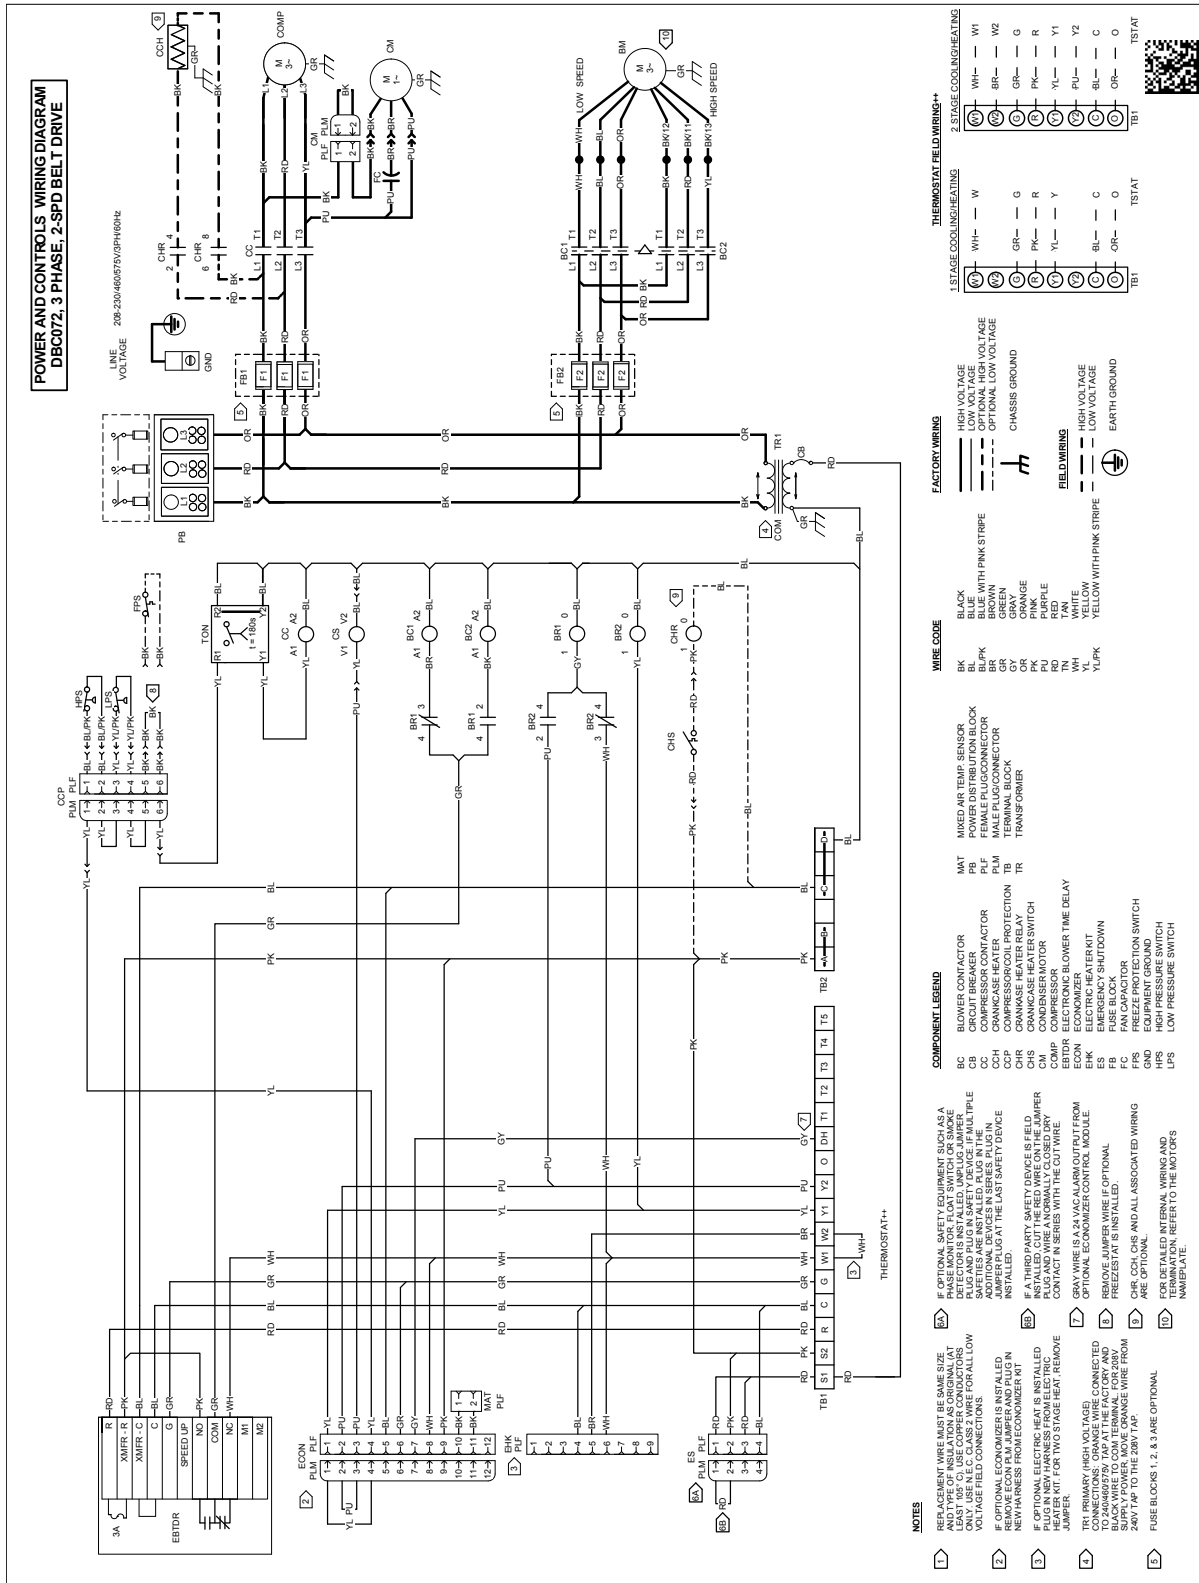


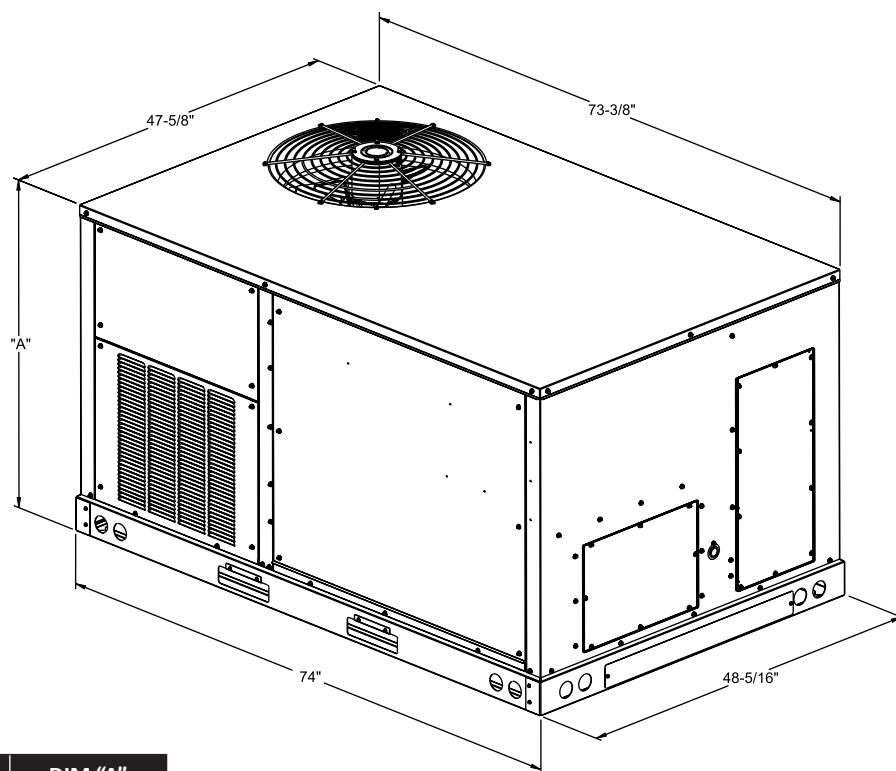





Model Size	DIM "A"
6 Ton AC	43½

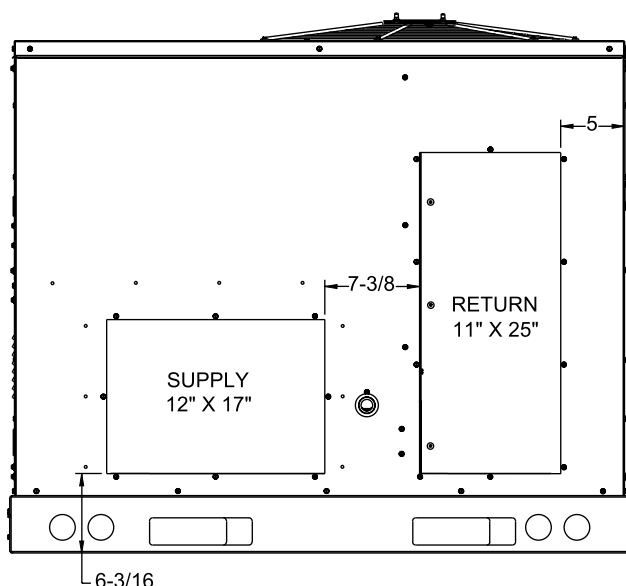

HORIZONTAL DISCHARGE

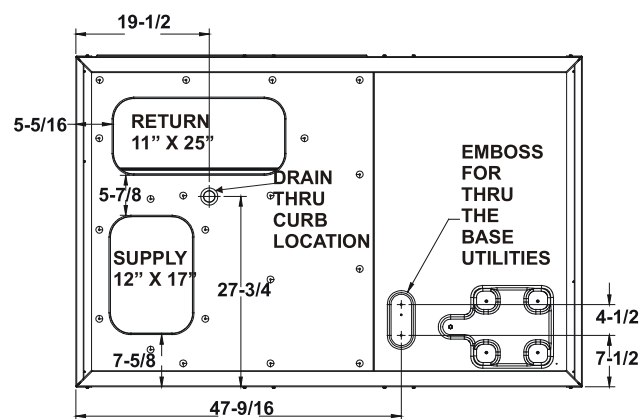


**BOTTOM VIEW OF UNIT
VERTICAL DISCHARGE**

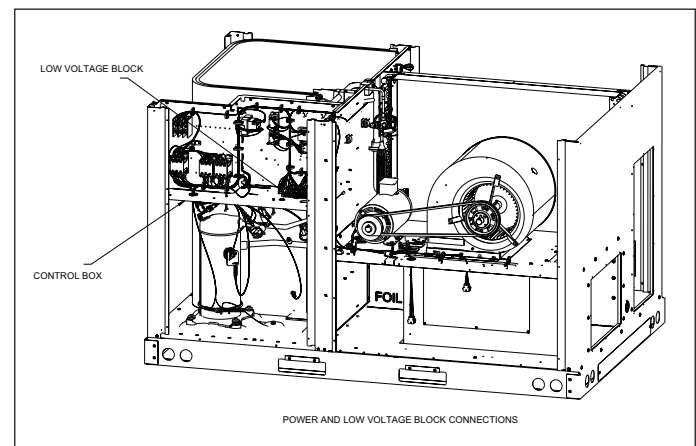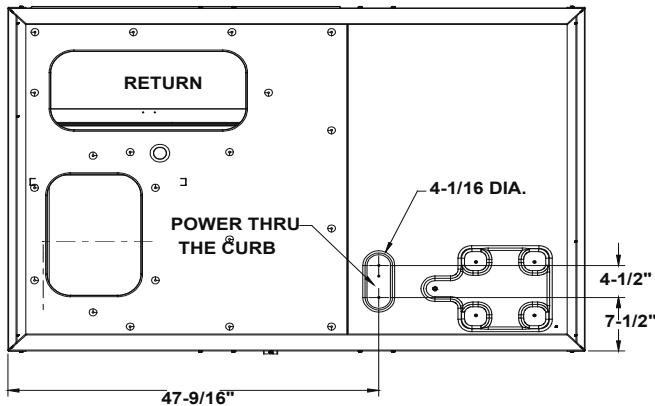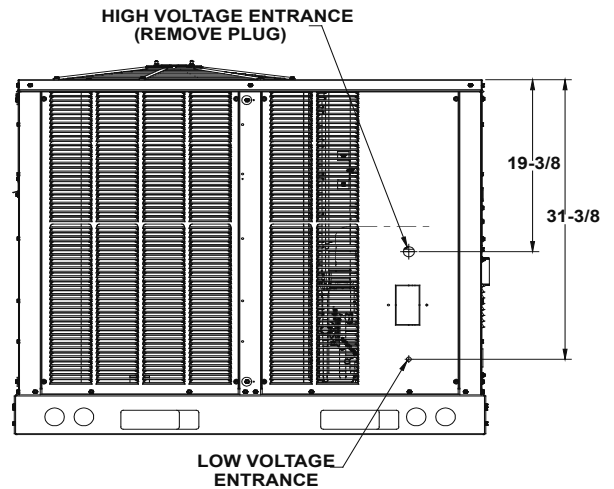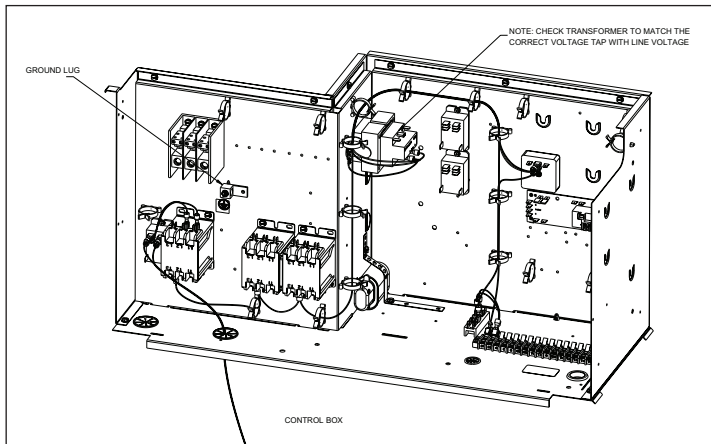

Unit Clearances

Service Clearance

Allow for recommended service clearances as shown in figure to the right. In situations that have multiple units, a 36" minimum clearance is required between the condenser coils. A clearance of 48" is recommended on all sides of the unit to allow service access and to ensure proper ventilation and condenser airflow. The top of the unit should be unobstructed. Provide a roof walkway along the sides of the unit for service and access to controls and components. Contact your Daikin sales representative for service requirements less than those recommended.

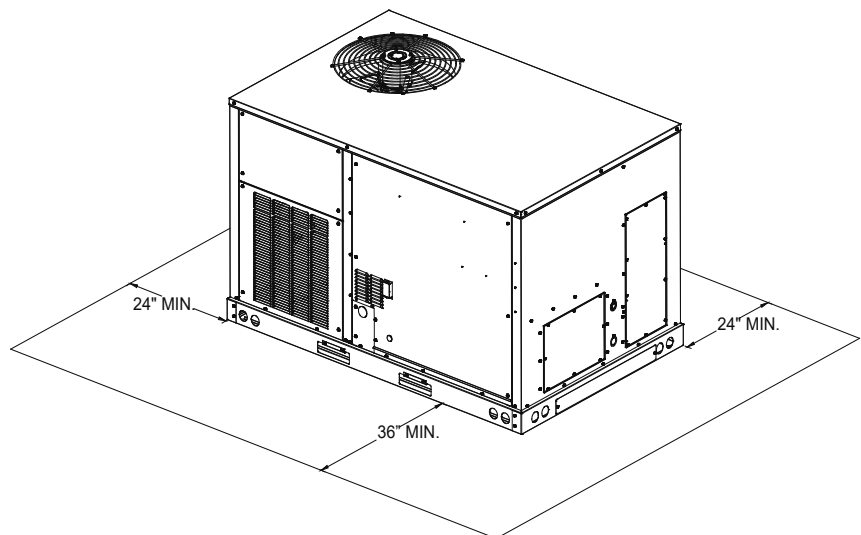

Unit Location


The structural engineer must verify that the roof has adequate support and ability to minimize deflection. Take extreme caution when using on a wooden roof structure. Unit condenser coils should be in a location that avoids any heated exhaust air.

Allow sufficient space around the unit for maintenance/service clearance. Consult your Daikin sales representative if available clearances do not meet minimum recommendations.

Where code considerations, such as the NEC, require extended clearances, these take precedence.

Provisions for forks have been included in the unit base frame. No other fork locations are approved.

- » Unit must be lifted by the four lifting holes located at the base frame corners.
- » Lifting cables should be attached to the unit with shackles.
- » The distance between the crane hook and the top of the unit must not be less than 60".
- » Two spreader bars must span over the unit to prevent damage to the cabinet by the lift cables. Spreader bars must be of sufficient length so that cables do not come in contact with the unit during transport. Remove wood struts mounted beneath unit base

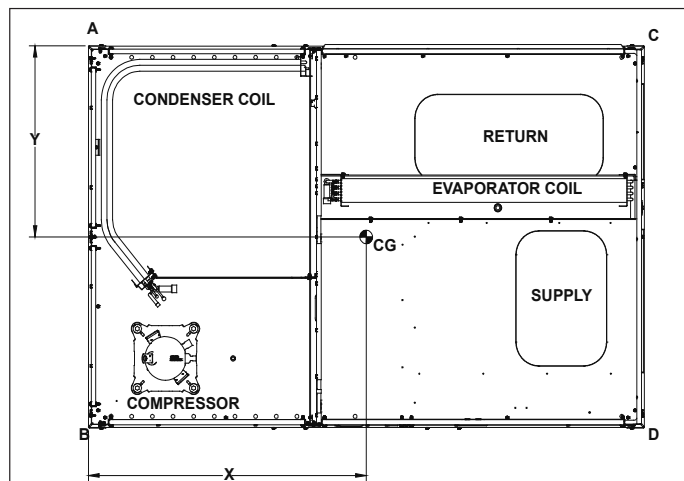

CORNER & CENTER-OF-GRAVITY LOCATIONS

frame before setting unit on roof curb. These struts are intended to protect unit base frame from forklift damage. To remove the struts, extract the sheet metal retainers and pull the struts through the base of the unit. Refer to rigging label on the unit.

Important: If using bottom discharge with roof curb, ductwork should be attached to the curb prior to installing the unit. Refer to the Roof Curb Installation Instructions for proper curb installation. Curbing must be installed in compliance with the National Roofing Contractors Association Manual. Lower unit carefully onto roof mounting curb. While rigging the unit, the center of gravity will cause the condenser end to be lower than the supply air end. Bring condenser end of unit into alignment with the curb. With condenser end of the unit resting on curb member and using curb as a fulcrum, lower opposite end of the unit until entire unit is seated on the curb. When a rectangular cantilever curb is used, take care to center the unit. Check for proper alignment and orientation of supply and return openings with duct.

Roof Curb Installation

The roof curb is field-assembled and must be installed level (within 1/16" per foot side to side). A sub-base must be constructed by the contractor in applications involving pitched roofs. Gaskets are furnished and must be installed between the unit and curb. For proper installation, follow NRCA guidelines. In applications requiring post and rail installation, an I-beam securely mounted on multiple posts should support the unit on each side. In addition, the insulation on the underside of the unit should be protected from the elements. Applications in geographic areas subjected to seismic or hurricane conditions must meet code requirements for fastening the unit to the curb and the curb to the building structure. For further and more detailed information please refer to our Daikin Light Commercial Packaged unit IOD.

Weights

Model	Shipping Weight (lbs)	Operating Weight (lbs)	Corner Weights (lbs)				Length X (in)	Width Y (in)
			A	B	C	D		
DBC0723*	724	678	141	219	72	246	34 3/4	20' 10"

For details on accessories refer to document **PM-LC-ACCESSORIES**

Notes

Notes

Our continuing commitment to quality products may mean a change in specifications without notice.
©2022 **DAIKIN COMFORT TECHNOLOGIES MANUFACTURING, L.P.** • Houston, Texas • Printed in the USA.