




Air Conditioning & Heating

GSX13

COOLING CAPACITY: 18,000 - 60,000 BTU/H

ENERGY-EFFICIENT SPLIT SYSTEM AIR CONDITIONER 13 SEER / 1½ TO 5 TONS

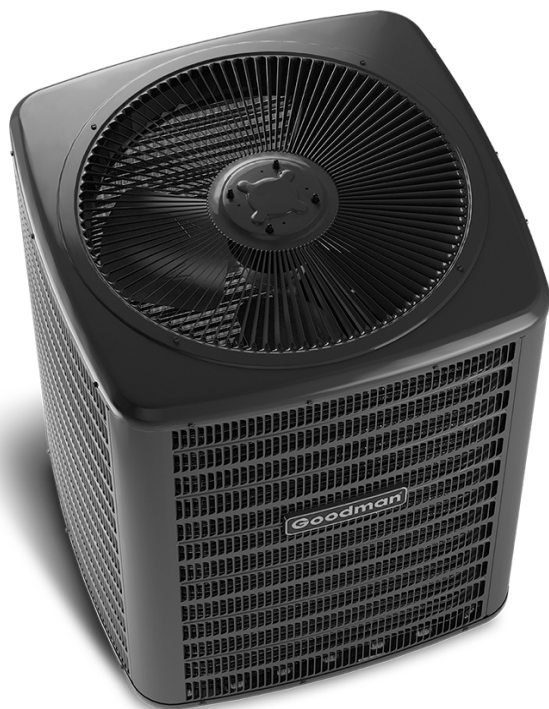

Contents

| | |
|-----------------------------|----|
| Nomenclature..... | 2 |
| Product Specifications..... | 3 |
| Expanded Cooling Data..... | 4 |
| Wiring Diagrams | 20 |
| Dimensions | 22 |
| Accessories | 22 |

Standard Features

- Energy-efficient compressor
- Factory-installed filter drier
- Copper tube/aluminum fin coil
- Service valves with sweat connections and easy-access gauge ports
- Contactor with lug connection
- Ground lug connection
- AHRI Certified; ETL Listed

Cabinet Features

- Heavy-gauge galvanized-steel cabinet with louvered sound control top
- Attractive Architectural Gray powder-paint finish with 500-hour salt-spray approval
- Steel louver coil guard
- Single-panel access to controls with space provided for field-installed accessories




COMPANY WITH
QUALITY SYSTEM
CERTIFIED BY DNV GL
■ ISO 9001 ■

COMPANY WITH
ENVIRONMENTAL SYSTEM
CERTIFIED BY DNV GL
■ ISO 14001 ■



* Complete warranty details available from your local dealer or at www.goodmanmfg.com. To receive the 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Quebec.

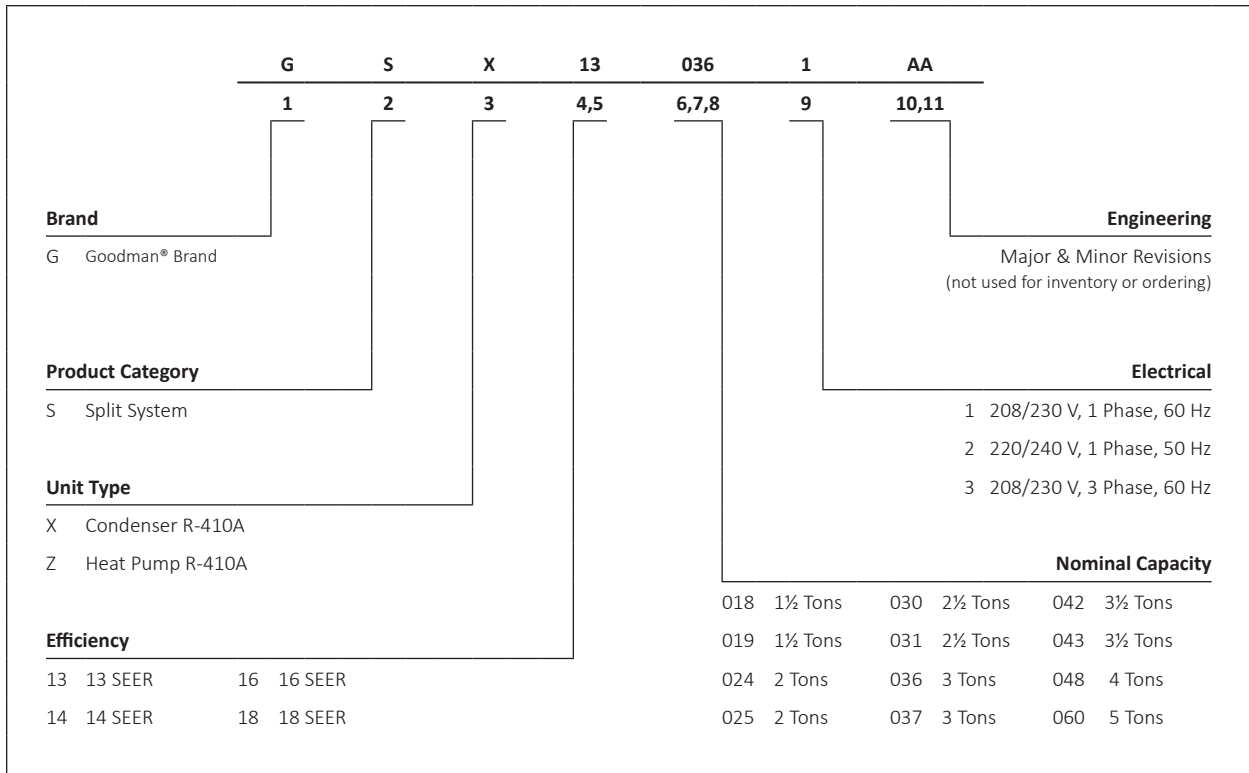

| | GSX13 0181E* | GSX13 0181EH | GSX13 0181EJ | GSX13 0241E* | GSX13 0301B* | GSX13 0301L* | GSX13 0361E* | GSX13 0421B* | GSX13 0481B* | GSX13 0601B* | GSX13 0611A* |
|---|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-------------------|-------------------|-------------------|-------------------|-----------------|
| CAPACITIES | | | | | | | | | | | |
| Nominal Cooling (BTU/h) | 18,000 | 18,000 | 18,000 | 23,000 | 30,000 | 30,000 | 36,000 | 42,000 | 48,000 | 60,000 | 60,000 |
| SEER / EER | 13/11 | 13/11 | 13/11 | 13/11 | 13/11 | 13 / 11 | 13/11 | 13/11 | 13/11 | 13/11 | 13/11 |
| Decibels | 75 | 75 | 75 | 75 | 73 | 74 | 74 | 75 | 76 | 77 | 72 |
| COMPRESSOR | | | | | | | | | | | |
| RLA | 6.7 | 6.7 | 6.0 | 7.7 | 12.8 | 10.5 | 13.6 | 17.9 | 19.9 | 25.0 | 26.4 |
| LRA | 41 | 37.5 | 37.5 | 37 | 64 | 47 | 79 | 112 | 109 | 134 | 134 |
| Stage | Single | Single | Single | Single | Single | Single | Single | Single | Single | Single | Single |
| Type | Rotary | Rotary | Rotary | Rotary | Scroll | Rotary | Scroll | Scroll | Scroll | Scroll | Scroll |
| CONDENSER FAN MOTOR | | | | | | | | | | | |
| Horsepower | 1/8 | 1/8 | 1/8 | 1/8 | 1/8 | 1/8 | 1/4 | 1/4 | 1/4 | 1/4 | 1/4 |
| FLA | 0.7 | 0.65 | 0.65 | 0.65 | 0.65 | 0.7 | 1.4 | 1.4 | 1.4 | 1.4 | 1.3 |
| REFRIGERATION SYSTEM | | | | | | | | | | | |
| Refrigerant Line Size ¹ | | | | | | | | | | | |
| Liquid Line Size ("O.D.) | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" |
| Suction Line Size ("O.D.) | 3/4" | 3/4" | 3/4" | 3/4" | 3/4" | 3/4" | 7/8" | 1 1/8" | 1 1/8" | 1 1/8" | 7/8" |
| Refrigerant Connection Size | | | | | | | | | | | |
| Liquid Valve Size ("O.D.) | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" | 3/8" |
| Suction Valve Size ("O.D.) ^{4 5} | 3/4" | 3/4" | 3/4" | 3/4" | 3/4" | 3/4" | 3/4" ⁴ | 7/8" ⁵ | 7/8" ⁵ | 7/8" ⁵ | 3/4" |
| Valve Type | Sweat | Sweat | Sweat | Sweat | Sweat | Sweat | Sweat | Sweat | Sweat | Sweat | Sweat |
| Refrigerant Charge | 44 | 58 | 58 | 60 | 60 | 68 | 62 | 80 | 91 | 94 | 111 |
| Shipped with Orifice Size | 0.051 | 0.051 | 0.051 | 0.055 | 0.061 | 0.067 | 0.070 | 0.076 | 0.080 | 0.086 | 0.086 |
| ELECTRICAL DATA | | | | | | | | | | | |
| Voltage (60 Hz) | 208/230 | 208/230-60 | 208/230-60 | 208/230 | 208/230 | 208/230-60 | 208/230 | 208/230 | 208/230 | 208/230 | 208/230 |
| Minimum Circuit Ampacity ² | 9.1 | 9.1 | 8.2 | 10.3 | 16.7 | 13.8 | 19.0 | 23.8 | 26.3 | 32.7 | 34.3 |
| Max. Overcurrent Protection ³ | 15 amps | 15 amps | 15 amps | 15 amps | 25 amps | 20 | 30 amps | 40 amps | 45 amps | 50 amps | 60 amps |
| Min / Max Volts | 197/253 | 197/253 | 197/253 | 197/253 | 197/253 | 197/253 | 197/253 | 197/253 | 197/253 | 197/253 | 197/253 |
| Electrical Conduit Size | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" | 1/2" or 3/4" |
| EQUIPMENT WEIGHT (LBS) | | | | | | | | | | | |
| | 102 | 102 | 102 | 103 | 115 | 138 | 118 | 171 | 175 | 184 | 211 |
| SHIP WEIGHT (LBS) | | | | | | | | | | | |
| | 117 | 117 | 117 | 120 | 132 | 153 | 135 | 189 | 193 | 202 | 233 |

¹ Line sizes denoted for 25' line sets, tested and rated in accordance with AHRI Standard 210/240. For other line-set lengths or sizes, refer to the installation & Operating instructions and/or the long line-set guidelines.

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

⁴ Installer will need to supply 3/4" to 7/8" adapters for suction line connections.

⁵ Installer will need to supply 7/8" to 1 1/8" adapters for suction line connections.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- This product may not be installed in the Southeast (including Hawaii) or Southwest Regions as of Jan. 1, 2015.

| IDB | AIRFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | ENTERING INDOOR WET BULB TEMPERATURE | | | | | | | | | | | |
|-------|---------|-----------------------------|------|-------|-------|------|------|------|------|------|------|-------|-------|--------------------------------------|------|------|------|-------|------|-------|-------|-------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 80 | Mbh | 25.8 | 26.4 | 28.2 | 30.1 | 25.2 | 25.8 | 27.5 | 29.4 | 24.6 | 25.1 | 26.9 | 28.7 | 24.0 | 24.5 | 26.2 | 28.0 | 22.8 | 23.3 | 24.9 | 26.6 | 21.1 | 21.6 | 23.1 | 24.7 |
| | S/T | 0.89 | 0.84 | 0.68 | 0.5 | 0.93 | 0.87 | 0.71 | 0.53 | 0.95 | 0.89 | 0.73 | 0.5 | 0.98 | 0.92 | 0.75 | 0.56 | 1.02 | 0.96 | 0.78 | 0.6 | 1.03 | 0.96 | 0.78 | 0.59 |
| | ΔT | 24 | 23 | 20 | 16 | 25 | 24 | 20 | 16 | 25 | 24 | 20 | 16 | 25 | 24 | 21 | 16 | 24 | 23 | 20 | 16 | 23 | 22 | 19 | 15 |
| | kW | 1.63 | 1.67 | 1.73 | 1.8 | 1.77 | 1.82 | 1.88 | 1.95 | 1.90 | 1.95 | 2.02 | 2.1 | 2.01 | 2.06 | 2.14 | 2.21 | 2.11 | 2.16 | 2.24 | 2.3 | 2.19 | 2.24 | 2.32 | 2.41 |
| | Amps | 6.8 | 6.9 | 7.2 | 7.5 | 7.4 | 7.6 | 7.8 | 8.1 | 8.1 | 8.3 | 8.6 | 8.9 | 8.7 | 8.9 | 9.2 | 9.6 | 9.2 | 9.5 | 9.8 | 10.2 | 9.8 | 10.1 | 10.5 | 10.9 |
| | Hi PR | 213 | 229 | 242 | 252.3 | 239 | 257 | 271 | 283 | 272 | 292 | 309 | 322.0 | 309 | 333 | 352 | 367 | 348 | 375 | 396 | 412.5 | 385 | 414 | 437 | 456 |
| | Lo PR | 105 | 112 | 122 | 129.7 | 111 | 118 | 129 | 137 | 115 | 123 | 134 | 142.4 | 121 | 129 | 140 | 150 | 127 | 135 | 147 | 156.8 | 131 | 139 | 152 | 162 |
| | Mbh | 28.0 | 28.6 | 30.5 | 32.6 | 27.3 | 27.9 | 29.8 | 31.9 | 26.7 | 27.2 | 29.1 | 31.1 | 26.0 | 26.6 | 28.4 | 30.4 | 24.7 | 25.3 | 27.0 | 28.8 | 22.9 | 23.4 | 25.0 | 26.7 |
| | S/T | 0.93 | 0.87 | 0.71 | 0.5 | 0.96 | 0.90 | 0.73 | 0.55 | 0.99 | 0.92 | 0.75 | 0.6 | 1.00 | 0.95 | 0.78 | 0.58 | 1.00 | 0.99 | 0.81 | 0.6 | 1.00 | 1.00 | 0.81 | 0.61 |
| | ΔT | 23 | 22 | 19 | 15 | 23 | 22 | 19 | 15 | 23 | 22 | 19 | 15 | 23 | 22 | 19 | 15 | 22 | 22 | 19 | 15 | 20 | 20 | 18 | 14 |
| | kW | 1.68 | 1.72 | 1.78 | 1.8 | 1.82 | 1.87 | 1.94 | 2.01 | 1.95 | 2.00 | 2.07 | 2.2 | 2.07 | 2.12 | 2.20 | 2.28 | 2.17 | 2.22 | 2.30 | 2.4 | 2.25 | 2.31 | 2.39 | 2.48 |
| | Amps | 7.0 | 7.2 | 7.4 | 7.7 | 7.6 | 7.8 | 8.1 | 8.4 | 8.3 | 8.5 | 8.8 | 9.2 | 8.9 | 9.1 | 9.5 | 9.9 | 9.5 | 9.8 | 10.1 | 10.5 | 10.1 | 10.4 | 10.8 | 11.2 |
| Hi PR | 219 | 236 | 249 | 260.1 | 246 | 265 | 280 | 292 | 280 | 301 | 318 | 331.9 | 319 | 343 | 362 | 378 | 359 | 386 | 408 | 425.3 | 396 | 427 | 451 | 470 | |
| Lo PR | 108 | 115 | 126 | 133.7 | 114 | 122 | 133 | 141 | 119 | 126 | 138 | 146.8 | 125 | 133 | 145 | 154 | 131 | 139 | 152 | 161.6 | 135 | 144 | 157 | 167 | |
| 85 | Mbh | 26.3 | 26.8 | 28.0 | 29.9 | 25.7 | 26.1 | 27.4 | 29.2 | 25.0 | 25.5 | 26.7 | 28.5 | 24.4 | 24.9 | 26.1 | 27.8 | 23.2 | 23.7 | 24.8 | 26.4 | 21.5 | 21.9 | 23.0 | 24.5 |
| | S/T | 0.94 | 0.90 | 0.82 | 0.66 | 0.97 | 0.94 | 0.85 | 0.69 | 1.00 | 0.96 | 0.87 | 0.70 | 1.00 | 0.99 | 0.90 | 0.73 | 1.00 | 1.00 | 0.93 | 0.75 | 1.00 | 1.00 | 0.94 | 0.76 |
| | ΔT | 26 | 25 | 24 | 21 | 26 | 26 | 24 | 21 | 26 | 26 | 24 | 21 | 26 | 26 | 25 | 21 | 24 | 25 | 24 | 21 | 23 | 23 | 23 | 20 |
| | kW | 1.65 | 1.69 | 1.75 | 1.81 | 1.79 | 1.83 | 1.90 | 1.97 | 1.92 | 1.96 | 2.04 | 2.11 | 2.03 | 2.08 | 2.16 | 2.24 | 2.13 | 2.18 | 2.26 | 2.34 | 2.21 | 2.26 | 2.35 | 2.43 |
| | Amps | 6.8 | 7.0 | 7.3 | 7.6 | 7.4 | 7.6 | 7.9 | 8.2 | 8.1 | 8.3 | 8.6 | 9.0 | 8.7 | 9.0 | 9.3 | 9.7 | 9.3 | 9.6 | 9.9 | 10.3 | 9.9 | 10.2 | 10.6 | 11.0 |
| | Hi PR | 215 | 231 | 244 | 255 | 241 | 260 | 274 | 286 | 274 | 295 | 312 | 325 | 312 | 336 | 355 | 370 | 352 | 378 | 399 | 417 | 388 | 418 | 441 | 460 |
| | Lo PR | 106 | 113 | 123 | 131 | 112 | 119 | 130 | 138 | 116 | 124 | 135 | 144 | 122 | 130 | 142 | 151 | 128 | 136 | 149 | 158 | 132 | 141 | 154 | 164 |
| | Mbh | 28.5 | 29.0 | 30.4 | 32.4 | 27.8 | 28.3 | 29.7 | 31.7 | 27.1 | 27.7 | 29.0 | 30.9 | 26.5 | 27.0 | 28.3 | 30.1 | 25.1 | 25.6 | 26.8 | 28.6 | 23.3 | 23.7 | 24.9 | 26.5 |
| | S/T | 0.97 | 0.94 | 0.85 | 0.69 | 1.00 | 0.97 | 0.88 | 0.71 | 1.00 | 1.00 | 0.90 | 0.73 | 1.00 | 1.00 | 0.93 | 0.75 | 1.00 | 1.00 | 0.96 | 0.78 | 1.00 | 1.00 | 0.97 | 0.79 |
| | ΔT | 24 | 24 | 23 | 19 | 24 | 24 | 23 | 20 | 24 | 24 | 23 | 20 | 23 | 24 | 23 | 20 | 22 | 22 | 23 | 20 | 20 | 21 | 21 | 18 |
| | kW | 1.69 | 1.73 | 1.80 | 1.86 | 1.84 | 1.89 | 1.95 | 2.03 | 1.97 | 2.02 | 2.09 | 2.17 | 2.09 | 2.14 | 2.22 | 2.30 | 2.19 | 2.24 | 2.32 | 2.41 | 2.27 | 2.33 | 2.41 | 2.50 |
| | Amps | 7.0 | 7.2 | 7.5 | 7.8 | 7.7 | 7.9 | 8.1 | 8.5 | 8.4 | 8.6 | 8.9 | 9.3 | 9.0 | 9.2 | 9.6 | 10.0 | 9.6 | 9.9 | 10.2 | 10.6 | 10.2 | 10.5 | 10.9 | 11.3 |
| Hi PR | 222 | 239 | 252 | 263 | 249 | 268 | 283 | 295 | 283 | 304 | 321 | 335 | 322 | 347 | 366 | 382 | 362 | 390 | 412 | 430 | 400 | 431 | 455 | 475 | |
| Lo PR | 109 | 116 | 127 | 135 | 115 | 123 | 134 | 143 | 120 | 128 | 139 | 148 | 126 | 134 | 146 | 156 | 132 | 140 | 153 | 163 | 137 | 145 | 159 | 169 | |
| Mbh | 28.7 | 29.3 | 30.7 | 32.7 | 28.1 | 28.6 | 30.0 | 32.0 | 27.4 | 27.9 | 29.3 | 31.2 | 26.7 | 27.3 | 28.5 | 30.4 | 25.4 | 25.9 | 27.1 | 28.9 | 23.5 | 24.0 | 25.1 | 26.8 | |
| S/T | 0.99 | 0.96 | 0.86 | 0.70 | 1.00 | 0.99 | 0.90 | 0.73 | 1.00 | 1.00 | 0.92 | 0.74 | 1.00 | 1.00 | 0.95 | 0.77 | 1.00 | 1.00 | 0.98 | 0.80 | 1.00 | 1.00 | 0.99 | 0.80 | |
| ΔT | 23 | 23 | 22 | 19 | 23 | 23 | 22 | 19 | 22 | 23 | 22 | 19 | 22 | 22 | 22 | 19 | 21 | 21 | 22 | 19 | 19 | 20 | 20 | 18 | |
| kW | 1.70 | 1.74 | 1.80 | 1.87 | 1.85 | 1.89 | 1.96 | 2.03 | 1.98 | 2.03 | 2.10 | 2.18 | 2.09 | 2.15 | 2.22 | 2.31 | 2.19 | 2.25 | 2.33 | 2.42 | 2.28 | 2.33 | 2.42 | 2.51 | |
| Amps | 7.1 | 7.2 | 7.5 | 7.8 | 7.7 | 7.9 | 8.2 | 8.5 | 8.4 | 8.6 | 8.9 | 9.3 | 9.0 | 9.3 | 9.6 | 10.0 | 9.7 | 9.9 | 10.3 | 10.7 | 10.3 | 10.5 | 10.9 | 11.4 | |
| Hi PR | 222 | 239 | 253 | 263 | 249 | 268 | 283 | 296 | 284 | 305 | 322 | 336 | 323 | 348 | 367 | 383 | 364 | 391 | 413 | 431 | 402 | 432 | 456 | 476 | |
| Lo PR | 110 | 117 | 127 | 135 | 116 | 123 | 134 | 143 | 120 | 128 | 140 | 149 | 126 | 134 | 147 | 156 | 132 | 141 | 154 | 164 | 137 | 146 | 159 | 169 | |



IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

| IDB AIRFLOW | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | ENTERING INDOOR WET BULB TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|-----------------------------|------|------|------|-------|-------|-------|------|------|------|------|--------------------------------------|-------|-------|------|------|------|------|-------|-------|-------|------|------|------|------|-------|-------|-------|------|------|------|------|-------|-------|-------|----|----|----|------|------|------|------|------|------|------|------|------|------|------|------|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| | | 65°F | | | | | 75°F | | | | | 85°F | | | | | 95°F | | | | | 105°F | | | | | 115°F | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 59 | 63 | 67 | 71 | 75 | 59 | 63 | 67 | 71 | 75 | 59 | 63 | 67 | 71 | 75 | 59 | 63 | 67 | 71 | 75 | 59 | 63 | 67 | 71 | 75 | 59 | 63 | 67 | 71 | 75 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | MBh | S/T | Δ T | kW | /anos | Hi PR | Lo PR | MBh | S/T | Δ T | kW | /anos | Hi PR | Lo PR | MBh | S/T | Δ T | kW | /anos | Hi PR | Lo PR | MBh | S/T | Δ T | kW | /anos | Hi PR | Lo PR | MBh | S/T | Δ T | kW | /anos | Hi PR | Lo PR | | | | | | | | | | | | | | | | | | | | | | | | |
| 80 | 1350 | 34.1 | 34.8 | 37.2 | 39.8 | 33.3 | 34.0 | 36.3 | 38.8 | 38.8 | 32.5 | 33.2 | 35.5 | 37.9 | 37.9 | 31.7 | 32.4 | 34.6 | 37.0 | 37.0 | 30.1 | 30.8 | 32.9 | 35.1 | 35.1 | 27.9 | 28.5 | 30.5 | 32.6 | 32.6 | 1.00 | 1.00 | 1.00 | 0.84 | 0.63 | 21 | 21 | 19 | 15 | 14 | 3.13 | 3.19 | 3.29 | 3.39 | 3.39 | 12.0 | 12.1 | 12.4 | 12.7 | 12.7 | 338 | 363 | 384 | 400 | 400 | 121 | 129 | 141 | 150 | 150 |
| | 1200 | 33.1 | 33.8 | 36.1 | 38.6 | 32.3 | 33.0 | 35.3 | 37.7 | 37.7 | 31.5 | 32.2 | 34.4 | 36.8 | 36.8 | 30.8 | 31.4 | 33.6 | 35.9 | 35.9 | 29.2 | 29.9 | 31.9 | 34.1 | 34.1 | 27.1 | 27.7 | 29.6 | 31.6 | 31.6 | 1.00 | 1.00 | 1.00 | 0.80 | 0.60 | 21 | 21 | 19 | 15 | 15 | 3.10 | 3.17 | 3.26 | 3.36 | 3.36 | 11.9 | 12.1 | 12.3 | 12.6 | 12.6 | 334 | 360 | 380 | 396 | 396 | 120 | 128 | 140 | 149 | 149 |
| | 1050 | 30.5 | 31.2 | 33.3 | 35.6 | 29.8 | 30.5 | 32.6 | 34.8 | 34.8 | 29.1 | 29.8 | 31.8 | 34.0 | 34.0 | 28.4 | 29.0 | 31.0 | 33.2 | 33.2 | 27.0 | 27.6 | 29.5 | 31.5 | 31.5 | 25.0 | 25.5 | 27.3 | 29.2 | 29.2 | 1.02 | 1.02 | 1.00 | 0.77 | 0.58 | 22 | 22 | 20 | 16 | 15 | 3.03 | 3.10 | 3.19 | 3.29 | 3.29 | 11.7 | 11.9 | 12.1 | 12.4 | 12.4 | 324 | 349 | 368 | 384 | 384 | 117 | 124 | 135 | 144 | 144 |
| | 85 | 1350 | 34.7 | 35.3 | 37.0 | 39.5 | 33.9 | 34.5 | 36.2 | 38.6 | 38.6 | 33.1 | 33.7 | 35.3 | 37.7 | 37.7 | 32.3 | 32.9 | 34.4 | 36.7 | 36.7 | 30.6 | 31.2 | 32.7 | 34.9 | 34.9 | 28.4 | 28.9 | 30.3 | 32.3 | 32.3 | 1.00 | 1.00 | 1.00 | 0.81 | 0.82 | 21 | 21 | 22 | 19 | 18 | 3.15 | 3.22 | 3.31 | 3.42 | 3.42 | 12.0 | 12.2 | 12.5 | 12.7 | 12.7 | 341 | 367 | 387 | 404 | 404 | 123 | 130 | 142 | 152 |
| 1200 | 33.7 | 34.3 | 35.9 | 38.3 | 32.9 | 33.5 | 35.1 | 37.5 | 37.5 | 32.1 | 32.7 | 34.3 | 36.6 | 36.6 | 31.3 | 31.9 | 33.4 | 35.7 | 35.7 | 29.7 | 30.3 | 31.8 | 33.9 | 33.9 | 27.6 | 28.1 | 29.4 | 31.4 | 31.4 | 1.00 | 1.00 | 1.00 | 0.78 | 0.78 | 21 | 22 | 22 | 19 | 19 | 3.13 | 3.19 | 3.29 | 3.39 | 3.39 | 12.0 | 12.1 | 12.4 | 12.7 | 12.7 | 338 | 363 | 384 | 400 | 400 | 121 | 129 | 141 | 150 | 150 | |
| 1050 | 30.9 | 31.6 | 33.7 | 36.0 | 30.3 | 30.9 | 32.4 | 34.6 | 34.6 | 29.6 | 30.2 | 31.6 | 33.7 | 33.7 | 28.9 | 29.5 | 30.9 | 32.9 | 32.9 | 27.5 | 28.0 | 29.3 | 31.3 | 31.3 | 25.4 | 25.9 | 27.2 | 29.0 | 29.0 | 1.00 | 1.00 | 1.00 | 0.75 | 0.75 | 22 | 23 | 23 | 20 | 20 | 3.06 | 3.12 | 3.21 | 3.31 | 3.31 | 11.8 | 11.9 | 12.2 | 12.5 | 12.5 | 327 | 352 | 372 | 388 | 388 | 118 | 125 | 137 | 146 | 146 | |

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Design Subcooling 9 ± 3 °F @ the liquid service valve, ARI 95 test conditions
 Amps = outdoor unit amps (comp.+fan)

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|-----|--|--------------------------------------|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|-----|----|----|----|-----|----|----|----|
| | | 65 | | | | 75 | | | | 85 | | | | 95 | | | | 105 | | | | 115 | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| | | ENTERING INDOOR WET BULB TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
| | | AIRFLOW | | | | | | | | | | | | | | | | | | | | | | | |
| | | 1500 | | | | | | | | | | | | | | | | | | | | | | | |
| | | 1750 | | | | | | | | | | | | | | | | | | | | | | | |
| | | 2000 | | | | | | | | | | | | | | | | | | | | | | | |
| | | 85 | | | | | | | | | | | | | | | | | | | | | | | |
| | | 1500 | | | | | | | | | | | | | | | | | | | | | | | |
| | | 1750 | | | | | | | | | | | | | | | | | | | | | | | |
| | | 2000 | | | | | | | | | | | | | | | | | | | | | | | |

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

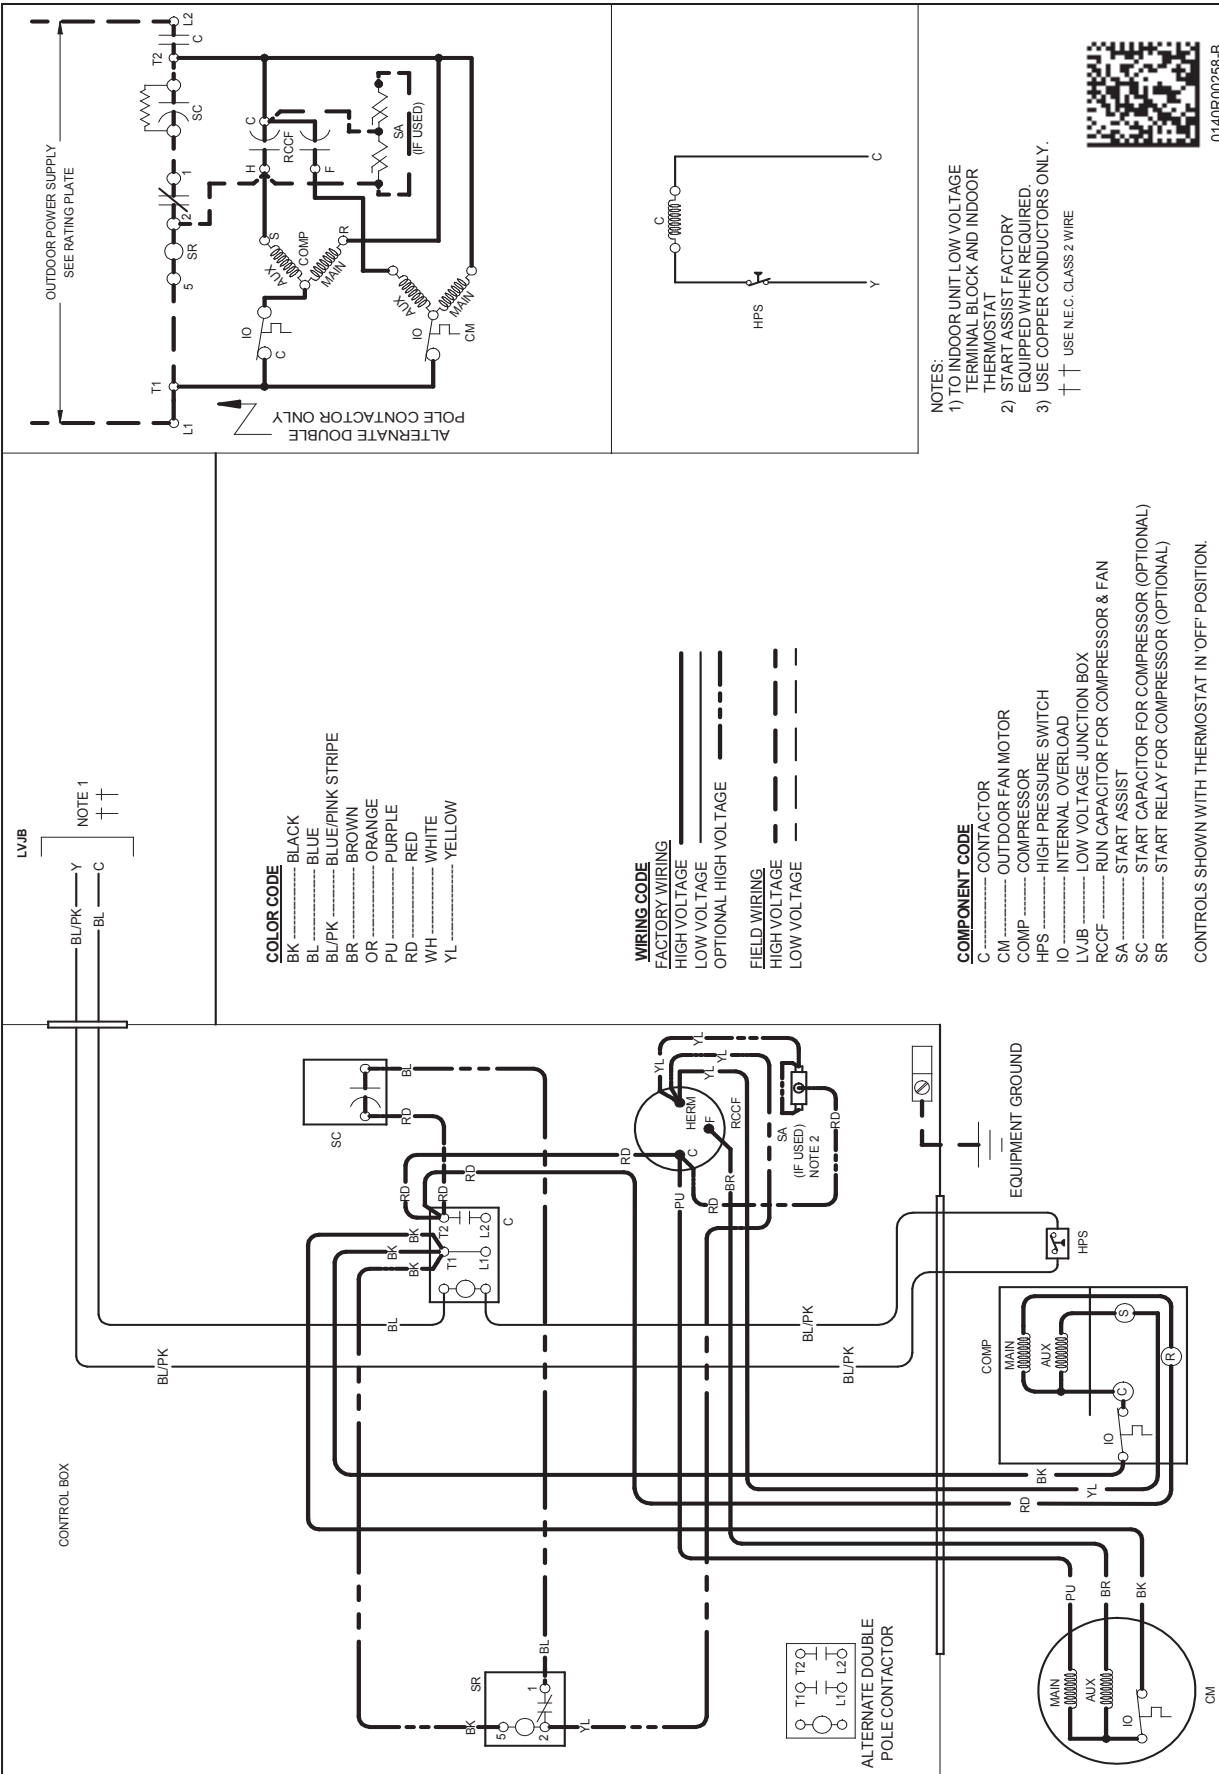

COLOR CODE

| | |
|-------|------------------|
| BK | BLACK |
| BL | BLUE |
| BL/PK | BLUE/PINK STRIPE |
| BR | BROWN |
| OR | ORANGE |
| PU | PURPLE |
| RD | RED |
| WH | WHITE |
| YL | YELLOW |

WIRING CODE



| | |
|-------|-----------------------|
| _____ | FACORY WIRING |
| _____ | HIGH VOLTAGE |
| _____ | LOW VOLTAGE |
| _____ | OPTIONAL HIGH VOLTAGE |
| _____ | FIELD WIRING |
| _____ | HIGH VOLTAGE |
| _____ | LOW VOLTAGE |

COMPONENT CODE

| | |
|------|---|
| C | CONTACTOR |
| CM | OUTDOOR FAN MOTOR |
| COMP | COMPRESSOR |
| HPS | HIGH PRESSURE SWITCH |
| IO | INTERNAL OVERLOAD |
| LVJB | LOW VOLTAGE JUNCTION BOX |
| RCCF | RUN CAPACITOR FOR COMPRESSOR & FAN |
| SA | START ASSIST |
| SC | START CAPACITOR FOR COMPRESSOR (OPTIONAL) |
| SR | START RELAY FOR COMPRESSOR (OPTIONAL) |

CONTROLS SHOWN WITH THERMOSTAT IN 'OFF' POSITION.

OUTDOOR POWER SUPPLY
SEE RATING PLATE

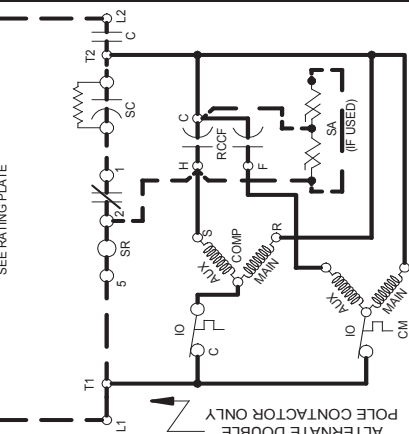

- NOTES:
- 1) TO INDOOR UNIT LOW VOLTAGE TERMINAL BLOCK AND INDOOR THERMOSTAT
 - 2) START ASSIST FACTORY EQUIPPED WHEN REQUIRED
 - 3) USE COPPER CONDUCTORS ONLY.
- ++ USE N.E.C. CLASS 2 WIRE




0140R002568-B

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

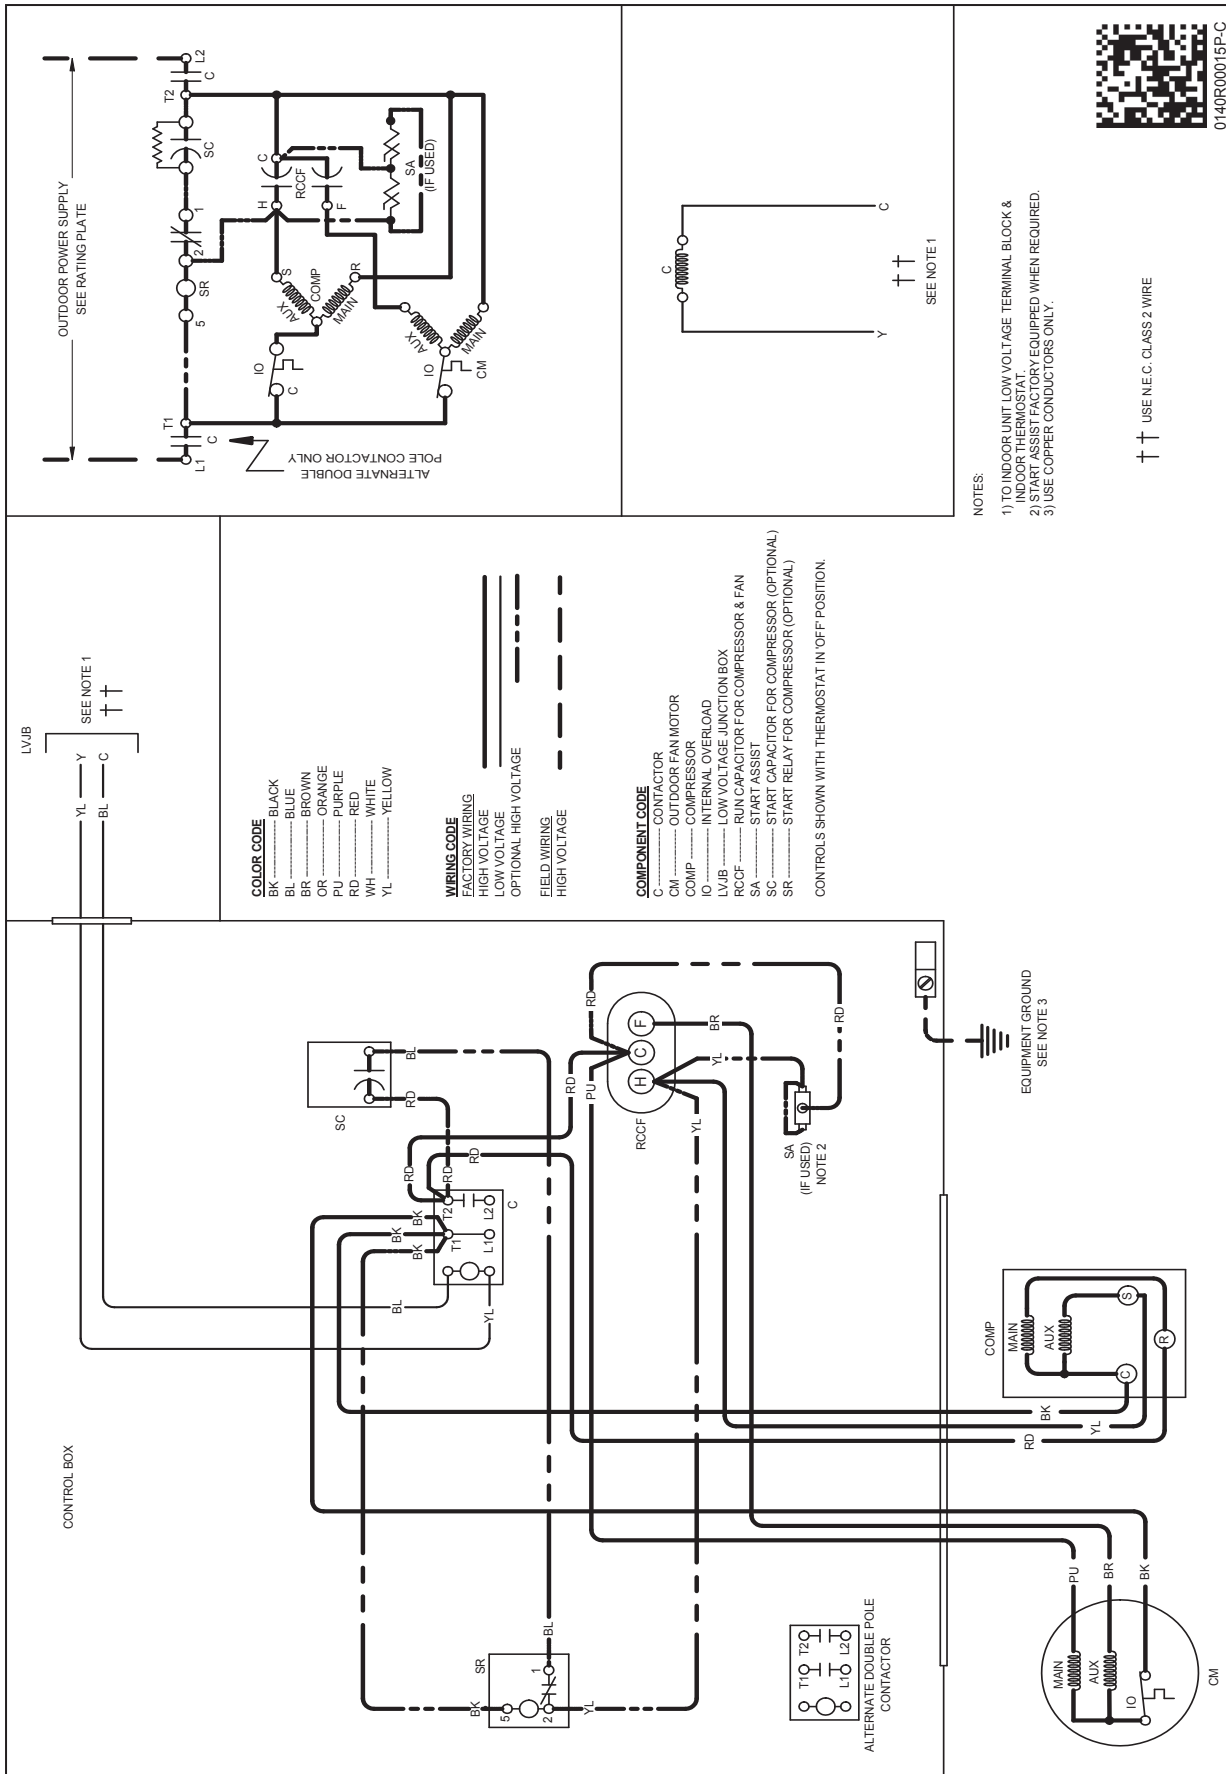


WARNING

⚡

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

DIMENSIONS

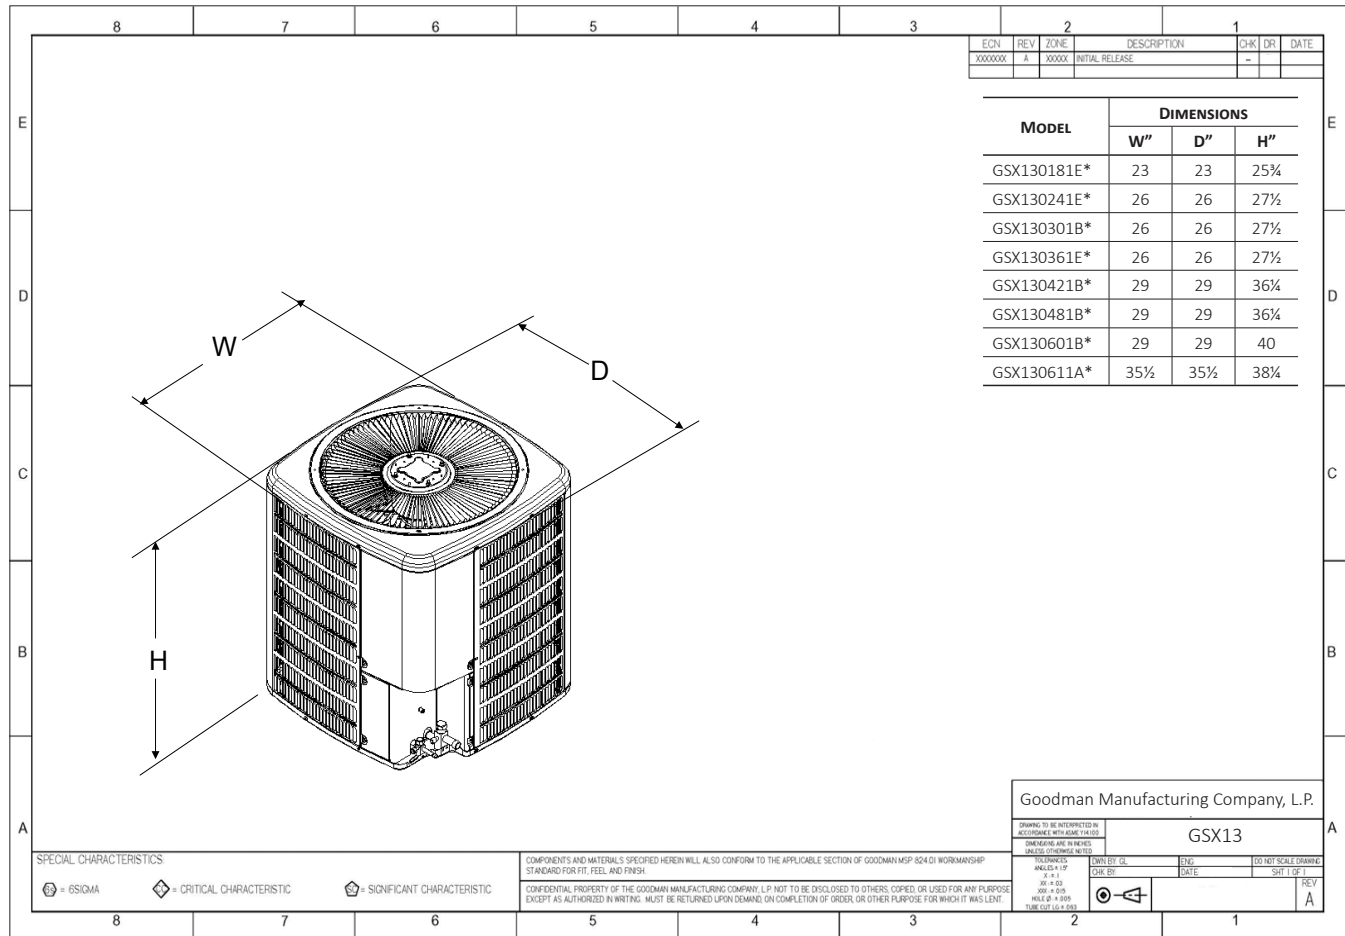

ACCESSORIES

| MODEL # | DESCRIPTION | GSX13 018E* | GSX13 024E*/F* | GSX13 030B*/L* | GSX13 036E* | EGSX13 042** | GSX13 048** | GSX13 060** | GSX13 061** |
|---------------------|--------------------------|----------------|-------------------|-------------------|----------------|-----------------|----------------|----------------|----------------|
| ABK-20 | Anchor Bracket Kit ^ | | X | X | X | X | X | X | X |
| ABK-21 | Anchor Bracket Kit ^ | X | | | | | | | |
| ASC-01 | Anti-Short Cycle Kit | X | X | X | X | X | X | X | X |
| CSR-U-1 | Hard-start Kit | X | X | X | X | | | | |
| CSR-U-2 | Hard-start Kit | | | | | X | X | X | X |
| CSR-U-3 | Hard-start Kit | | | | | | X | X | X |
| FSK01A ¹ | Freeze Protection Kit | X | X | X | X | X | X | X | X |
| LSK02A ² | Liquid Line Solenoid Kit | X | X | X | X | X | X | X | X |
| 0130R00000S | Low-Pressure Switch Kit | X | X | X | X | X | X | X | X |
| LAKT01A | Low-Ambient Kit | X | X | X | X | X | X | X | X |
| TX2N4A ² | TXV Kit | X | X | | | | | | |
| TX3N4 ² | TXV Kit | | | X | X | | | | |
| TX5N4 ² | TXV Kit | | | | | X | X | X | X |

[^] Contains 20 brackets; four brackets needed to anchor unit to pad

¹ Installed on indoor coil

² Field-installed, non-bleed, expansion valve kit: Condensing units and heat pumps with reciprocating or rotary compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit.

All AHRI system ratings are accessible in the System Configurator tool via PartnerLink.